

# Greens Crossing C-Store Harvey Mitchell Parkway (FM 2818)



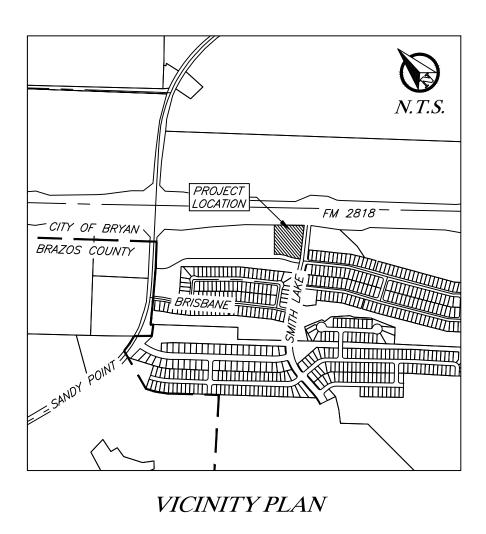

Know what's **below. Call** before you dig.



Greens Crossing Block 1, Lot 1 - 2.771 AC Bryan, Brazos County, Texas

> OWNER: STTC, LLC 11767 Katy Freeway Suite 510A Houston, TX 77079

> > DEVELOPER:

Greens Crossing Center, LLC

ENGINEER:



Firm # 9951 PO Box 5192 Bryan, Texas 77805 979-739-0567


January 2024

	Sheet List Table
Sheet Number	Sheet Title
C1	Notes
C2	Site Plan
C3	Erosion & Sedimentation Control Plan
C4	Pavement & Grading Plan
C5	Utility Plan
C6	Drainage Plan
L1	Landscape Plan
S1	BCS Unified Sewer Details
S2	BCS Unified Sewer Details
W1	BCS Unified Water Details
W2	BCS Unified Water Details
D	BCS Unified Drainage Details

# Preliminary Plans Only Not for Construction

This document is released for the purpose of interim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used for construction, bidding, or permitting purposes.

**Released for Review** 



#### General Notes:

- 1. The contractor shall promptly notify the engineer of any discrepancies between these plans and other drawings of differing disciplines & specifications.
- 2. The contractor is specifically cautioned that the location and/or elevation of the existing utilities as shown on these plans is based on records of the various utility companies and, where possible, measurements taken in the field. The information is not to be relied upon as being exact or complete. It is the contractor's responsibility to avoid all existing utilities and repair any damaged lines, at his own expense, whether the utility is shown on these plans or not. The contractor shall notify the appropriate utility company 48 hours prior to any excavation. The contractor shall also notify the engineer if design changes need to be made in the field.
- 3. Contractor to verify all underground utilities in the field prior to construction.
- 4. It is the responsibility of the contractor to comply with all state and federal regulations regarding construction activities near energized over head power lines.
- 5. The contractor shall be responsible for the protection of all existing utilities or service lines that are crossed or exposed during construction operations. Where existing utilities or service lines are cut, broken, or damaged, the contractor shall repair or replace the utilities or service line with the same type of material and construction or better. This material and work shall be at the contractor's own expense.
- 6. During the execution of the work, the contractor shall maintain the project site in an orderly and acceptable manner as far as practical. The contractor shall clean and remove from the project area all surplus and discarded materials, temporary structures, and debris of any kind and shall leave the project site in a neat and orderly condition. All clean up will be done to the satisfaction of the engineer.
- 7. Contractor is responsible for OSHA established trench safety as described in the federal register 29 CFR Part 1926. a trench safety plan should be prepared and a "competent person" appointed prior to any and all excavating operations exceeding 5' depth. The plan is to be prepared and sealed by a registered texas professional engineer and shall be submitted to the City of College Station and consulting engineer prior to any excavation on the project.
- 8. A copy of the approved construction plans shall be kept on site at all times throughout the entire construction of the project. Contractor shall maintain a a set of redline drawings, recording as-built conditions during construction. These redline marked up drawings will be submitted to the design consultant who will make the changes on the original tracings, labeling each sheet in the set as "record drawings".
- 9. The contractor shall be responsible for safeguarding and protections all material and equipment stored on the jobsite. The contractor shall be responsible for the storage of materials in a safe and workmanlike manner to prevent injuries, during and after working hours, until project completion.
- 10. Contractor to store materials at location(s) approved by & coordinated with the owner. Equipment is to be stored overnight at locations so as not to block streets or drives. Materials are to be protected from damage by the elements.
- 11. Contractor shall saw cut remove and replace concrete pavement, and curb & gutter as required to construct proposed improvements.
- 12. It shall be the responsibility of the contractor to pay for and obtain all required permits and inspection approvals for all work shown.
- 13. Any adjacent property and right-of-way disturbed during construction will be returned to their existing condition or better. The contractor agrees to repair any damage to the public right-of-way in accordance with the standards of the applicable regulatory
- 14. All exposed dirt surfaces shall be seeded, hydro-mulched, or sodded.
- 15. The contractor shall not create a dirt nuisance or safety hazard in any street or driveway. the pavement be cleaned daily.
- 16. Adequate drainage shall be maintained at all times during construction and any drainage ditch or structure disturbed during construction shall be restored to existing conditions or better
- 17. The contractor shall coordinate all fence removal and replacement with the Owner.
- 18. The contractor shall protect all monuments, iron pins, and property corners during construction
- 19. The contractor must provide construction staking from the information provided on the plans.

<u>General Utility Note (Private & Public)</u>:

- 1. All excavation for underground utilities shall be made true to grade. Excavation shall be made a minimum of six inches below the required grade and provide a sand bed for the piping. Backfill over piping shall be made with earth or fill sand , free of debris, and shall be tamped by hand or mechanical means to the density of the adjacent undisturbed earth or to 95% standard proctor density (ASTM D698), which ever is greater. All trenching and excavation shall be done in strict accordance with current OSHA requirements and all other applicable safety codes and standards.
- 2. Minimum bury or cover specified is to be measured from finish grades. Where utility line extend under pavement, the bury or cover shall be measured from the bottom of the structure.
- 3. Utility installations in non-structural areas shall be bedded and initial backfill consistent with non-structural requirements. In structural areas (i.e. under foundations, pavement, walks, etc.) the utility shall be bedded and initial backfill with cement stabilized sand. Final backfill in these areas shall be compacted by mechanical tamping to structural compaction requirements.
- . Regardless of elevations shown for manhole rims, clean-out covers, or grates, these items shall be placed flush with the pavement elevations and slopes. Manholes and clean-outs not in pavement areas shall be set 3 inches above the finish grade.
- Contractor shall uncover existing utilities at all "points of interest" to determine if conflicts exist before commencing and construction. Notify the engineer at once of any conflict.
- 6. The contractor shall coordinate all utility installation so that grade critical elements (i.e. storm drain, sanitary sewer, etc.) do not conflict with non-grade critical elements (i.e. electrical conduit, water services, etc.).
- The contractor shall furnish all materials, equipment, and labor for excavation, boring, installation, and backfilling of utility lines and relates appurtenances, as shone on the
- 8. The loading and unloading of all pipe and other accessories shall be in accordance with the manufacturer's recommended practices and shall, at all times, be performed with care to avoid any damage to the material. The contractor shall locate and provide the necessary storage areas for materials and equipment.
- Contractor shall be responsible for coordinating all connections to public systems and installations with regulatory inspector.
- 10. This project shall be built by means of open cut except as noted on the drawings. Contractor to determine the locations of bore pits in the field subject to the inspector's approval.
- 11. Structural backfill will be required for all excavation within 5 feet of public roadway pavements or walks.
- Private Utility Notes:
- 1. The contractor shall install the proposed private utility lines in accordance with local codes, latest national plumbing code, and all applicable state and local laws. Other private or public utilities shall be installed in accordance with the utility company's specifications. Should these drawings or specifications differ with other utility company's specifications, the stricter of the two shall apply.
- 2. It shall be the responsibility of the contractor to pay for and obtain all required permits and inspection approvals for all work shown.
- The contractor shall coordinate all installations of service lines, conduits, meters, etc., with the appropriate utility company.

Water Line Notes (Public & Private):

1. All domestic water line pipe shall be constructed out of PVC (Sch 40). Public or fire water line pipe shall be constructed out of C900-DR14 and public services shall be copper.

## Storm Sewer Notes (Private):

- 1. All 15 inch to 42 inch storm sewer pipe, shall be constructed out of reinforced concrete pipe (RCP), C443 ASTM C76, Class III except as noted.
- 2. All 6 inch to 12 inch storm sewer pipe, except as noted, shall be HDPE. SDR-35, ASTM D-3034, PVC pipe may be used in place of HDPE pipe.
- 3. Contractor shall provide a minimum of 12 inch clearance at storm sewer and water line crossings and a minimum of 6 inch clearance at storm sewer and sanitary sewer crossings.
- 4. Unless otherwise specified, the contractor shall install all storm sewer pipe in accordance with the trench detail contained in these construction drawings.
- Demolition & Construction Notes:
- 1. Demolition of existing structures and improvements shall include all work contained on these plans, but shall not be limited to the items specially identified. Any materials to be demolished or cleared shall be completely removed and disposed of. This work will not only consist of above ground items, but underground elements as well, including but not limited to: tree roots, foundation systems, old pipes, etc. The contractor shall notify the engineer of any additional items that require demolition, not identified on these plans, prior to removal.
- 2. It shall be the responsibility of the contractor to stage and sequence all demolition work with utility companies to provide minimal interruption and inconvenience of utility services.
- 3. Demolished surplus material shall be legally disposed of off-site.
- 4. All pavement edges, bounding the construction area & matching with new construction shall be neatly sw cut, unless gravel. Flexible pavement shall be saw cut a minimum of 24" beyond any proposed structures.
- 5. The contractor shall clear all right-of-ways and easements contained in these construction drawings.
- 6. The contractor shall field verify and locate all existing utilities on site prior to demolition.
- 7. The contractor shall perform demolition activities as noted and shown on these plans and as directed by the owner/ developer.
- 8. It shall be the responsibility of the contractor to obtain any permits and pay any fees required for demolition and disposal from the appropriate authorities.
- 9. The contractor shall install all erosion and sediment control devices prior to commencing demolition work.
- place.
- 11. The contractor shall take all precautions to avoid damage to any existing road surface. 12. All existing items that are to remain in place which are damaged during construction shall be restored to original condition, or better, at the sole expense of the
- contractor.
- 13. Should any existing utilities not shown or shown incorrectly on this plan be found on site, the contractor shall contact the engineer immediately to discuss any possible conflicts before proceeding with any work in that area.
- 14. An asbestos survey must be performed prior to the demolishing of any structures. The contractor shall adhere to the requirements set forth in the asbestos survey and report.

#### **Dimensional Control Notes:**

- The electronic file and information generated, by J4 Engineering (J4E), for this project is considered by j4e to be confidential. When issued, it's use is intended solely for the individual or entity to which it is addressed. The material is intended for use by the recipient named, only, and permission is not granted to the recipient for distribution of these documents in any form or fashion. The recipient understands that this data is authorized "as is" without any warranty as to it performance, accuracy, freedom from error, or as to any results generated throughout its use. The recipient also understands and agrees that J4E, upon release of such data, is no longer responsible for their use or modification. The user and recipient of the electronic data accepts full responsibility and liability for any consequences arising out of their use.
- 2. All dimensions shown are to be used in conjunction with these plans for locating all improvements and shall be field verified by the contractor for workability prior to construction of improvements.
- 3. Unless otherwise shown, all dimensioning is to the back of curb or edge of pavement, which ever is applicable.

<u>Grading Notes:</u>

- 1. All unpaved areas shall be adequately graded to drain at a minimum of 1.00% slope, unless otherwise noted, so that no ponding occurs.
- 2. Unless otherwise specified, unpaved areas shall drain away from buildings so that the perimeter curb is a minimum 6" lower than the finished floor.
- 3. Finish grade adjacent to curbing or sidewalk shall be  $\frac{1}{2}$ " below the top of concrete and 2" below in landscaping areas.
- 4. When top of curb elevations are shown, the curb height is 6" unless otherwise specified.
- 5. The contractor shall follow the general intent of the grading plans. Minor adjustments to the actual elevations shown on the grading plan may be required to match existing ground elevations and structures.
- 6. Adequate drainage shall be maintained at all times during construction and any drainage ditch or structure disturbed during construction shall be restored to existing conditions or better
- 7. The approval of these plans is not an authorization to grade adjacent properties. When field conditions warrant off-site grading, permission must be obtained from the affected property owner(s). Any adjacent property and right-of-way disturbed during construction will be returned to there existing conditions or better.

#### Erosion Control Notes:

- 1. Erosion control measures shown in these plans shall be considered the very minimum required. It shall be the responsibility of the contractor to implement all other erosion control measures (diversion berms, drainage structures, swales, additional fencing, etc...) necessary to keep the existing improvements and developments from damage of any kind, during all phases of demolition and construction.
- 2. The site operator, or his representative established by a letter of delegation, shall make a visual inspection of all siltation controls and newly stabilized areas on a daily basis; especially after a rainfall to insure that all controls are maintained and properly functioning. Any damaged controls shall be repaired or replaced prior to the end of the work day, including re-seeding and mulching or re-sodding, if necessary.
- 3. All sediment trapping devices shall be installed as soon as practical after the area has been disturbed. All sediment trapping devices shall be cleaned when sediment level reaches 25% capacity. Sediment shall be disposed of by spreading on site or hauling away if not suitable for fill.
- 4. During construction, contractor shall maintain best management practice (bmp). Sediment fence. hay bale barriers, or other devices shall control all storm water leaving the site.

10. The contractor is responsible for the protection of all utilities that are to remain in

1. The contractor may obtain an electronic copy of these plans for construction purposes.

- 5. The contractor shall be responsible for establishing temporary erosion control measures as required for different phases of construction. Erosion control measures shown may need to be adjusted to handle increased or concentrated flows created by various stages of construction.
- 6. Phase II erosion control measure measures shall be implemented immediately after construction of their associated improvements. Inlet protection barriers shall be constructed with hay bales or silt fencing. Inlets located in pavements areas shall be protected with sand bags, replacing the hay bales or silt fencing once the pavement is in place. Erosion control measures shall be kept in place until upstream drainage areas are fully stabilized.
- 8. The contractor is responsible for removing sediment control devices after the site has been seeded and/ or sodded, and ground cover has taken root.
- 9. The contractor shall take all necessary measures to ensure that all disturbed areas are stabilized. Designated areas shall be block sodded and all other areas disturbed due to construction shall be hydro-mulched seeded. These stabilized areas shall be sodded or seeded, fertilized, and watered to establish a solid ground cover within 30 days of completion or if activities cease for 14 days.
- 10. When hydro-mulching is required, contractor shall keep mulch moist after installation and until area shows growth.
- 11. Erosion control measures shall be implemented prior to any excavation or demolition
- Sidewalk Construction
- 1. Sidewalks shall be doweled into and tie to any concrete structure adjacent to sidewalk (driveway, inlet box, curb) #4 x 12" bars @ 18" O.C.
- 2. ADA ramps shall be constructed per the ambulatory ramp details on the pavement plan shown in these plans. All ramps shall have a detectable warning surface for the full length of the ramp.
- Paving Notes:
- 1. The payement system shown was designed without the aid of a geotechnical investigation. Due to the plastic soils within this area, some differential movement may still occur due to seasonal soil moisture variations.
- 2. <u>Sub-grade</u>
- a. Existing trees, stumps, and large tree systems, shall be grubbed and removed. Vegetation shall be removed and the top 6 inches of top soil and sub-grade stripped from the areas to be covered by the proposed improvements.
- b. Paving areas shall be proof-rolled with a 20 ton roller and, if required at the time of construction, the contractor shall stabilize weak areas by over excavation and backfilling.
- c. Materials excavated on site, excluding the top 6 inches, may be used as fill material, under pavement areas only, if the material is free from trash, lumps, clods, organic substance, & other foreign matter.
- d. Fill material shall be placed in eight inch maximum loose lifts, with each lift wetted or dried to a moisture content range of 0% to +3% of the optimum moisture content and compacted to a uniform density of 95% of the maximum dry density as determined by ASTM D698.
- e. Compaction test, for fill, shall be verified by in-place density test for each lift. One in-place density test shall be performed for every 4,000 SF with a minimum of 3 tests being performed, per lift.
- 3. <u>Asphalt</u>
- a. All asphalt paving shall be hot-mix asphalt cement (HMAC), Type D P64-22, in accordance with TxDOT Item #340.
- b. No more than 20% RAP shall be used with HMAC mix design.
- c. Limestone base shall be prime coating with RC-250, MC-30, CRS-1P/2P, or approved equal in accordance with TxDOT Item #300 and Item #310.
- 4. <u>Portland Cement Concrete</u>
  - a. All concrete, unless otherwise specified, shall have a minimum compressive strength of 3,500 psi at 28 days for pavement and 3,000 psi at 28days for non-pavement applications (ie. sidewalks, drainage flumes, and containment structures).
- b. All concrete shall be vibrated when placed and not raked a distance greater than
- c. Unless otherwise noted, joint spacing shall not exceed 15 feet in any direction to another joint or edge of pavement. Control joints shall be cut between 4 and 18 hours after placement of concrete and may be substituted with construction joints. If provided, the contractor shall follow the general intent of the joint plans shown.
- d. Expansion joints shall not exceed a maximum spacing of 45 feet and should not be placed through the middle of area inlets or junction boxes located in the payement. All area inlets or junction boxes, located in payement area, shall be installed with isolation joints between the structure and the pavement.
- e. All joints shall be sealed with Sonoborn Sonolastic SL-1, or an approved equal
- Concrete shall not be placed if the air temperature is 50° F and falling or 95° F or higher. Concrete may be placed if the air temperature is 40° F and rising or less than 95° F.
- 5. <u>Steel</u>
- a. All reinforcing steel shall be deformed billed steel bar having a minimum yield strength of not less than 60 KSI conforming to ASTM A6115, Grade 60.
- b. All reinforcing steel shall be free from rust or other bond reducing agents.
- c. All splices in pavement and curbing steel shall be staggered and lapped 30 inches times the bar diameter or 12 inches, whichever is greater.
- d. Concrete coverage for the reinforcing steel shall comply with the ACI code, latest edition. The steel shall have a minimum  $1 \frac{1}{2}$  inch clearance.
- <u>Gas Company Notes:</u>
- 1. At all underground gas utility crossings, the contractor shall give the appropriate utility company a minimum of 72 hours notice so that their field representative may be present.
- 2. Eighteen (18) inch clearance shall be maintained between the proposed utility and the existing underground gas line. this clearance shall be measured form outside of pipe to outside of pipe, or sleeving, whichever is more conservative.
- 3. For excavation near the underground gas line(s), the contractor shall cover, or remove, the bucket teeth of the excavator. The final thirty-six (36) inches surrounding the gas line shall be excavated by hand digging.
- Traffic Control Notes:
- 1. Contractor shall provide and install traffic control devices in conformance with part VI of the Texas Manual on Uniform Traffic Control Devices (Texas MUTCD, most recent edition with revisions) during construction.
- 2. Lane closure will not be allowed unless approved by the TxDOT or COB representative, as applicable.
- 3. The work shall be completed such that the roadway will be fully opened to traffic overnight. Overnight lane closures will not be permitted, unless otherwise approved by the applicable engineer.
- 4. Plastic drums shall be used for overnight delineation of off roadway work areas.

- ——— AE —
- \_\_\_O\_\_\_\_
- \_\_\_\_\_ XXX \_\_\_\_//\_\_\_\_/

- ——— AE \_\_\_\_\_T \_\_\_
- \_\_\_\_\_T \_\_\_
- \_\_\_\_\_
- \_\_\_\_\_

# Legend

Line Types		
W-8		Existing Water Line, Size Noted
W-6		Proposed Water Line, Size Noted
W	- W	Existing Water Service
w	-w	Proposed Water Service
S-8		Existing Sanitary Sewer Line, Size Noted
S-8		Proposed Sanitary Sewer Line, Size Noted
S	- S	Existing Sanitary Sewer Service
S	- s	Proposed Sanitary Sewer Service
ST ST	- st	Existing Storm Sewer Piping
st st	- st ——	Proposed Storm Sewer Piping
GAS	GAS	Existing Natural Gas Line
GAS	GAS	Proposed Natural Gas Line
UE	- UE	Existing Underground Electrical Line
UE	- UE	Proposed Underground Electrical Line
AE	- AE	Existing Aerial Electrical Line
AE	- AE	Proposed Aerial Electrical Line
		Existing Underground Telephone
T	т	Proposed Underground Telephone
		Existing Contour, Elevation Noted
		Proposed Contour, Elevation Noted
		Existing Easement
SILT		Silt Fence
OO	-0	Existing Chain Link Fence
_oo	-0	Proposed Chain Link Fence
XXX	- xxx	Existing Wire Fence
//////_	//	Existing Board Fence
//////-		Proposed Board Fence


## Symbols

Hydrant		Storm Grate Inlet
Water Valve		S.E.T.
Water Manhole	S	Sewer Manhole
⊖ Water Meter	\$	Sewer Clean-Out
Phone Pedestal	MB	Mail Box
_O Sign	Ø	Power Pole

## Abbreviations


TP	Top of Pavement	W/	With
TC	Top of Curb	W/OUT	With Out
TG	Top of Ground	S.E.T.	Sloped End Treatment
TW	Top of Walk	BM	Bench Mark
TI	Top of Inlet	ТВМ	Temporary Bench Mark
TR	Top of Wall	SY	Square Yard
FL	Flow Line	LF	Linear Foot
TS	Top of Step	CO	Clean Out
Min	Minimum	0.C.	On Center
Max	Maximum	O.C.E.W.	On Center Each Way
N.T.S.			
N.1.D.	Not to Scale	PSI	Pounds per Square Inch
PI	Not to Scale Point of Inflection	PSI PVC	Pounds per Square Inch Polyvinyl Chloride
PI	Point of Inflection	PVC	Polyvinyl Chloride
PI PT	Point of Inflection Point of Tangency	PVC RCP	Polyvinyl Chloride Reinforced Concrete Pipe
PI PT PC	Point of Inflection Point of Tangency Point of Curvature	PVC RCP PVMT	Polyvinyl Chloride Reinforced Concrete Pipe Pavement

Description         General Notes:         1. It is the intent of these plans to comply with all City of Bryan guidelines, details, and specifications.
General Notes: 1. It is the intent of these plans to comply with all City of Bryan
1. It is the intent of these plans to comply with all City of Bryan
1. It is the intent of these plans to comply with all City of Bryan
guidelines, details, and specifications.
Preliminary Plans Only Not for Construction
This document is released for the purpose of interim review under the authority of Glenn Jones,
P.E. 97600 on 31-Jan-24. It is not to be used for construction, bidding, or permitting purposes.
Released for Review
No. Revision/Issue Date
Firm Name and Address:
J4 Engineering
PO Box 5192 - Bryan, Texas - 77805
979-739-0567 www.J4Engineering.com Firm# 9951
Project Name and Address: Greens Crossing
C-Store
<i>Green's Crossing</i> <i>Block 1, Lot 1 - 2.771 Acres</i> <i>Bryan, Brazos County, Texas</i>
Date: Jan 2024 Scale: As Noted
As Noted C1

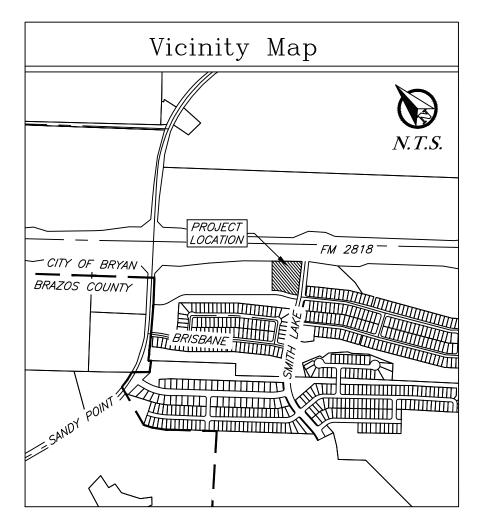

# Construction Notes:

- All proposed sewer cleanouts that are to be placed within a concrete sidewalk shall be set at the same grade as the sidewalk and utilize a flush mount, brass cap, so that there are no tripping hazards.
- All fill subgrade and base material shall be compacted to 98% STD in areas to be paved and 95% STD in all other areas.
- All items to be removed during clearing and grubbing. Remove not only the above ground elements, but all underground elements as well. All excavated material shall become the property of the contractor unless otherwise directed by the Owner. All debris must be disposed of off site.
- Prior to grading operations, contractor is to strip the first 6" of soil. Contractor shall proof roll the entire site and remove any unstable materials according to TxDOT Specifications. Select fill is to be used in replacing objectionable material.
- Assure positive drainage across project site to the storm water structures.
- The proposed limestone gravel pavement area shall follow the same detail and specifications as the asphalt parking lot, omitting the prime coat and asphalt-cement wearing surface. Limestone gravel surface shall be rolled smooth to finish grade.
- Each utility contractor is responsible for positioning and trenching of service lines. Mark all lines with utility tape. Utility contractors are responsible for coordinating with paving contractor in placement and installation of any necessary utility conduit prior to subgrade preparation. Lines requiring slope control are to be installed first. All other lines not requiring slope control or elevation shall be installed deepest first. Each contractor is responsible for knowing final determination of installation order.
- Materials and methods for pavement markings shall conform to TxDOT Standard Specifications for Construction of Highways, Streets, and Bridges (current edition), with the following exceptions: 1) Type II marking materials need not be purchased from the Department, and 2) Glass beads may be omitted, but marking material shall be Type II paint-type material.
- Fire Sprinkler System- potable water supply must be protected by testable double check valve assembly, and install as per City Ordinance.
- 10. Potable Water Protection All devices, appurtenances, appliances, and apparatus intended to serve some special function and that connects to the water supply system, shall be provided with protection against backflow and contamination of the water supply system.
- The Contractor shall be responsible for the containment and proper disposal of all liquid and solid waste associated with this project. The Contractor shall use all means necessary to prevent the occurrence of windblown litter from the project site.
- 12. Demolition/Construction Waste Site is required to provide containment for waste prior to and during demolition/construction. Solid waste roll off boxes and/or metal dumpsters shall be supplied by City to permitted contractor(s) only.
- 13. The proposed RV dump station shall be graded such that rainwater cannot enter the station.
- 14. Access to this storage facility is controlled by electronic security gate and fencing. Only existing renters will be allowed access to the RV dump station.

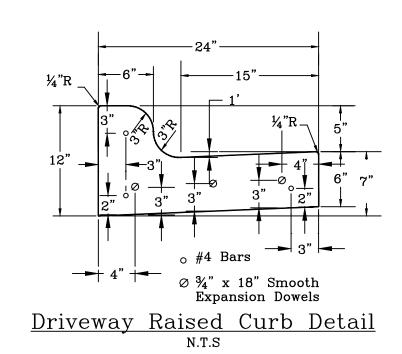

## NOTICE!

The contractor is specifically cautioned that the location and/or elevation of the existing utilities as shown on these plans is based on records of the various utility companies and, where possible, measurements taken in the field. The information is not to be relied upon as being exact or complete. It is the contractor's responsibility to avoid all existing utilities and repair any damaged lines, at his own expense, whether the utility is shown on these plans or not. The contractor shall notify the appropriate utility company 48 hours prior to any excavation. Contact Information:

Texas One Call: Lone Star One Call: Texas Excavation Safety City of Bryan	800-245-4545 800-669-8344 800-344-8377 979-209-5900
System (Digtess)	979-209-3900
Bryan Texas Utilities	979-821-5865
Atmos Energy Frontier	979-774-2506 979-821-4300
Suddenlink	979-846-2229

# Site Specific Notes:

- The owner of the property is STTC, LLC. The developer of the property is Greens Crossing Center, LLC. The subject property is Block 1, Lot 1, Greens Crossing, Bryan, Brazos County, Texas.
- The proposed building is One-Story Type IIb without fire sprinklers totaling 8,580 SF, FF=311.75' & Height 16'.
- The subject property is zoned Planned Development (PD).
- Fire flow demand is 2,000 gpm. The existing hydrants at the intersection of Smith Blake and FM 2818 and on the property will provide the fire flow for this project.
- No portion of this tract lies within a designated 100-yr floodplain according to the F.I.R.M. Maps Panel No. 48041C0195E, Revised Date, May 16, 2012.
- The developed area for this project is 2.771 acres (120,704 SF).
- Solid waste service will be provided by two onsite dumpsters.
- All minimum building setbacks shall be in accordance with City of Bryan Ordinances.
- Owner shall be responsible for the operation, repair, and maintenance of the private stormwater infrastructure.

# Utility Notes:

- Private water line and private sanitary sewer line construction shall be in accordance with the plumbing code. Cleanouts shall be installed per plumbing code.
- Private water and sewer line service materials to be in accordance with plumbing code.
- Contractor shall coordinate conduit and/or line installation for telecommunication providers for the site.
- Depth of the existing water and sewer lines to be verified by the contractor.
- Where electric facilities are installed, BTU has the right to install, operate, relocate, construct, reconstruct, add to, maintain, inspect, patrol, enlarge, repair, remove, and replace said facilities upon, over, under, and across the property included in the PUE, and the right of ingress and egress on the property adjacent to the PUE to access electric facilities.

# Fire Lane Striping:

All curbs and curb ends shall be painted red with 4" white lettering stating "FIRE LANE-NO PARKING-TOW AWAY ZONE". The phrases should be spaced 15' apart continuously. Fire Lane linework shown on this Site Plan is used to delineate the location of the fire lane for permitting purposes and is not intended to show required painted Fire Lane Striping

FIRE LANE MINO PARKING MINO AWAY ZONE Note: Fire lane shall not be painted on Flat work/surface with use of Fire Lane Signage.




<u>Note:</u>

Temporary devices around storm drains are used to detain and/or filter sediment-laden runoff. The protection allows sediment to settle prior to discharge into a storm drain inlet of catch basin. Sand bags shall be UV resistant and must not degrade due to atmospheric conditions. Sand bags shall be replaced upon first sign of deterioration. Sand bags shall be installed & monitored throughout the project upon installation of an inlet.

Storm Drain Inlet Protection

N.T.S

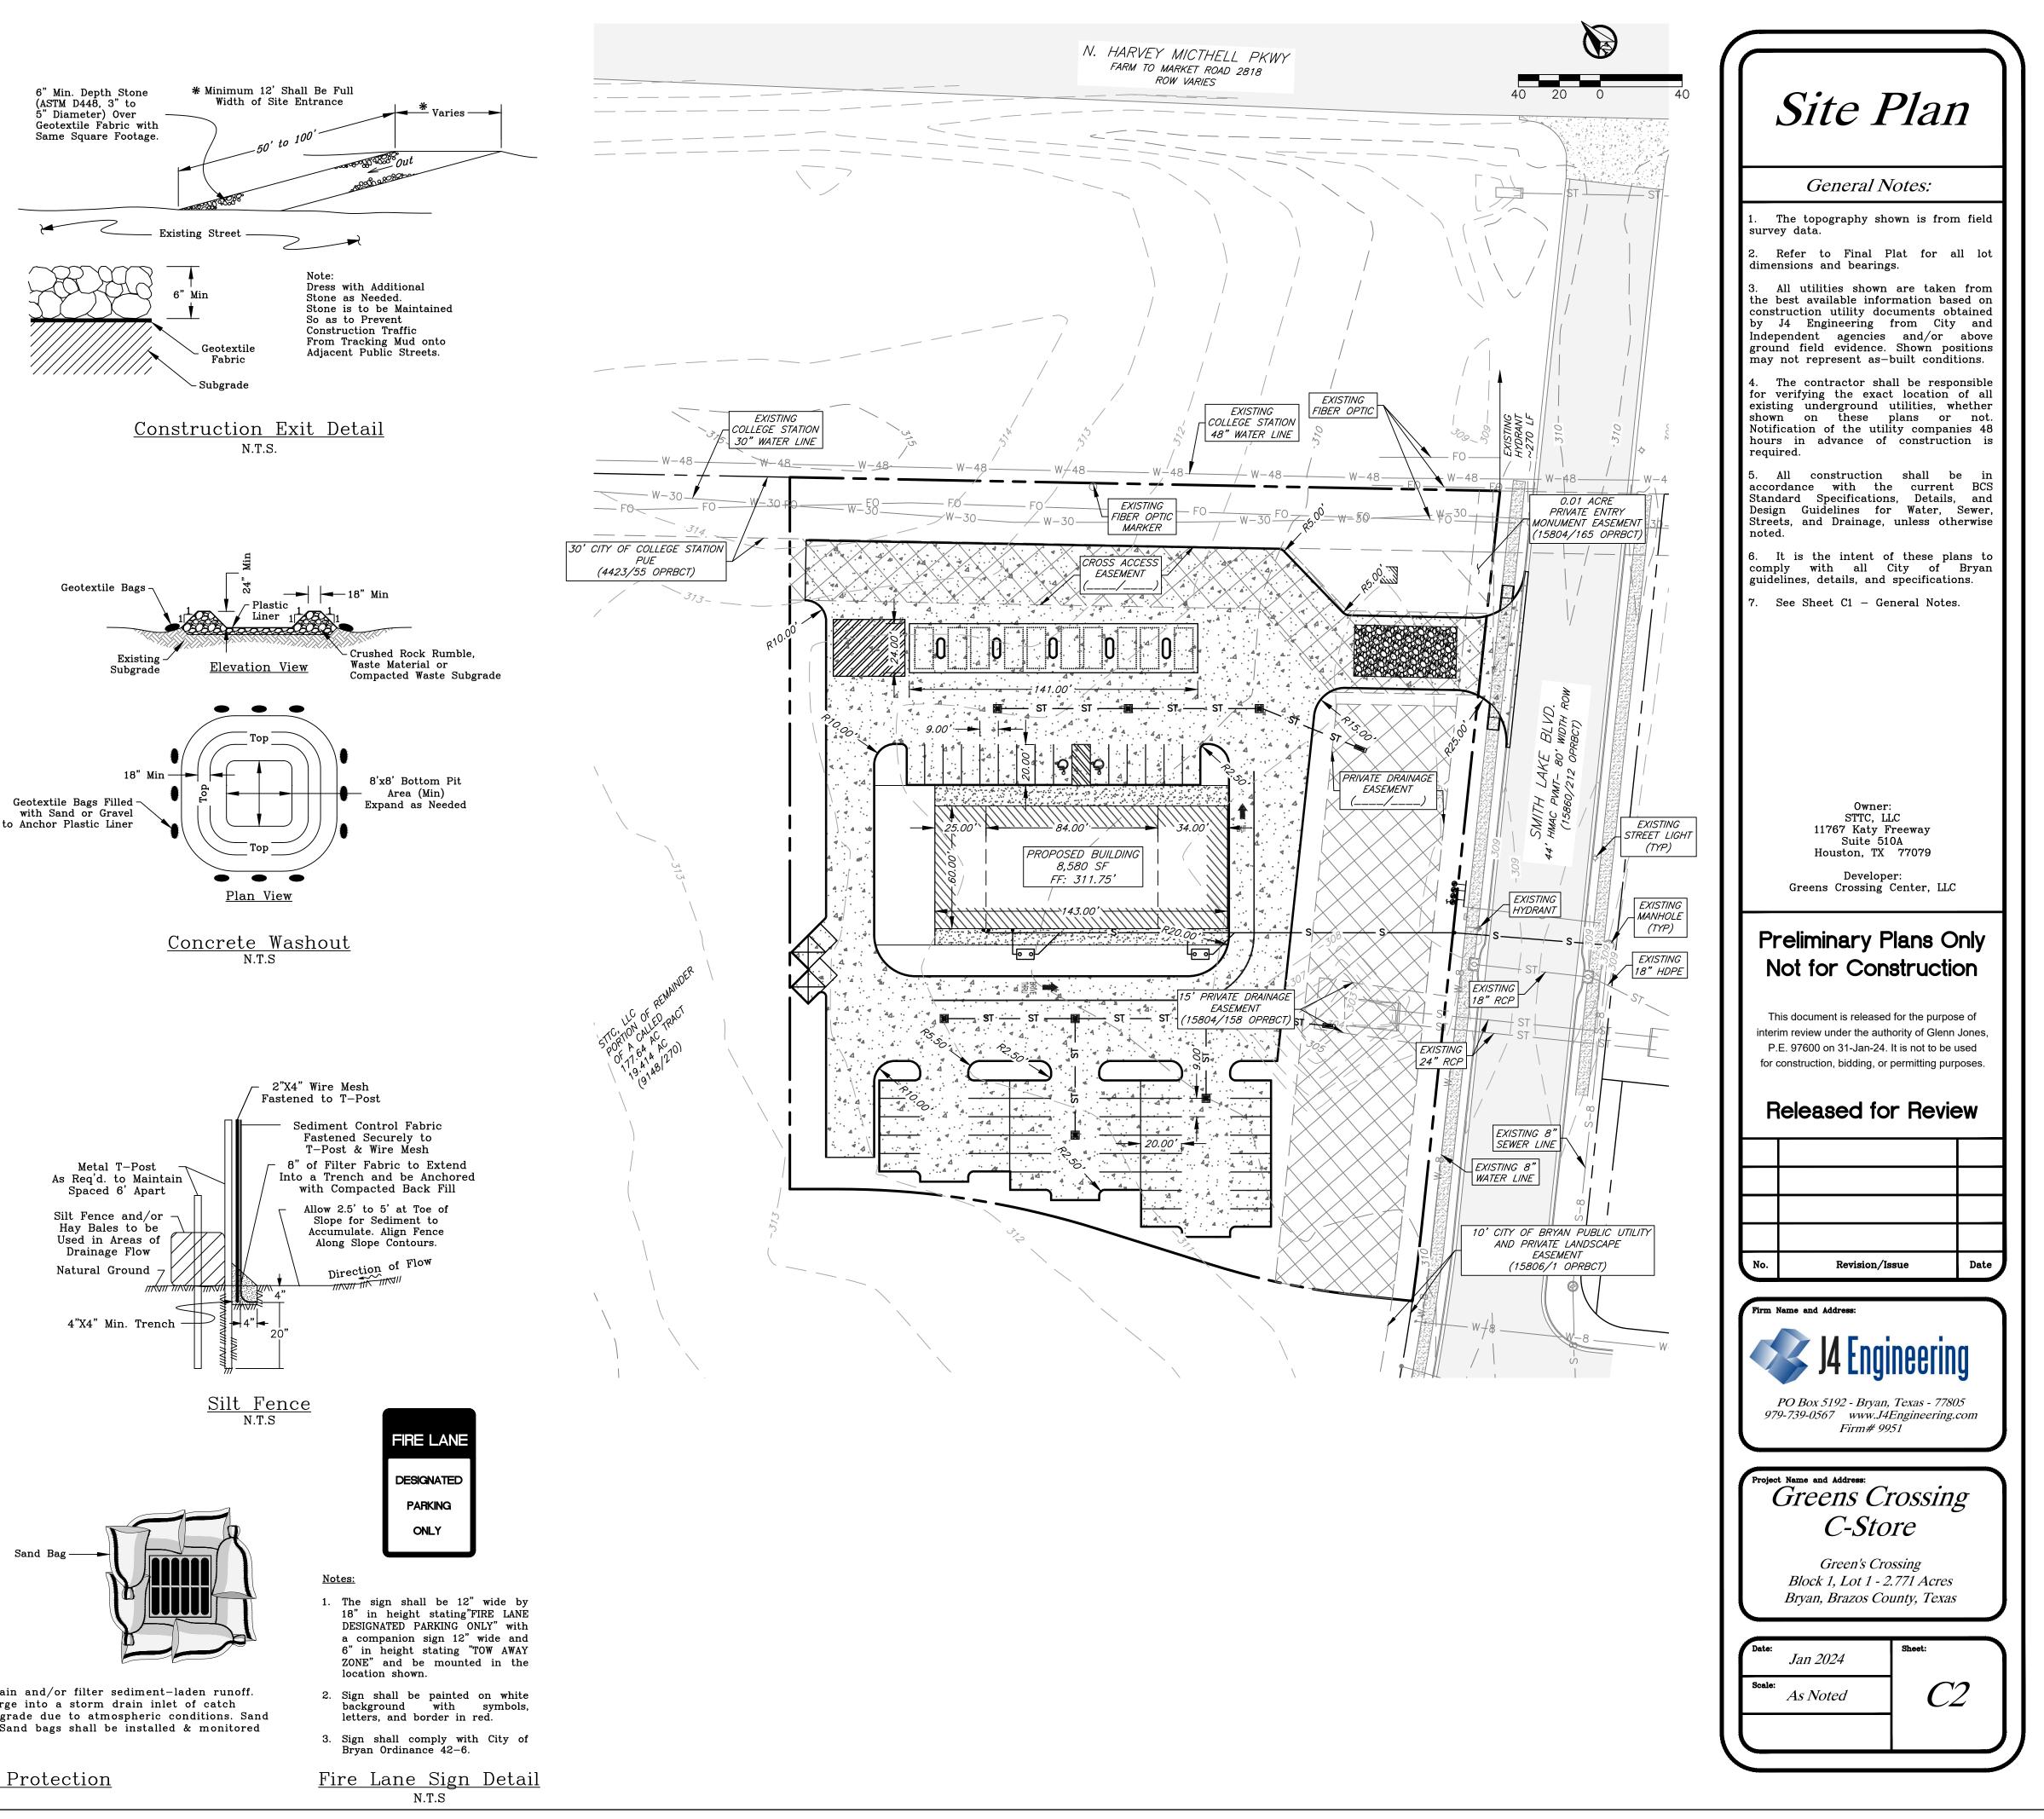

## SWPPP Information:

Nature of Construction Activity: Pavement, drainage, and utility improvements for a site development. Potential pollutants and sources - Sediment from excavations and equipment movements around the site.

# <u>Schedule of Events:</u> 1. Install silt fencing.

Install stabilized construction exit. Clear and grubb.

. Install utilities and storm culverts. Apply pavement.

 Complete grading and install permanent seeding.
 When all construction activity is completed the site is stabilized. Remove silt fence and re-seed any area disturbed during construction and assure a healthy ground cover.

<u>Areas of Disturbance:</u> During the construction of the pavement, drainage, and utility improvements the area that will be disturbed includes the street right-of-ways and the water and sanitary sewer connections to existing lines.

Structural Controls: Temporary stabilization ~ areas where construction activity temporarily ceases for at least 21 days will be stabilized with temporary seed no later than 14 days from the last construction activity in that area all proposed fill material will be seeded.

Silt fence and/or hay bales will be installed at all outfalls, areas where water runs off the site; inlets under construction will have silt fencing or hay bales placed around the perimeter of the inlet all constructed inlets will have sandbags placed in front of the throat to collect sediment but allow flow of water into the inlet.

<u>Storm Water Management:</u> Storm water drainage will be controlled by drainage ditches and a detention pond for the developed area. All areas affected by construction will be fine graded and have permanent seeding. The remainder of the area will remain in its natural state.

<u>Offsite vehicle tracking:</u> A stabilized construction entrance will be provided to help reduce vehicle tracking of sediments. The paved street adjacent to the site entrance will be swept to remove any excess mud, dirt, or rock tracked from the site. Dump trucks hauling material from the construction site will be covered with a tarpaulin.

Certification of Compliance with State and Local Regulations:

This storm water pollution prevention plan reflects the city's requirements for storm water management, erosion, and sediment control. To ensure compliance, this plan was prepared in acccordance with the cities drainage policy. There are no other applicable state or federal requirements for sediment and erosion site plans (or permits) or storm water management site plans (or permits).

<u>Maintenance/Inspection Procedures:</u>

- These are the inspection and maintenance practices that will be used to maintain erosion and sediment controls:
- All control measures will be inspected at least once every 14 days and following any storm event of 0.5 inches or greater.
  All measures will be maintained in good working order; if a repair is necessary if will be initiated within 24 hours of the report. • Built up sediment will be removed from silt fence when it has reached one-half the height of the fence. • Silt fence will be inspected for depth of sediment, tears, to see if the fabric is securely attached to the fence posts, and to see
- that the fence posts are firmly in the ground. Temporary and permanent seeding and planting will be inspected for bare spots, washouts, and healthy growth.
  A maintenance inspection report will be made after each inspection. The inspection report form will be prepared by the site
- superintendent and filed for record.
- A site superintendent will be responsible for inspections, maintenance and repair activities, and filling out the inspection and maintenance report.

<u>Non-Storm Water Discharges:</u> It is expected that the following non-storm water discharges will occur from the site during the construction period:

• Water from water line flushing

Site Description: Project name and location: Green's Crossing C-Store Bryan, Brazos County, Texas

Owner and Developer: STTC, LLC 11767 Katy Frwy Ste. 510A Houston, Texas 77079

The site is not located on Indian lands.

#### Latitude: 30° 40' 45.24" N Longitude: 96°25′4.47″W

MS4 operator name: City of Bryan, Texas

Receiving water body: Carter's Creek Estimated area to be disturbed: 2.771 acres

The storm water pollution prevention plan shall be in compliance with state and local sediment and erosion plans.

## **Operator Requirements:**

The operator shall submit a NOI to TCEQ and a copy to the operator and post a copy at the construction site in a location where it is readily available for viewing prior to commencing construction activities, and maintain the notice in that location until completion of the construction activity.

The operator shall provide a copy of the NOI to the operator of the municipal separate storm sewer system receiving the discharge, at least two (2) days prior to commencing construction activities.

The operator shall submit a NOT to TCEQ and a copy to the operator of the municipal storm sewer system once the final stabilization has been achieved and the temporary erosion controls have been removed.

Controls must be developed to limit, to the extent practicable, offsite transport of litter, construction debris and construction materials.

<u>Operator Inspection Requirements:</u> The following records must be maintained and either attached to or referenced in the storm water plan:

• The dates when major grading activities occur. • The dates when construction activities temporarily or permanently cease on a portion of the site. • The dates when stabilization measures are initiated.


A report summarizing the scope of the inspection, names and qualifications of personnel making the inspection, the dates of the inspection, and major observations must be made and retained with the storm water plan. Major observations should include:


# • The locations of discharges of sediment or other pollutants form the site;


• Locations of BMP's that failed to operate as designed or proved inadequate for a particular location; and • Locations where additional BMP's are needed.


<u>Operator's Record Keeping:</u> The permittee must retain the following records for a minimum of 3 years from the date that a NOT is submitted:

• A copy of the storm water plan and • All reports and actions required by this permit, including a copy of the construction site notice all data used to complete the NOI

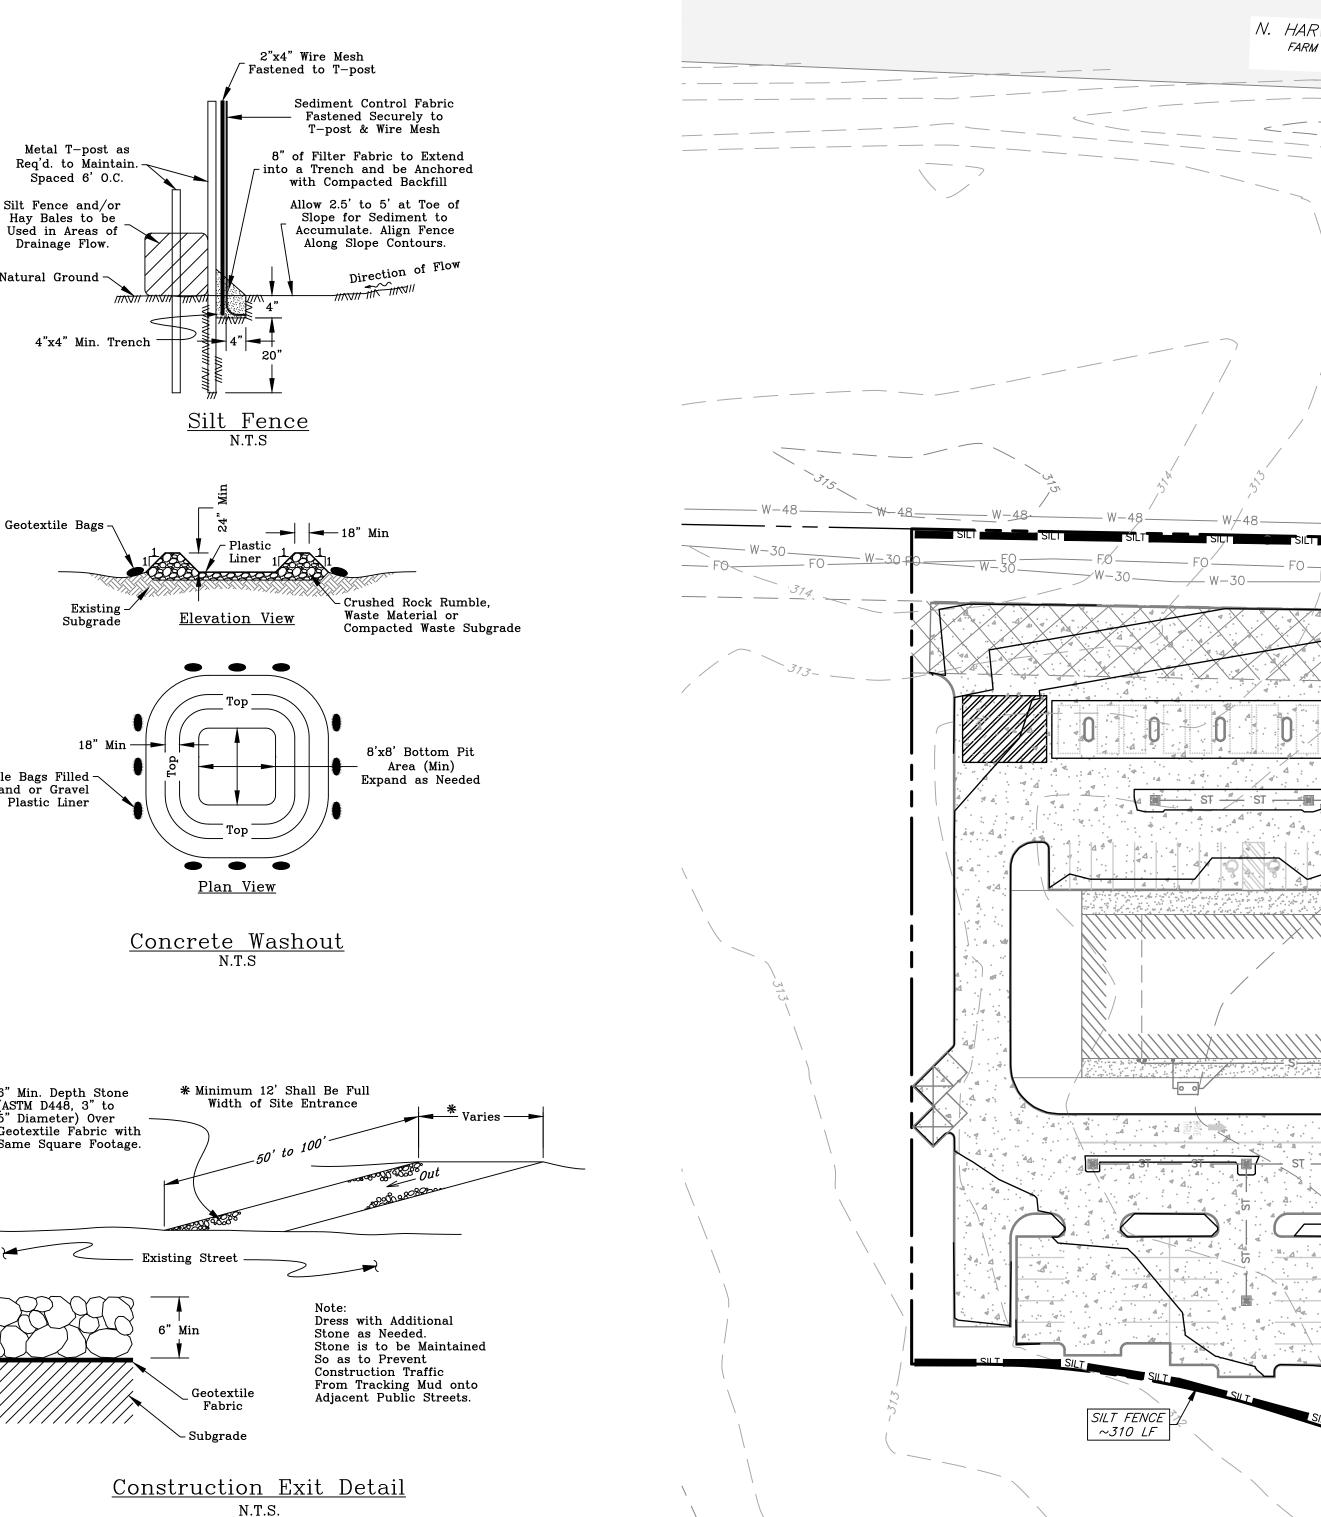

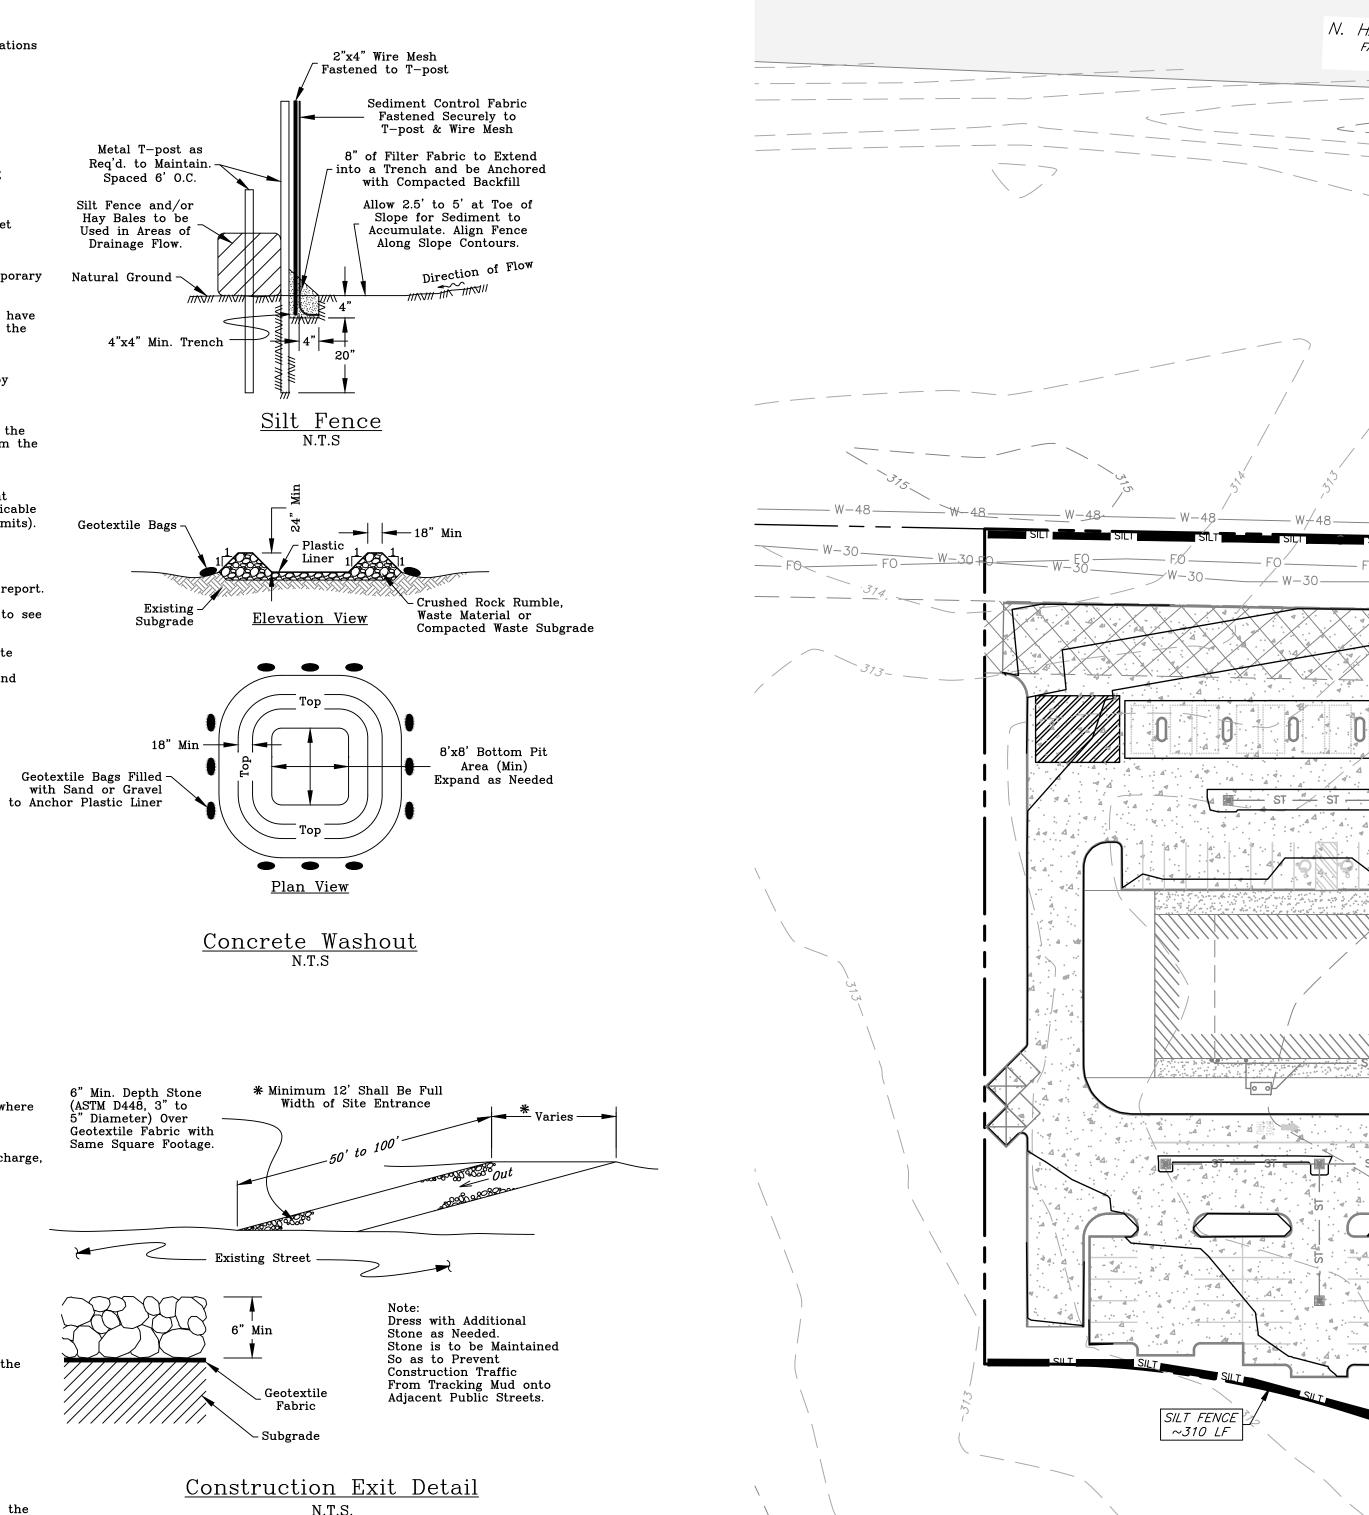

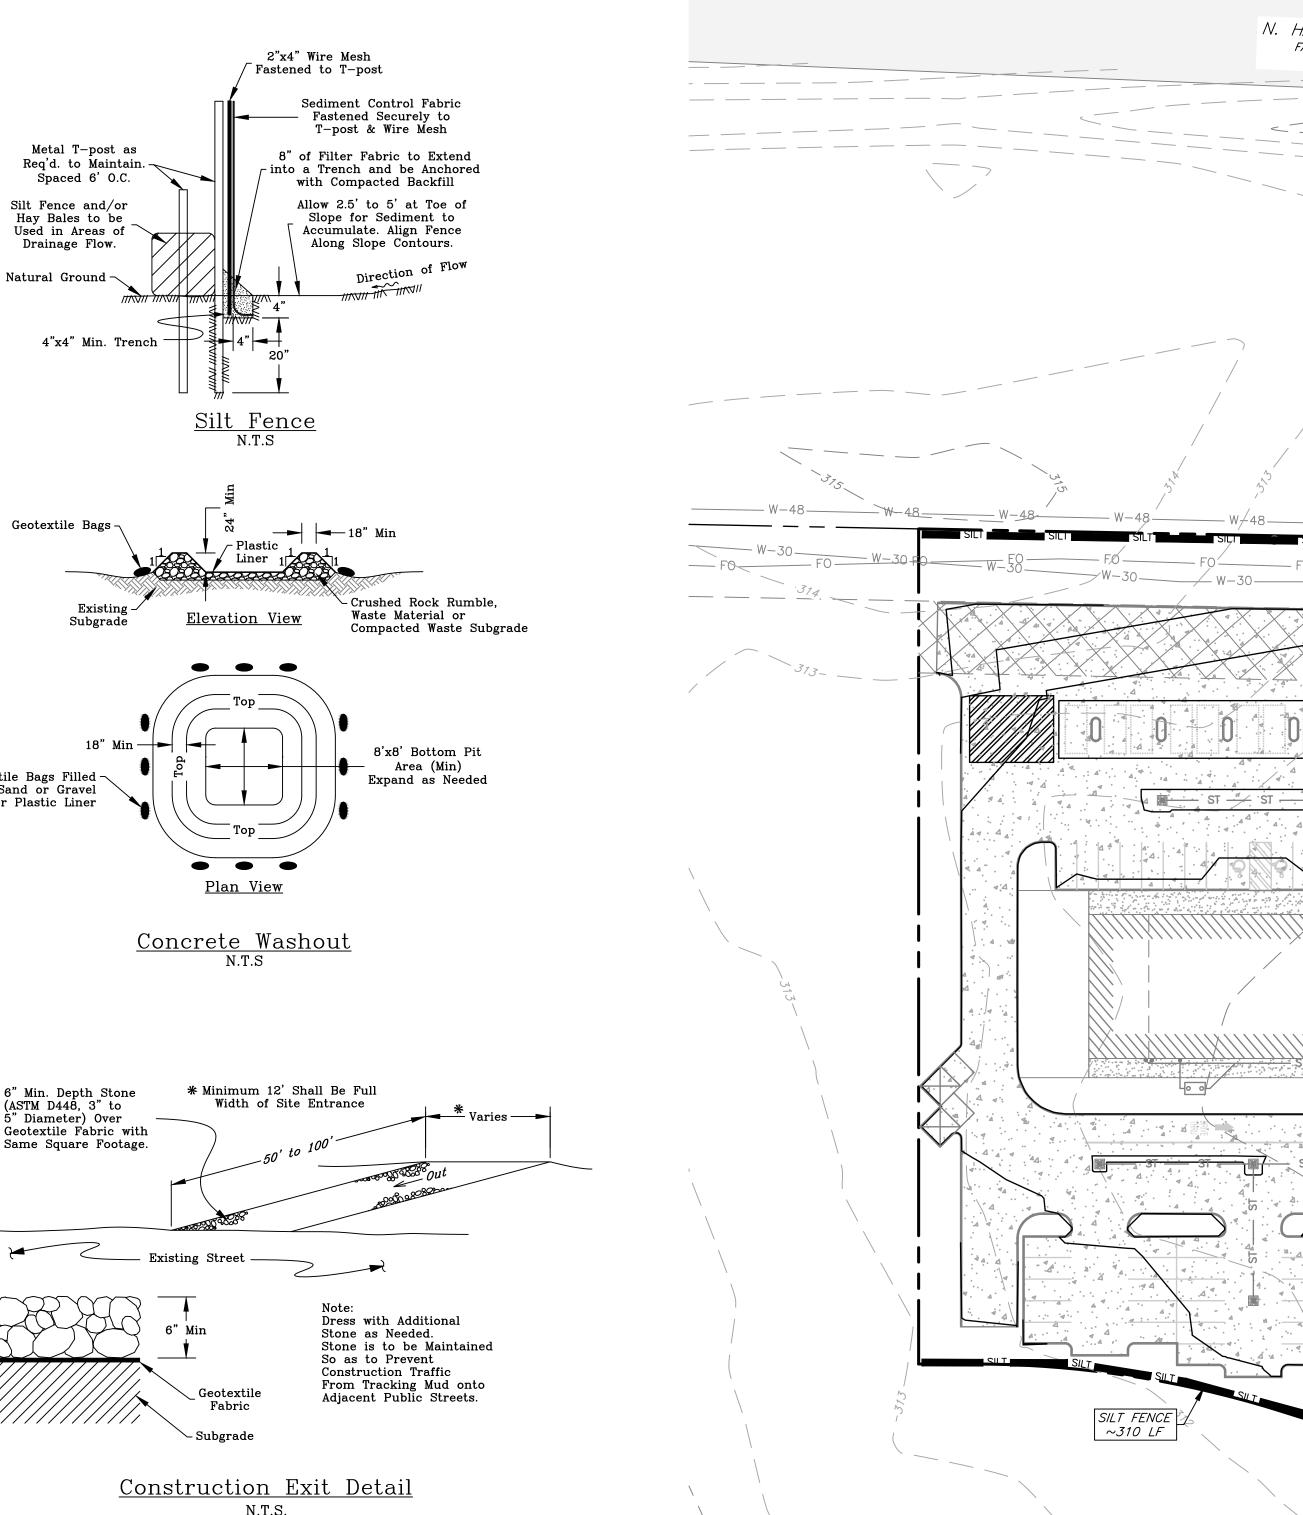

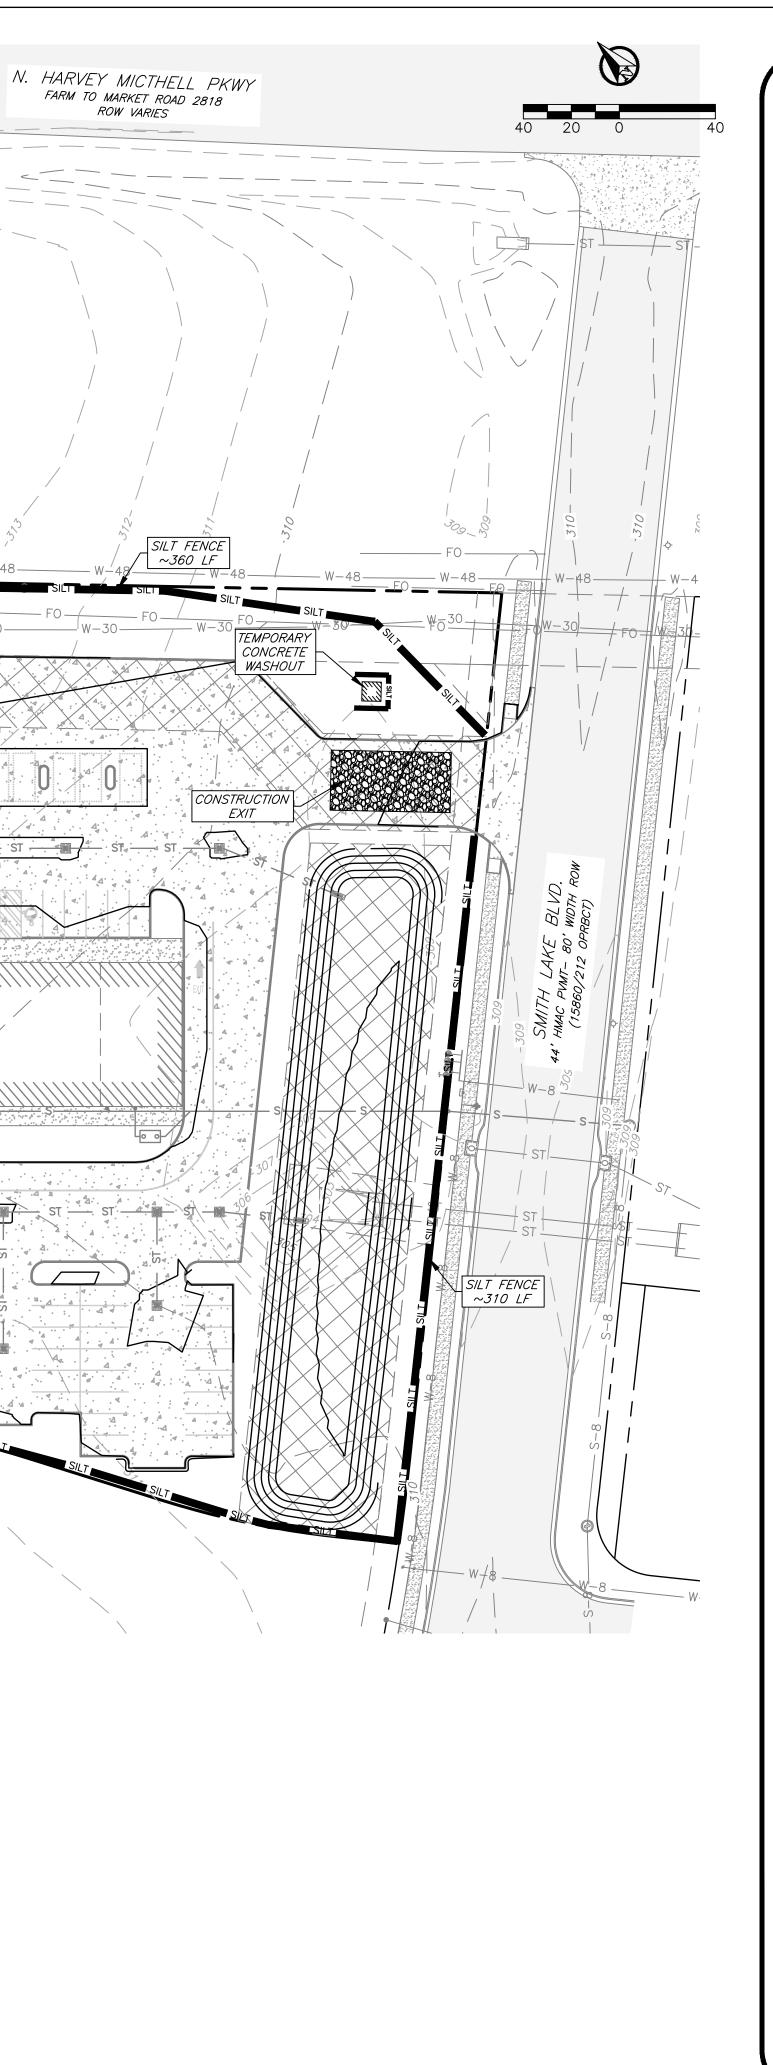

a 2:


	Erosion &	
	Sedimentation	
	Control Plan	
	General Notes:	
1.	Approved erosion control measures must be installed during the entire time that earth has been bared by construction.	
2.	It is the responsibility of the contractor to use what ever means necessary to minimize erosion and prevent sediment from leaving the project site.	
3.	The contractor is responsible for implementing, inspecting, and maintaining the erosion and sediment control devices.	
4.	Phase II erosion control measures shall be implemented immediately after construction of their associated improvements. Inlet protection barriers shall be constructed with sediment filter socks. Inlets located in pavements areas shall be protected with sediment filter socks. Erosion control measures shall be kept in place until upstream drainage areas are fully stabilized.	
5.	Construction exit is to be dressed with additional rock as needed and maintained so as to prevent construction traffic from tracking mud onto adjacent public streets.	
6.	Inspections shall be performed every 14 days and after every rainfall event of $\frac{1}{2}$ or more. All erosion control devices shall be cleaned of silt (as needed) after every rain.	
7.	The contractor is responsible for complying with the TPDES General Permit No. TXR150000 requirements for construction sites.	
8.	All areas where existing vegetation and grass cover have been bared by construction shall be adequately hydromulched and watered until growth is established. All erosion control measures shall remain in place until acceptable vegetative growth is established after construction is complete and then removed by contractor.	
9.	It is the intent of these plans to comply with all City of Bryan guidelines, details & specifications.	
10.	See Sheet C1 — General Notes	
IF	reliminary Plans Only	
inte	Preliminary Plans Only Not for Construction This document is released for the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes.	
inte fo	Not for Construction This document is released for the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used	
inte fo	Not for Construction This document is released for the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes.	
inte fo	Not for Construction This document is released for the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes.	
inte fo	Not for Construction This document is released for the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes.	
inte fo	Not for Construction This document is released for the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes.	
inta fo	Not for Construction This document is released for the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes.  Released for Review	
inta fo No.	Not for Construction         This document is released for the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes.         Released for Review         Image: Construction of the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes.         Released for Review         Image: Construction of the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes.         Revision/Issue       Image: Construction of the purpose of erim review under the purpose of erim revie	
Interior Interio Interior Interior Interior Interior Interior Interior Inte	Not for Construction         This document is released for the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes.         Released for Review         Revision/Issue         Date         Name and Address:         Pro Box 5192 - Bryan, Texas - 77805 grov-739-0567	
Interior of the second	Not for Construction   This document is released for the purpose of erim review under the authority of Glenn Jones, P. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes. <b>Released for Review</b> Revision/Issue Interview under the authority of Glenn Jones, P. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes. <b>Released for Review</b> Revision/Issue Interview under the authority of Glenn Jones, P. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes. <b>Released for Review</b> Revision/Issue Interview under the authority of Glenn Jones, P. 97607 Statistication of the purpose o	
Interior of the second	Not for Construction         This document is released for the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes.         Released for Review         Revision/Issue         Date         Name and Address:         P.D. Box 5192 - Bryan, Texas - 77805 (979-739-0567)         Www.J4Engineering.com Firm# 9951	
Interior of the second	Not for Construction This document is released for the purpose of eim review under the authority of Glenn Jones, P. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes. Released for Review revision/Issue New and Address Popos 5192 - Bryan, Texas - 77805 gor 61 Herrity - 2771 Acress gran, Brazos County, Texas	
Interior of the second	Not for Construction   This document is released for the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes. <b>Released for Review</b> Revision/Issue Date In terme and Address: PO Box 5192 - Bryan, Texas - 77805 979-739-0567 www.J4Engineering.com Firm# 9951 ever Name and Address: Cor Name and Address: Cor Name and Address: Green's Crossing Block 1, Lot 1 - 2.771 Acress Bryan, Brazos County, Texas Sheet: Jan 2024	
Interior Interio Interior Interior Interior Interior Interior Inte	Not for Construction   This document is released for the purpose of erim review under the authority of Glenn Jones, P.E. 97600 on 31-Jan-24. It is not to be used r construction, bidding, or permitting purposes. <b>Released for Review Revision/Issue</b> Date In terme and Address: <b>Output Output Dess</b> 5192 - Bryan, Texas - 77805 <b>Or Box</b> 5192 - Bryan, Texas	

# Paving Notes:


- 1. All concrete for pavement construction shall be to the minimum depth shown on the plans and shall have a minimum 28-day compressive strength of 3,500 PSI. The maximum percentage of fly ash replacement of Portland cement shall be 20 percent by weight.
- 2. Item 360 of the TxDOT "Standard Specifications for Construction and Maintenance of Highways. Street, & Bridges" shall be used as a technical specification for reinforced concrete pavement.
- 3. All paving requirements shall be in accordance with the "CREI RV/Boat Storage Facility" Geotechnical Engineering Report, dated Aug 10, 2023, prepared by Terracon.
- 4. The subgrade beneath the concrete sidewalks shall be compacted and "proof-rolled". any weak or soft areas identified by the "proof-rolling" shall be removed and replaced.
- 5. A sand leveling course under concrete pavement is NOT permitted.
- 6. Joint sealant material to be Sonneborn SL-1 or approved equal.
- 7. Curing compound shall be applied uniformly to the concrete after the surface finishing is complete at the rate recommended by the manufacturer. The curing compound shall meet the requirements of TxDOT Item 526.
- 8. Contractor shall provide engineer with a proposed pavement expansion and contraction joint plan prior to pavement construction.
- 9. See Sheet C1-General Notes.


# Grading Notes:

- 1. Fill material used to achieve grade in areas to receive pavement or within the street right-of-way shall be compacted to at least 98% of the maximum dry density as determined by the standard proctor test, (ASTM D698), at a moisture content from optimum moisture content to 4% above the optimum moisture content. Areas outside of the street right-of-way shall be compacted to 95% of the maximum dry density.
- 2. The subgrade beneath the concrete sidewalks shall be compacted and "proof-rolled". Any weak or soft areas identified by the "proof-rolling" shall be removed and replaced.
- 3. ADA ramp slopes shall not exceed 1v:12h.
- 4. The topography shown is from field survey data.
- 5. Structural backfill for utility or storm drain trenches is required whenever the trench is within 5' of pavement or sidewalk.
- 6. The contractor shall follow the general intent of the grading plans. minor adjustments to the actual elevations shown on the grading plan may be required to match existing ground elevations and structures. the proposed contour lines shown are approximate only, the design grade spot elevations should be used for construction of the site work.
- 7. Refer to pavement plan for pavement construction details and notes.
- 8. The contractor shall salvage all topsoil and replace it on all disturbed areas. all parking lot islands and areas adjacent to parking and sidewalk areas shall receive 6" sandy loam topsoil prior to placement of grass sod or hydromulch.
- 9. The contractor shall field verify and locate all existing utilities on site prior to demolition.
- 10. The contractor shall install all erosion and sediment control devices, as shown, prior to commencing demolition work.
- 11. Should any existing utilities not shown or shown incorrectly on this plan be found on site, the contractor shall contact the design engineer immediately to discuss any possible conflicts before proceeding with any work in that area.

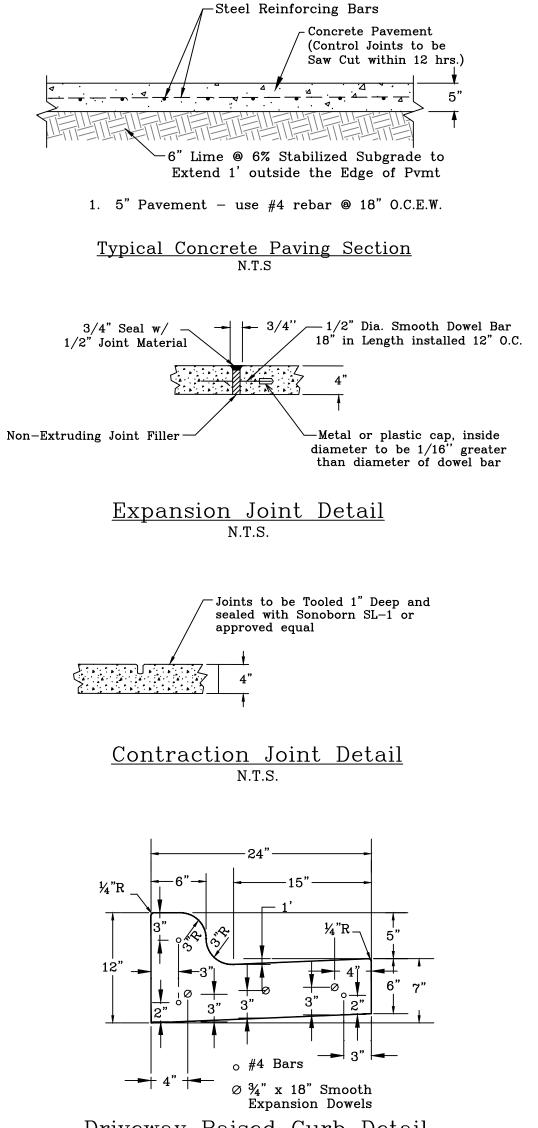



Driveway Raised Curb Detail N.T.S

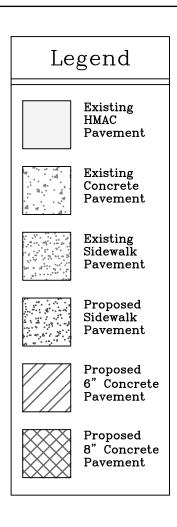

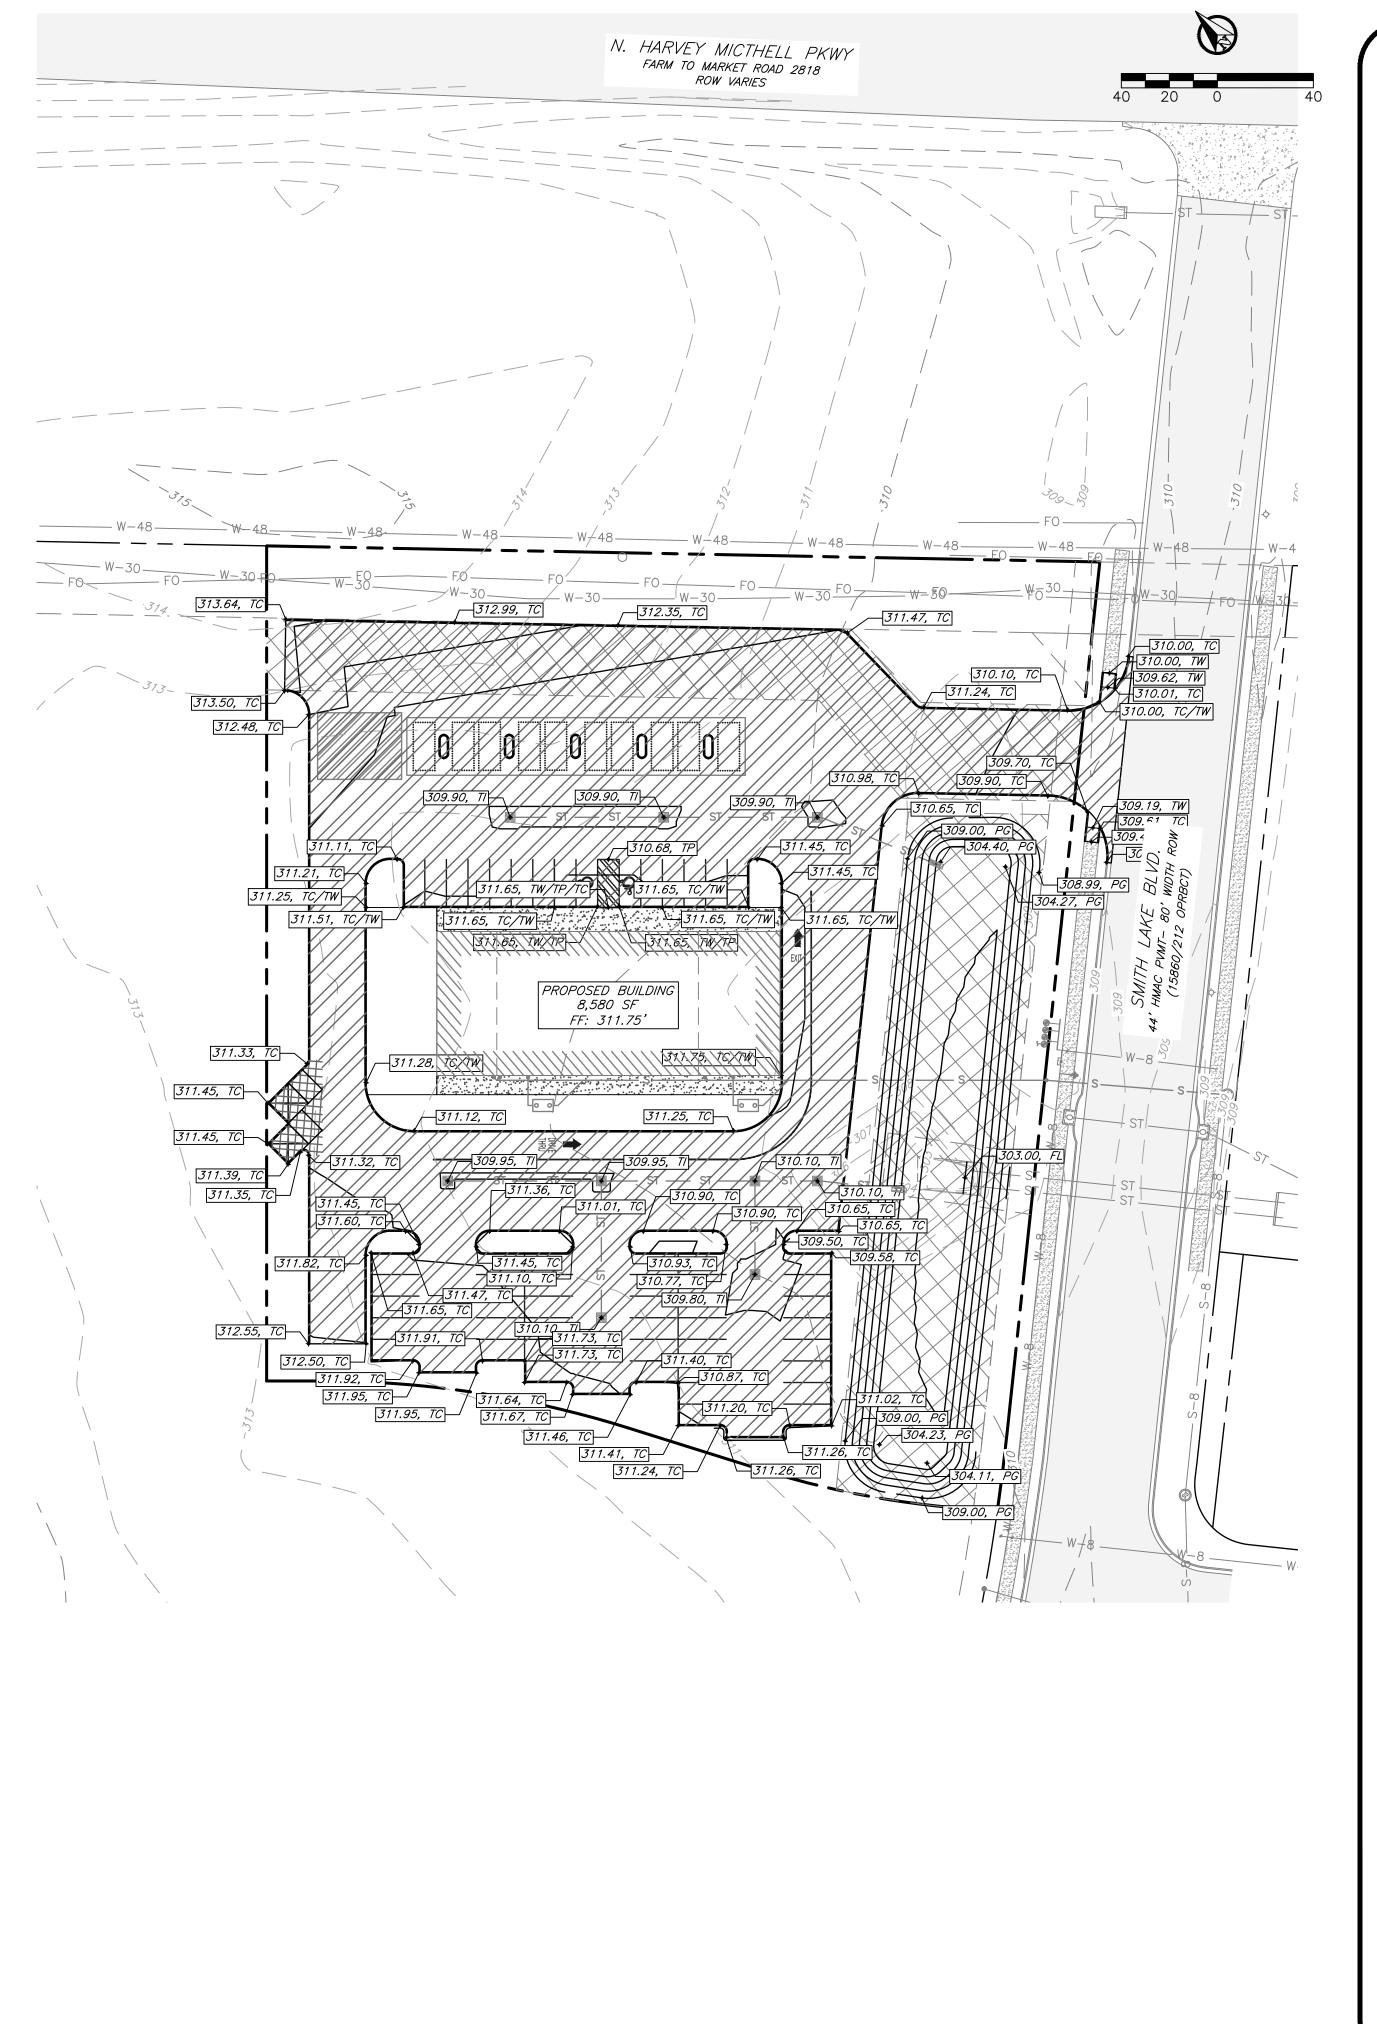



Paveme Grading			
General N	otes:		
1. The topography s field survey data.	hown is from		
<ol> <li>Refer to Final Pla dimensions and bear</li> </ol>			
3. All utilities shown a the best availabl based on constr documents obtain Engineering from Independent agencie	are taken from le information ruction utility ned by J4 City and s and/or above idence. Shown		
4. The contractor shall for verifying the ex- all existing underg whether shown on not. Notification companies 48 hours construction is requ	act location of ground utilities, these plans or of the utility s in advance of		
<ol> <li>Contractor is respo verifying existing grades prior to an and reporting any to the Owner.</li> </ol>	and proposed ny construction		
6. All construction accordance with th Standard Specifica and Design Guideli Sewer, Streets, unless otherwise not	ne current BCS ations, Details, nes for Water, and Drainage,		
7. The contractor shall for the containment disposal of all lice waste associated with and shall use all m to prevent the occu- blown litter.	nt and proper quid and solid ith the project neans necessary		
8. It is the intent of comply with all guidelines, specificat	City of Bryan		
9. See Sheet C1 - Gen TC - Top of Cu TP - Top of Pa TW - Top of Sic PG - Proposed	arb vement dewalk		
Preliminary P Not for Cons This document is released to interim review under the author P.E. 97600 on 31-Jan-24. It for construction, bidding, or p Released for	for the purpose of prity of Glenn Jones, t is not to be used permitting purposes.		
No. Revision/Iss	sue Date		
Firm Name and Address: <b>JA Engineering</b> PO Box 5192 - Bryan, Texas - 77805 979-739-0567 www.J4Engineering.com Firm# 9951			
Project Name and Address: Greens Ci C-Sto Green's Cro	re		
Block 1, Lot 1 - 2. Bryan, Brazos Cou	.771 Acres		
Date: Jan 2024	Sheet:		
Scale: As Noted	<i>C4</i>		
ι Ι	J		

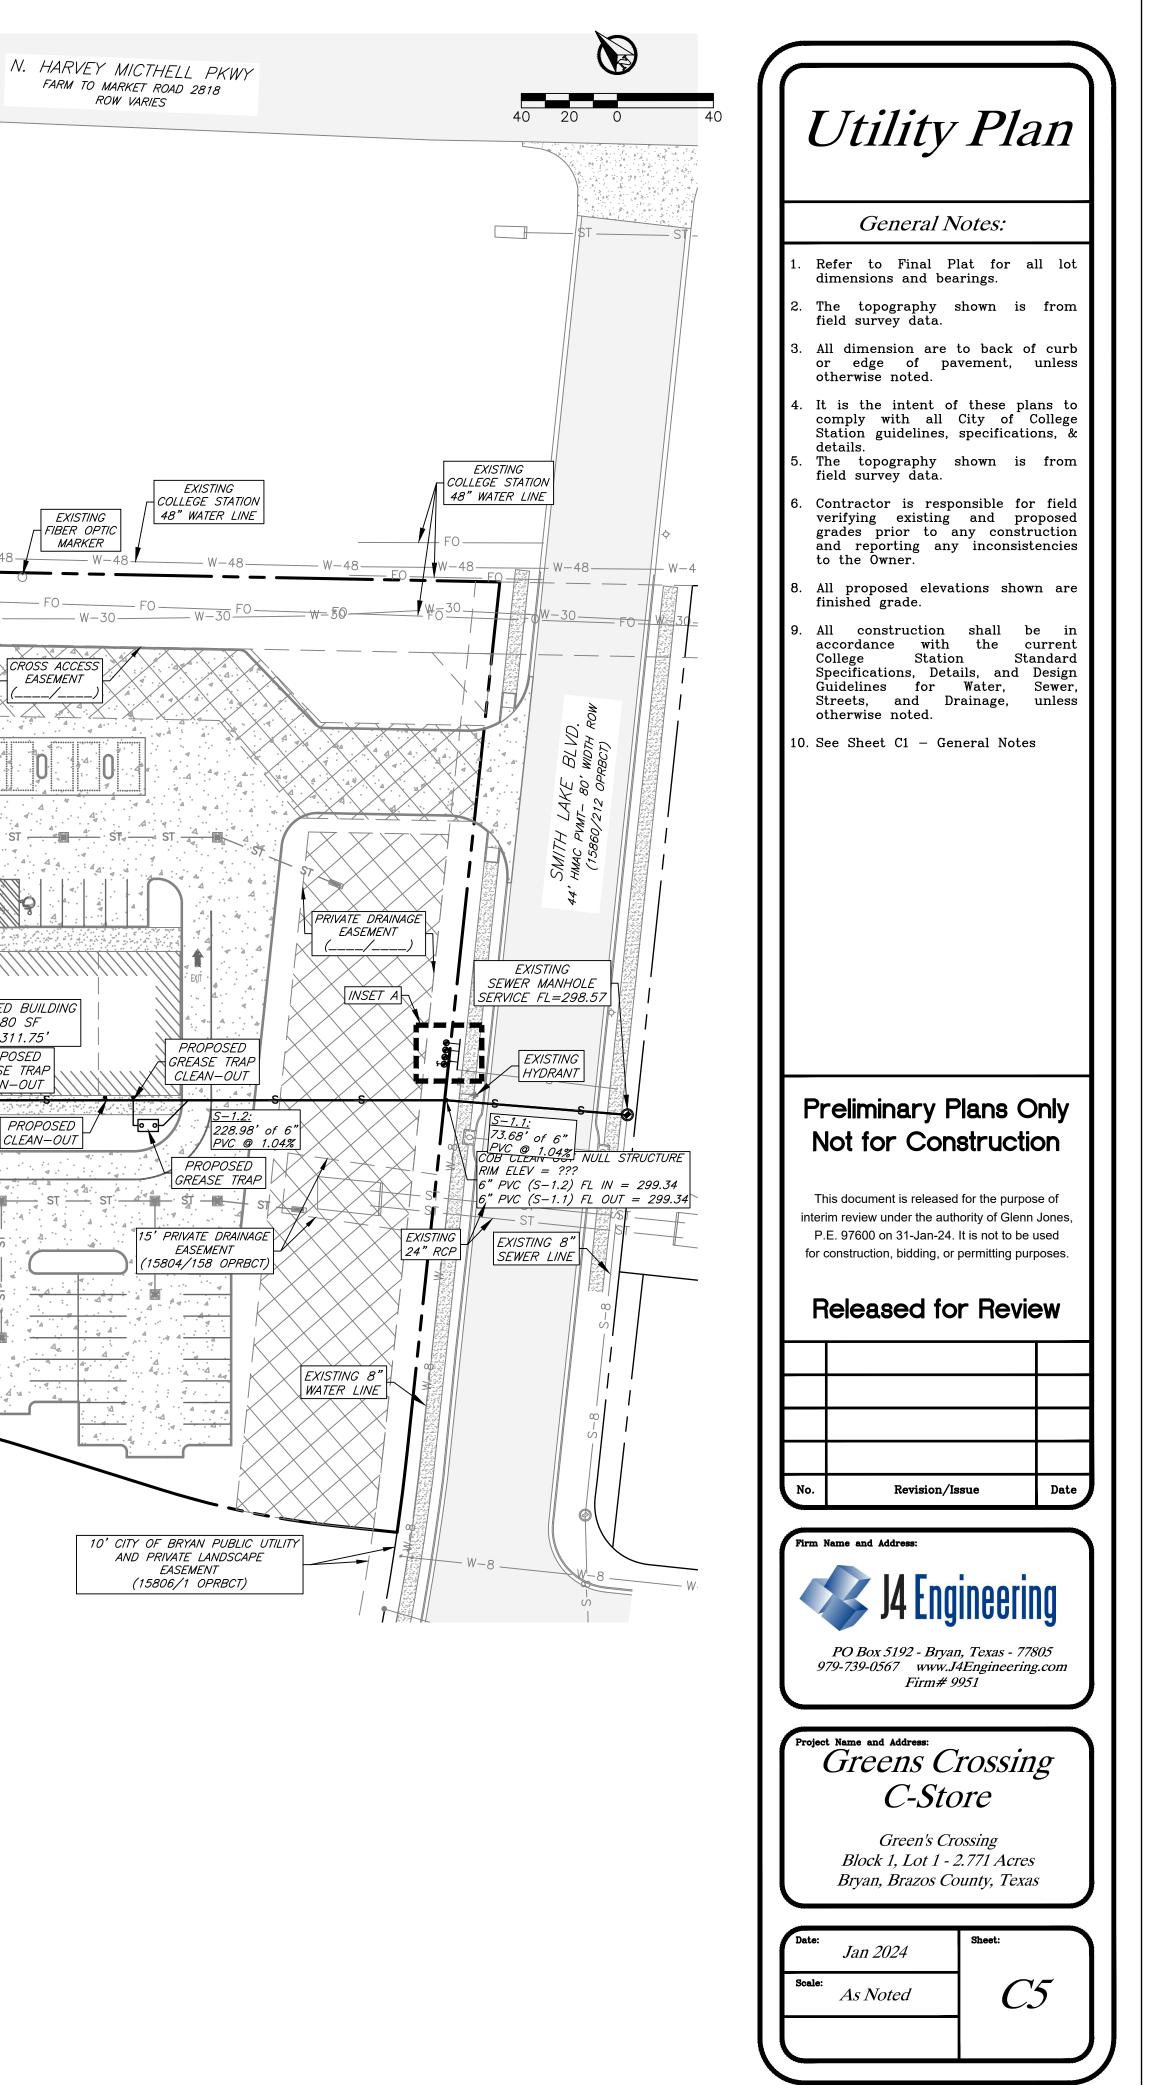


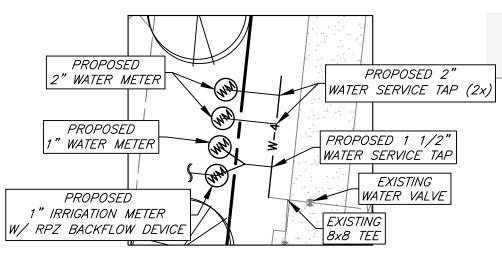


Inset A N.T.S.

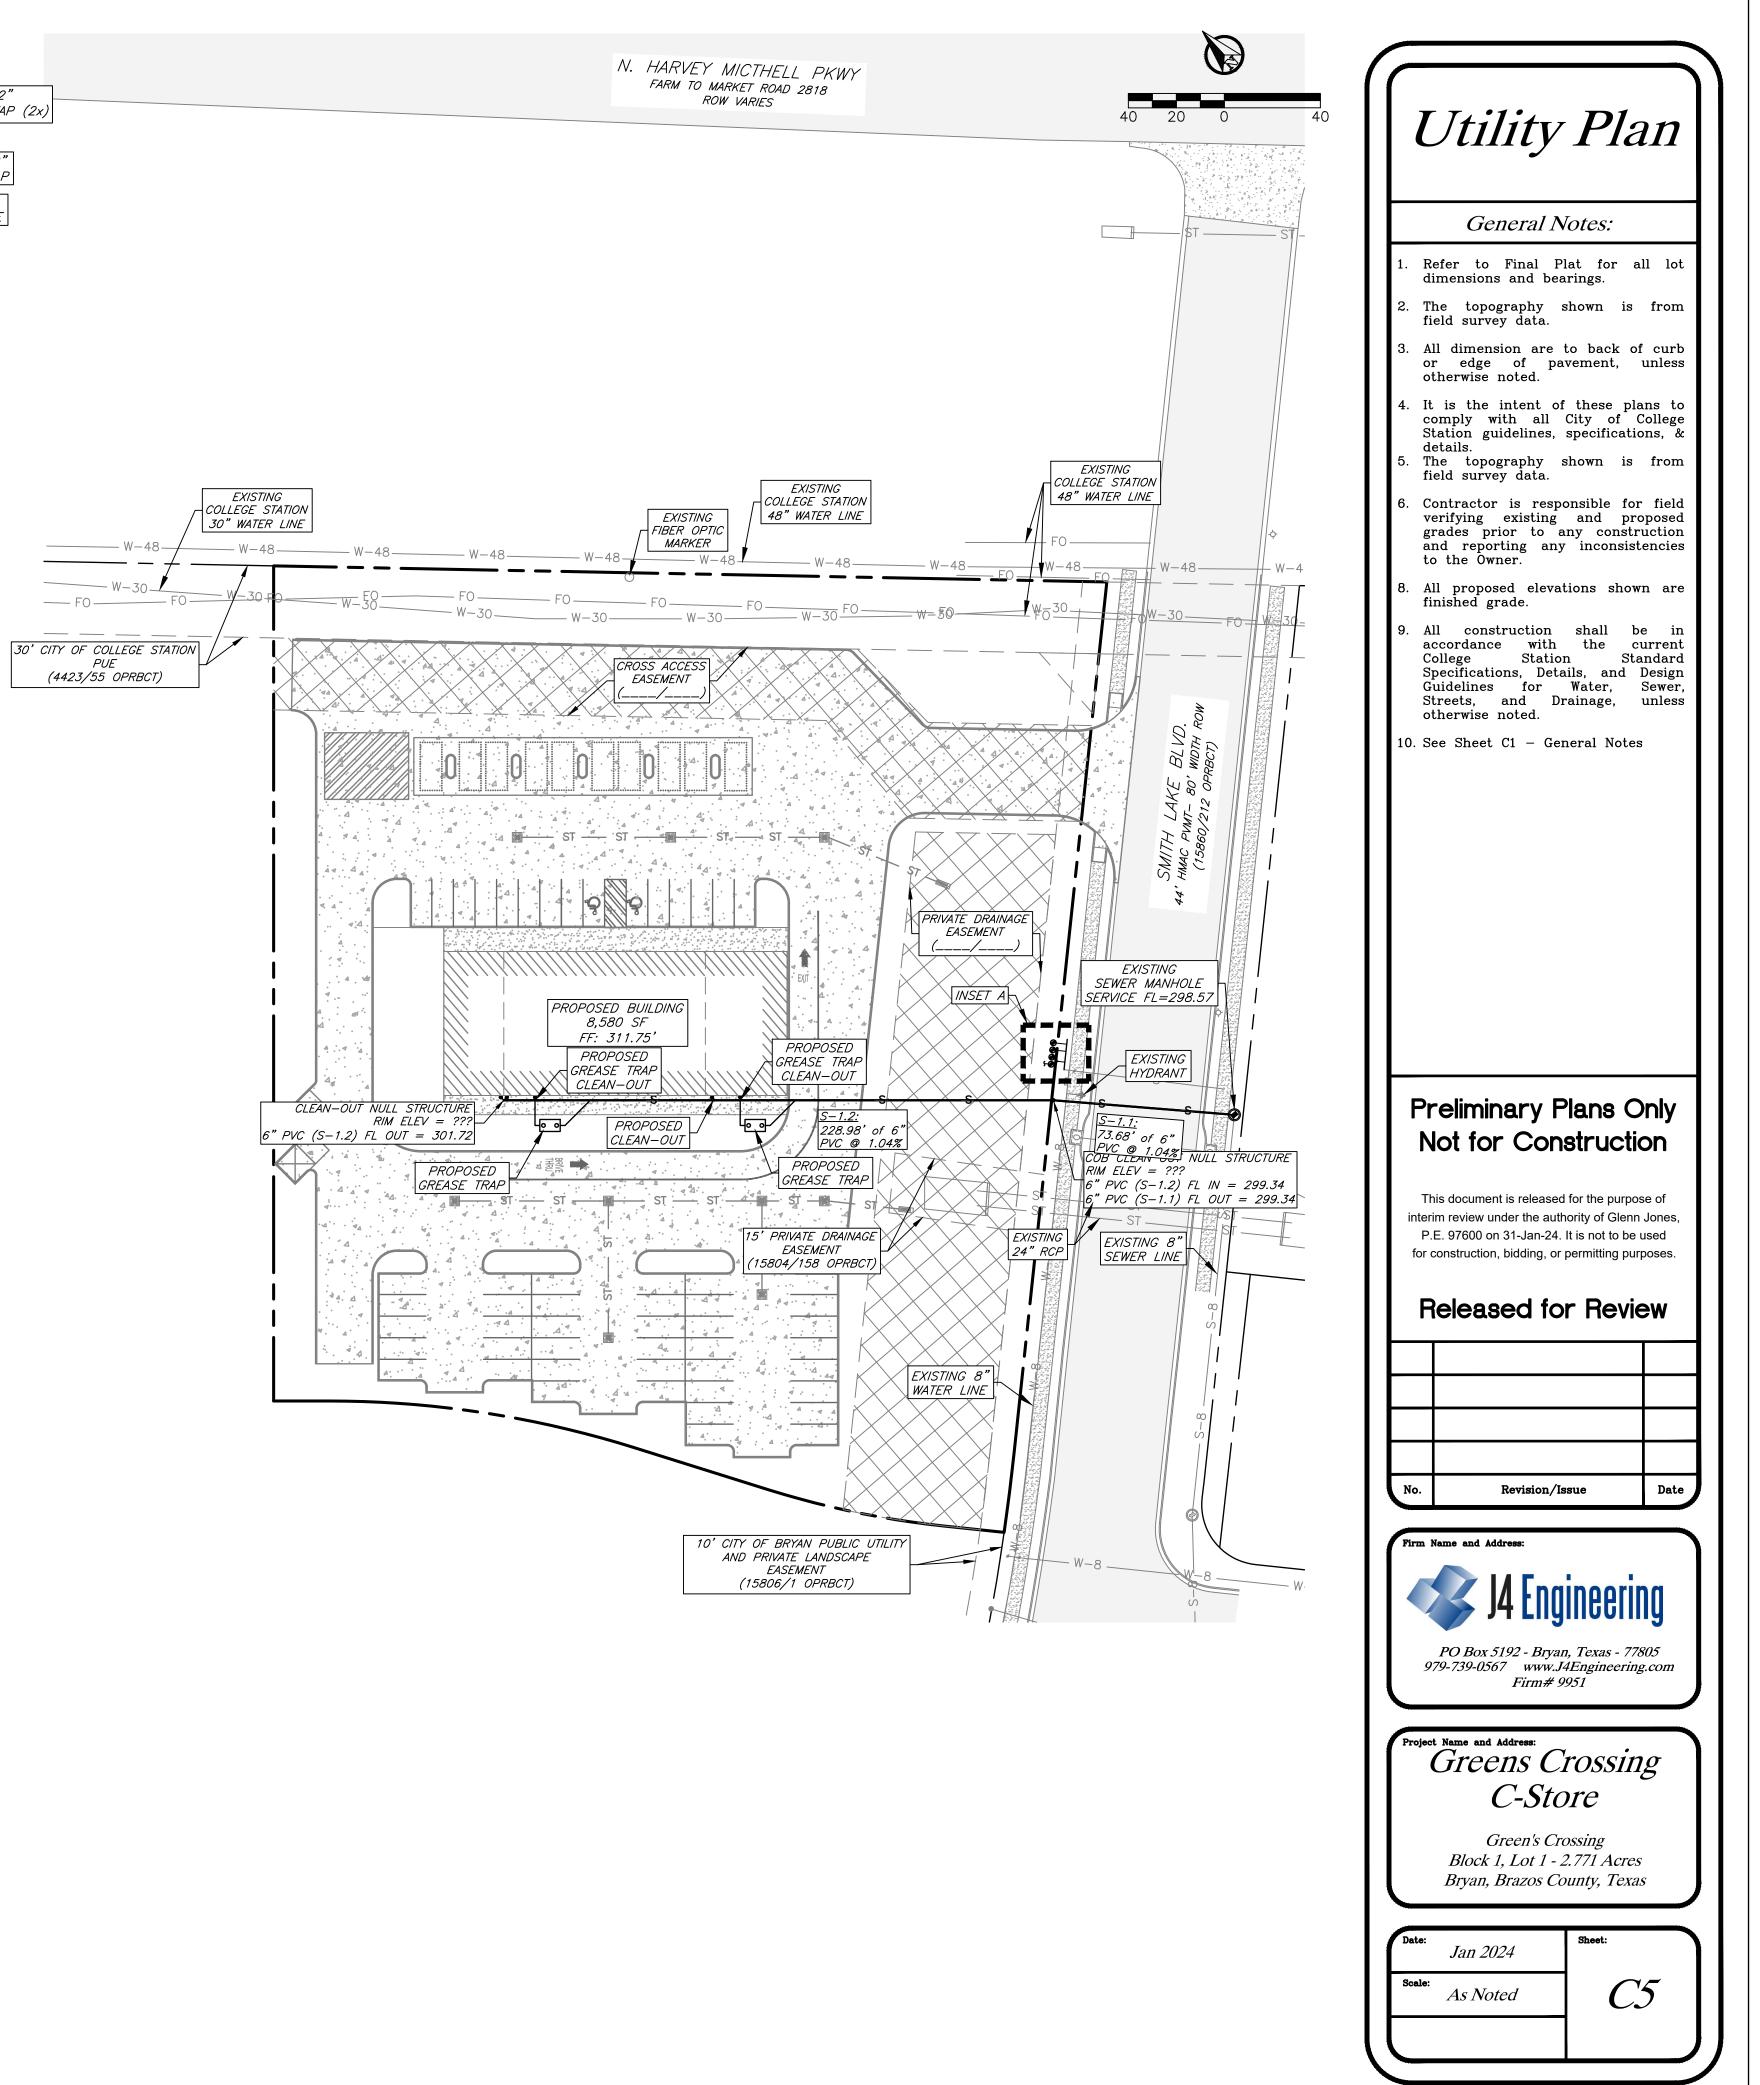


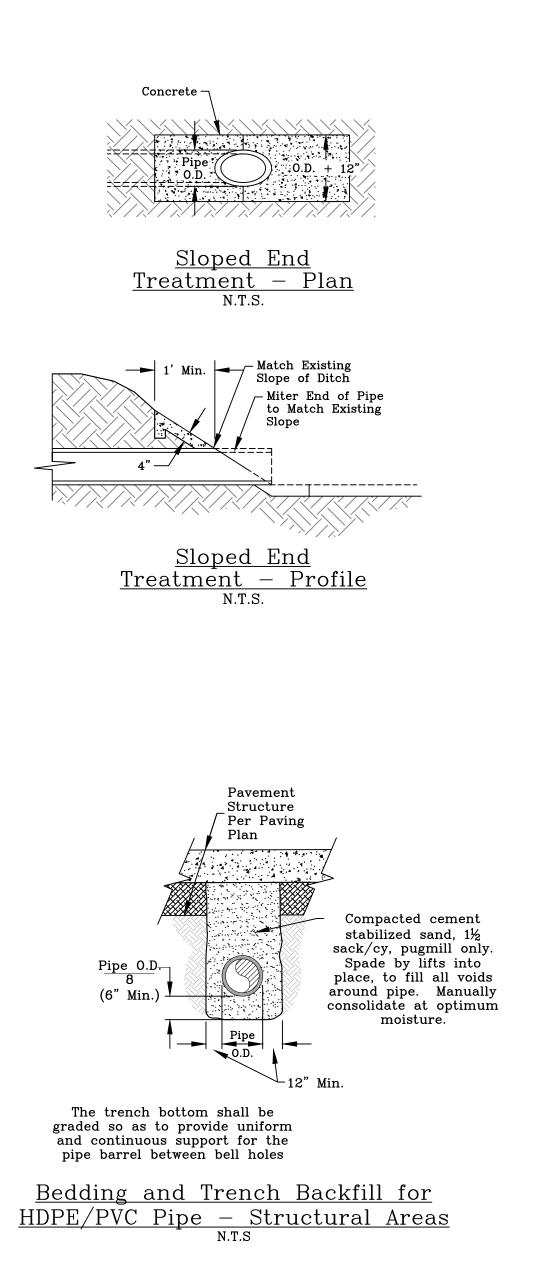


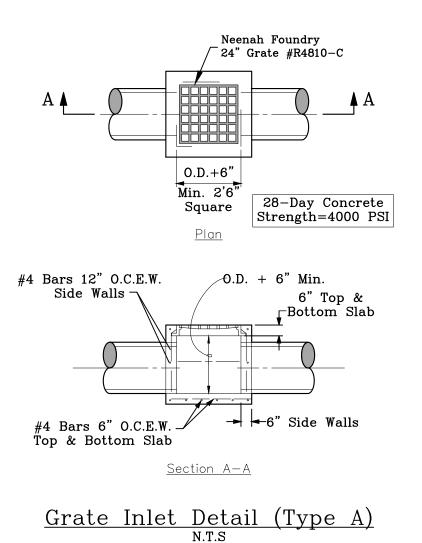


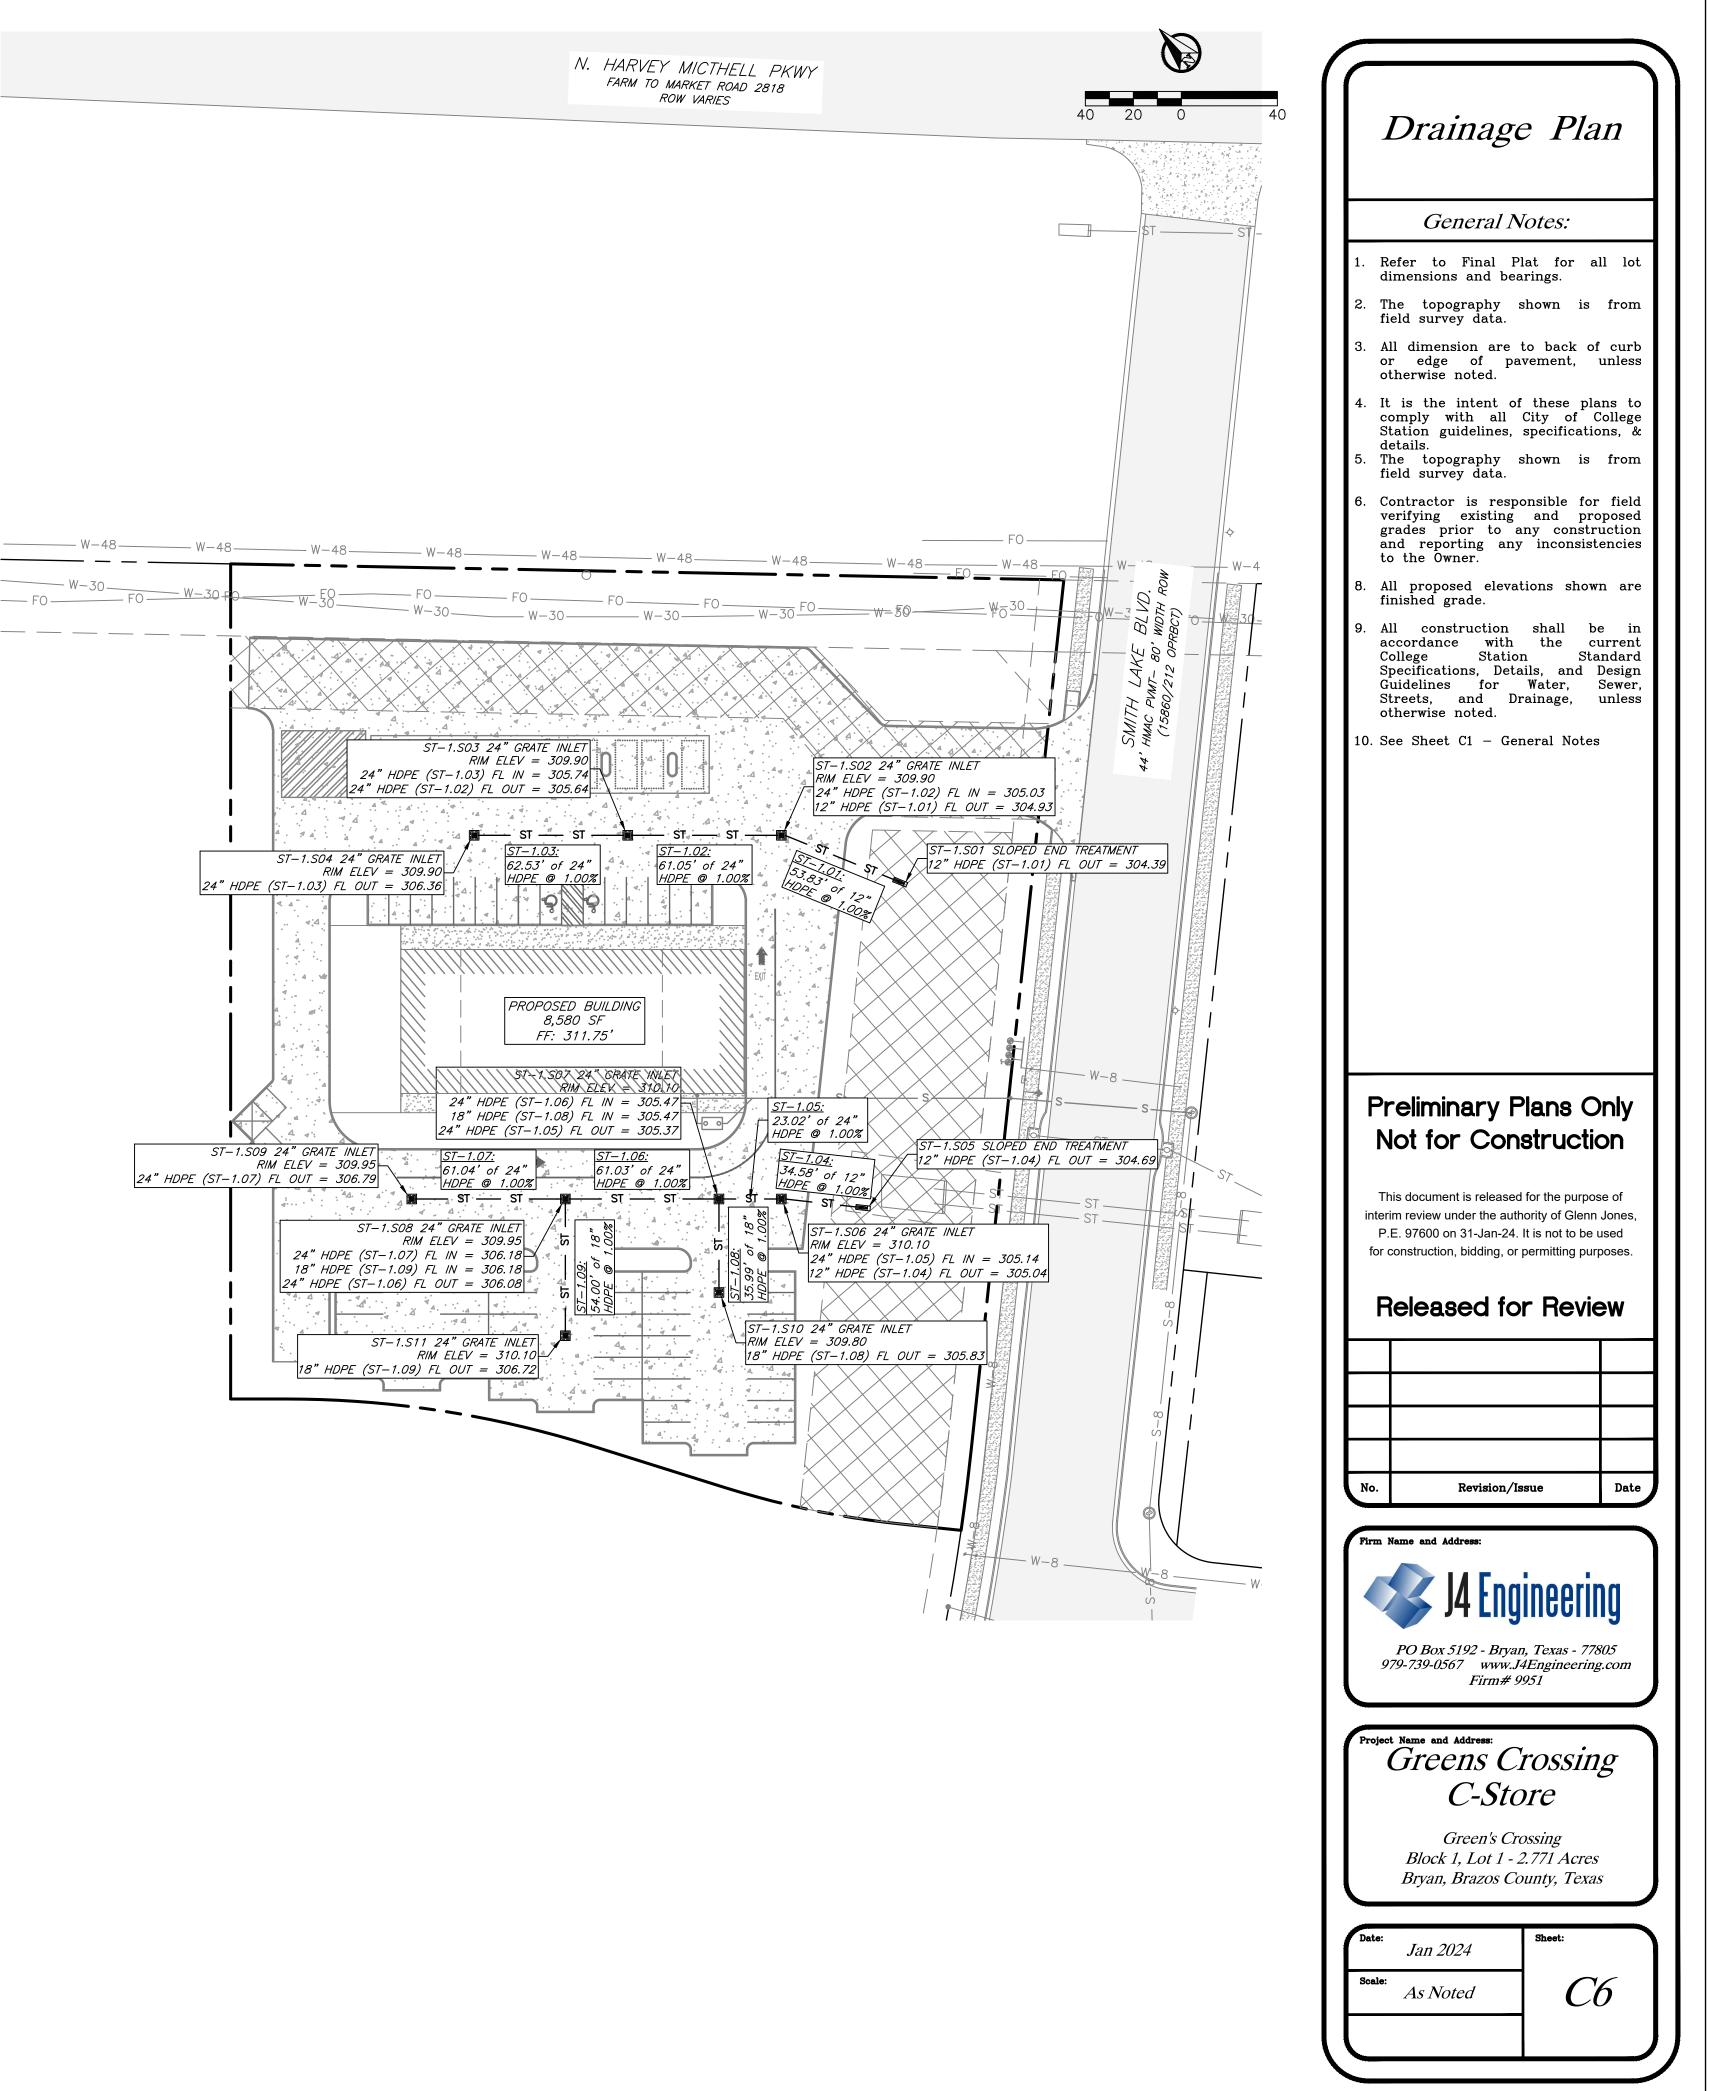



	Landscape Notes:		La	andscape /	Analysis:	
1. 2.	All trees shall be provided as container grown trees. All landscaping plant material shall be guaranteed for a period of thirty days from the date of installation by contractor. After thirty days, the owner will be responsible for maintenance of all landscaping.	Construction Activities: Parking & Pavement = 65,300 SF Building Met Total = 73,880 SF				
3.	The property owner is responsible for regular weeding, mowing, fertilizing, and other maintenance of all plantings following acceptance from Contractor. The required landscaping must be maintained in a healthy, growing condition at all times.		ilding, 880 Sl	Parking, & Pave F @ 15%		<u>35 SF</u> 35 SF
4.	Plant material shown here is represented at its mature size. Plantings to be installed will be significantly smaller than those shown and should not be expected to reach maturity for several years dependant on growing conditions.	Car 27 Noi	nopy I @ 2:	50 SF opy Trees )0 SF	= 6,750 = 5,100 t Total = 11,85	<u>0 SF</u>
5.	Contractor is to seed all disturbed areas left unpaved and guarantee coverage of vegetation until establishment of grass. Grass type shall be Bermuda grass or Rye/Bermuda mixture.					I
6.	All water meters, hydrants, valves, manholes, and cleanouts, on or adjacent to the property, must remain accessible during construction and upon the completion of necessary grading and landscaping.	Symbol	Qty. 27	Common Name Cedar Elm	Botanical Name Ulmus crassifolia	Size 3" cal.
7.	"Cal." indicates caliper at 12" above the ground. Multi-trunk trees' caliper is measured with the single, largest cane.	~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~~				
8.	Existing Trees used for landscape credit must have a minimum trunk diameter of four and one-half inches or larger and be in a healthy physical state. Should existing trees used for landscape credit die, they shall be replaced with new trees according to the requirements of section $62-429(a)(2)c$ . Existing trees with a trunk diameter less than four and one-half inches may be given the same landscape credit as that given newly planted trees with similar characteristics.		51	Crepe Myrtle	Lagerstroemia indica	1½" cal.
9.	Replacement of dead landscaping shall occur within 90 days of notification. Replacement material must be of similar character as the dead landscaping. Failure to replace dead landscaping as required by the zoning official or his/her designee, shall constitute a violation of this article subject to the general penalty provisions of City Code section 1-14.					
10.	To ensure the growth of trees in end islands, a minimum 24—inch soil depth and 250 cubic feet of appropriate planting medium is required per tree, with topsoil mounded to a center height.					
11.	All landscaping is to be maintained by irrigation. The irrigation system will be designed and permitted separately.					
	Extend End 12" Beyond Concrete and Tape Both Ends	al PVC	) PVC ) w Top e TYP.	of		
		N.T.S				
	2 T-posts (TYP) 2 T-posts (TYP) 2 T-posts (TYP) 2 T-posts (TYP) 2 T-posts (TYP) 3 Topost and the second secon	er n, m 3"	- Guy - Bare - Pre 1. 2. 3. 4. 5. 6.	of container. Fully remove debris, trash, rock material greater diameter. Install premixed 40% sandyloam t humus and 20% s	en Hose (TYP) Here Backfill (TYP) ve soil to the size all construction ks and any other than 2" in soil containing copsoil, 40% black harp sand. width 12" larger all sides. e exposed.	
	Tree	Staking N.T		<u>Planting</u>		

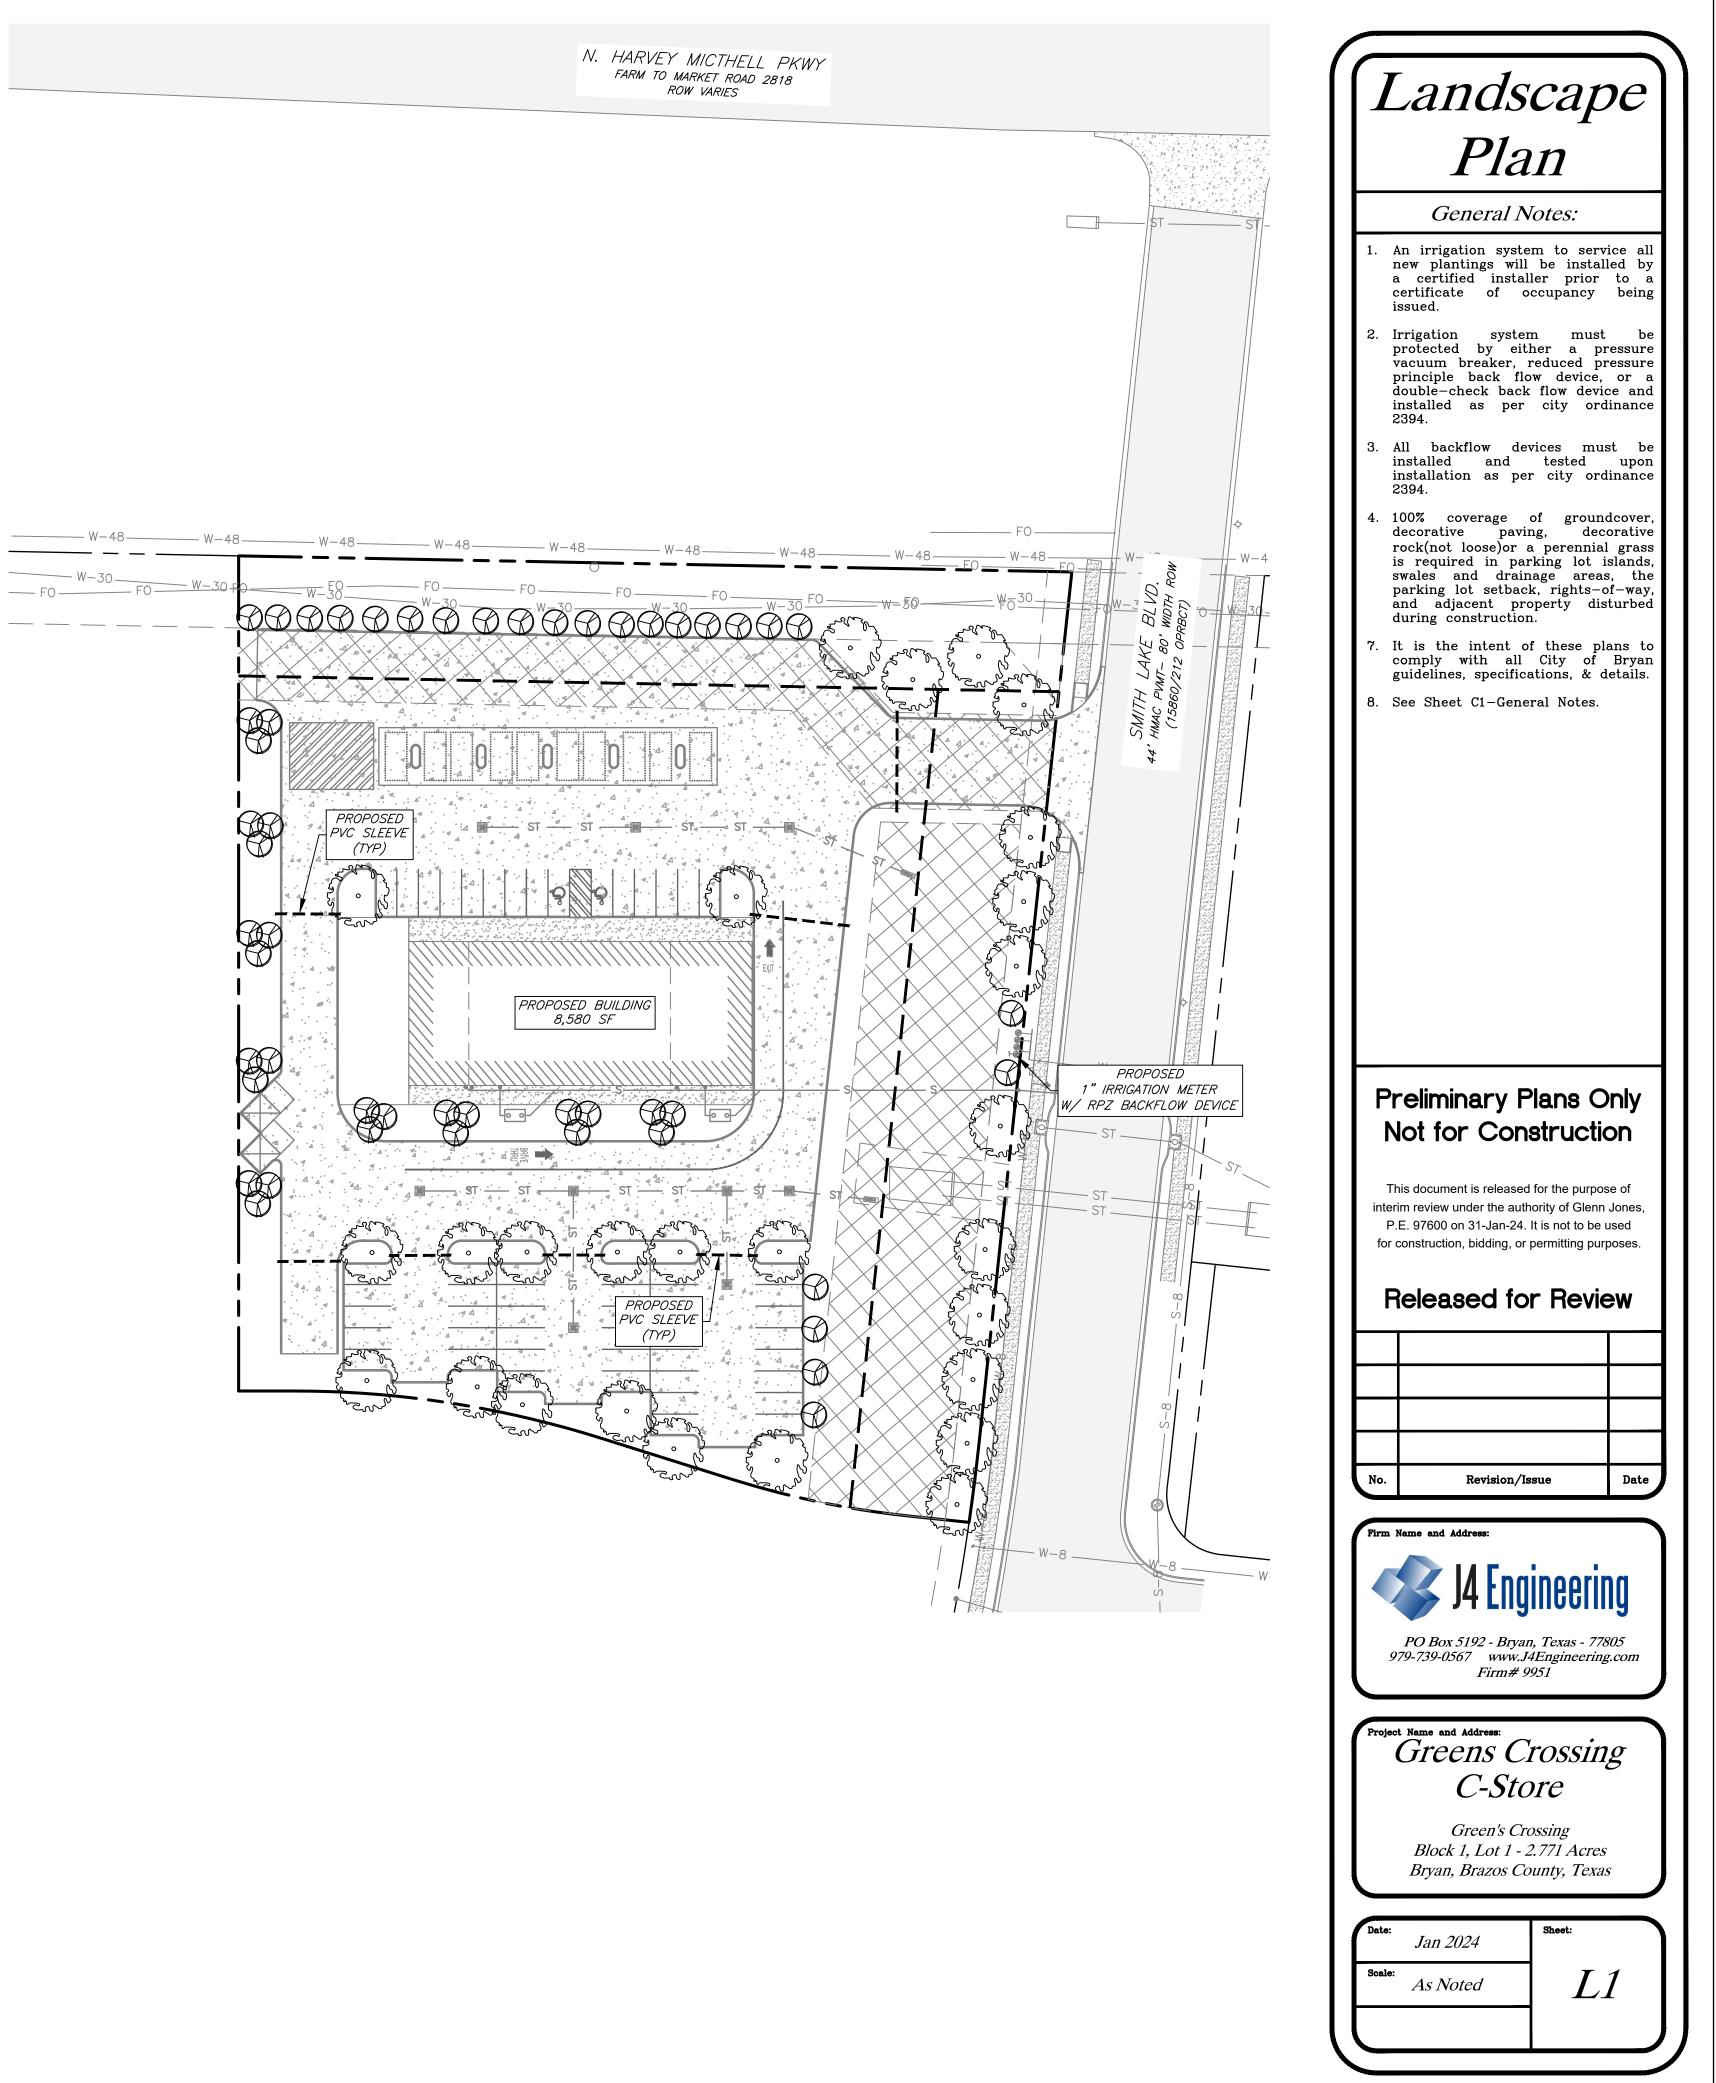

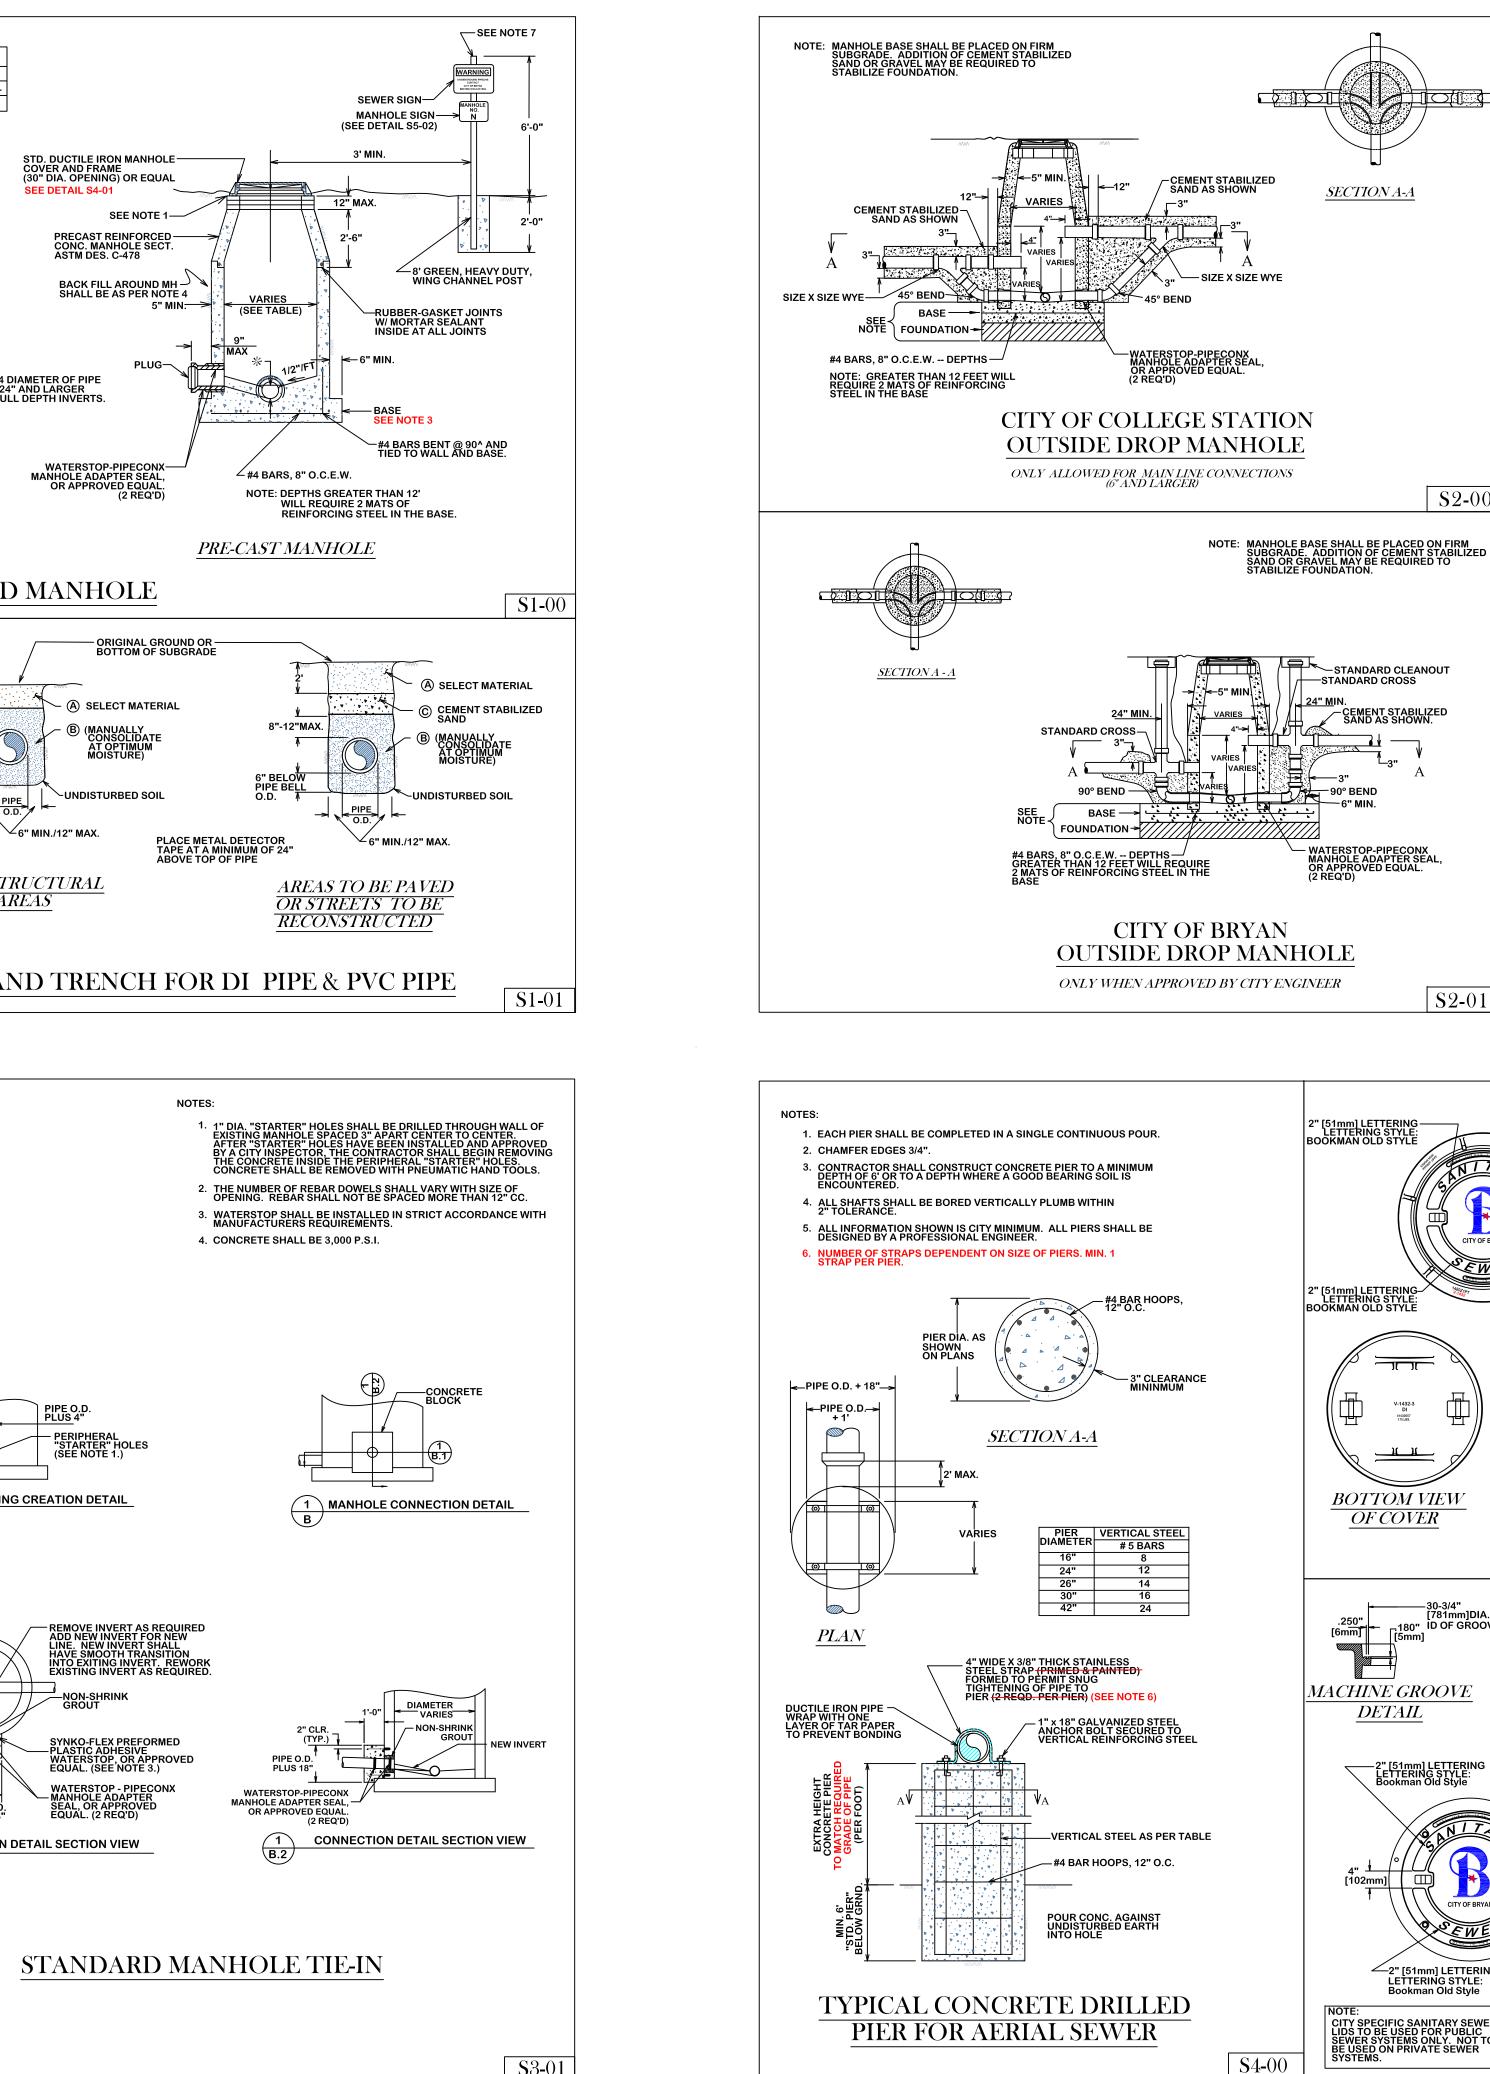


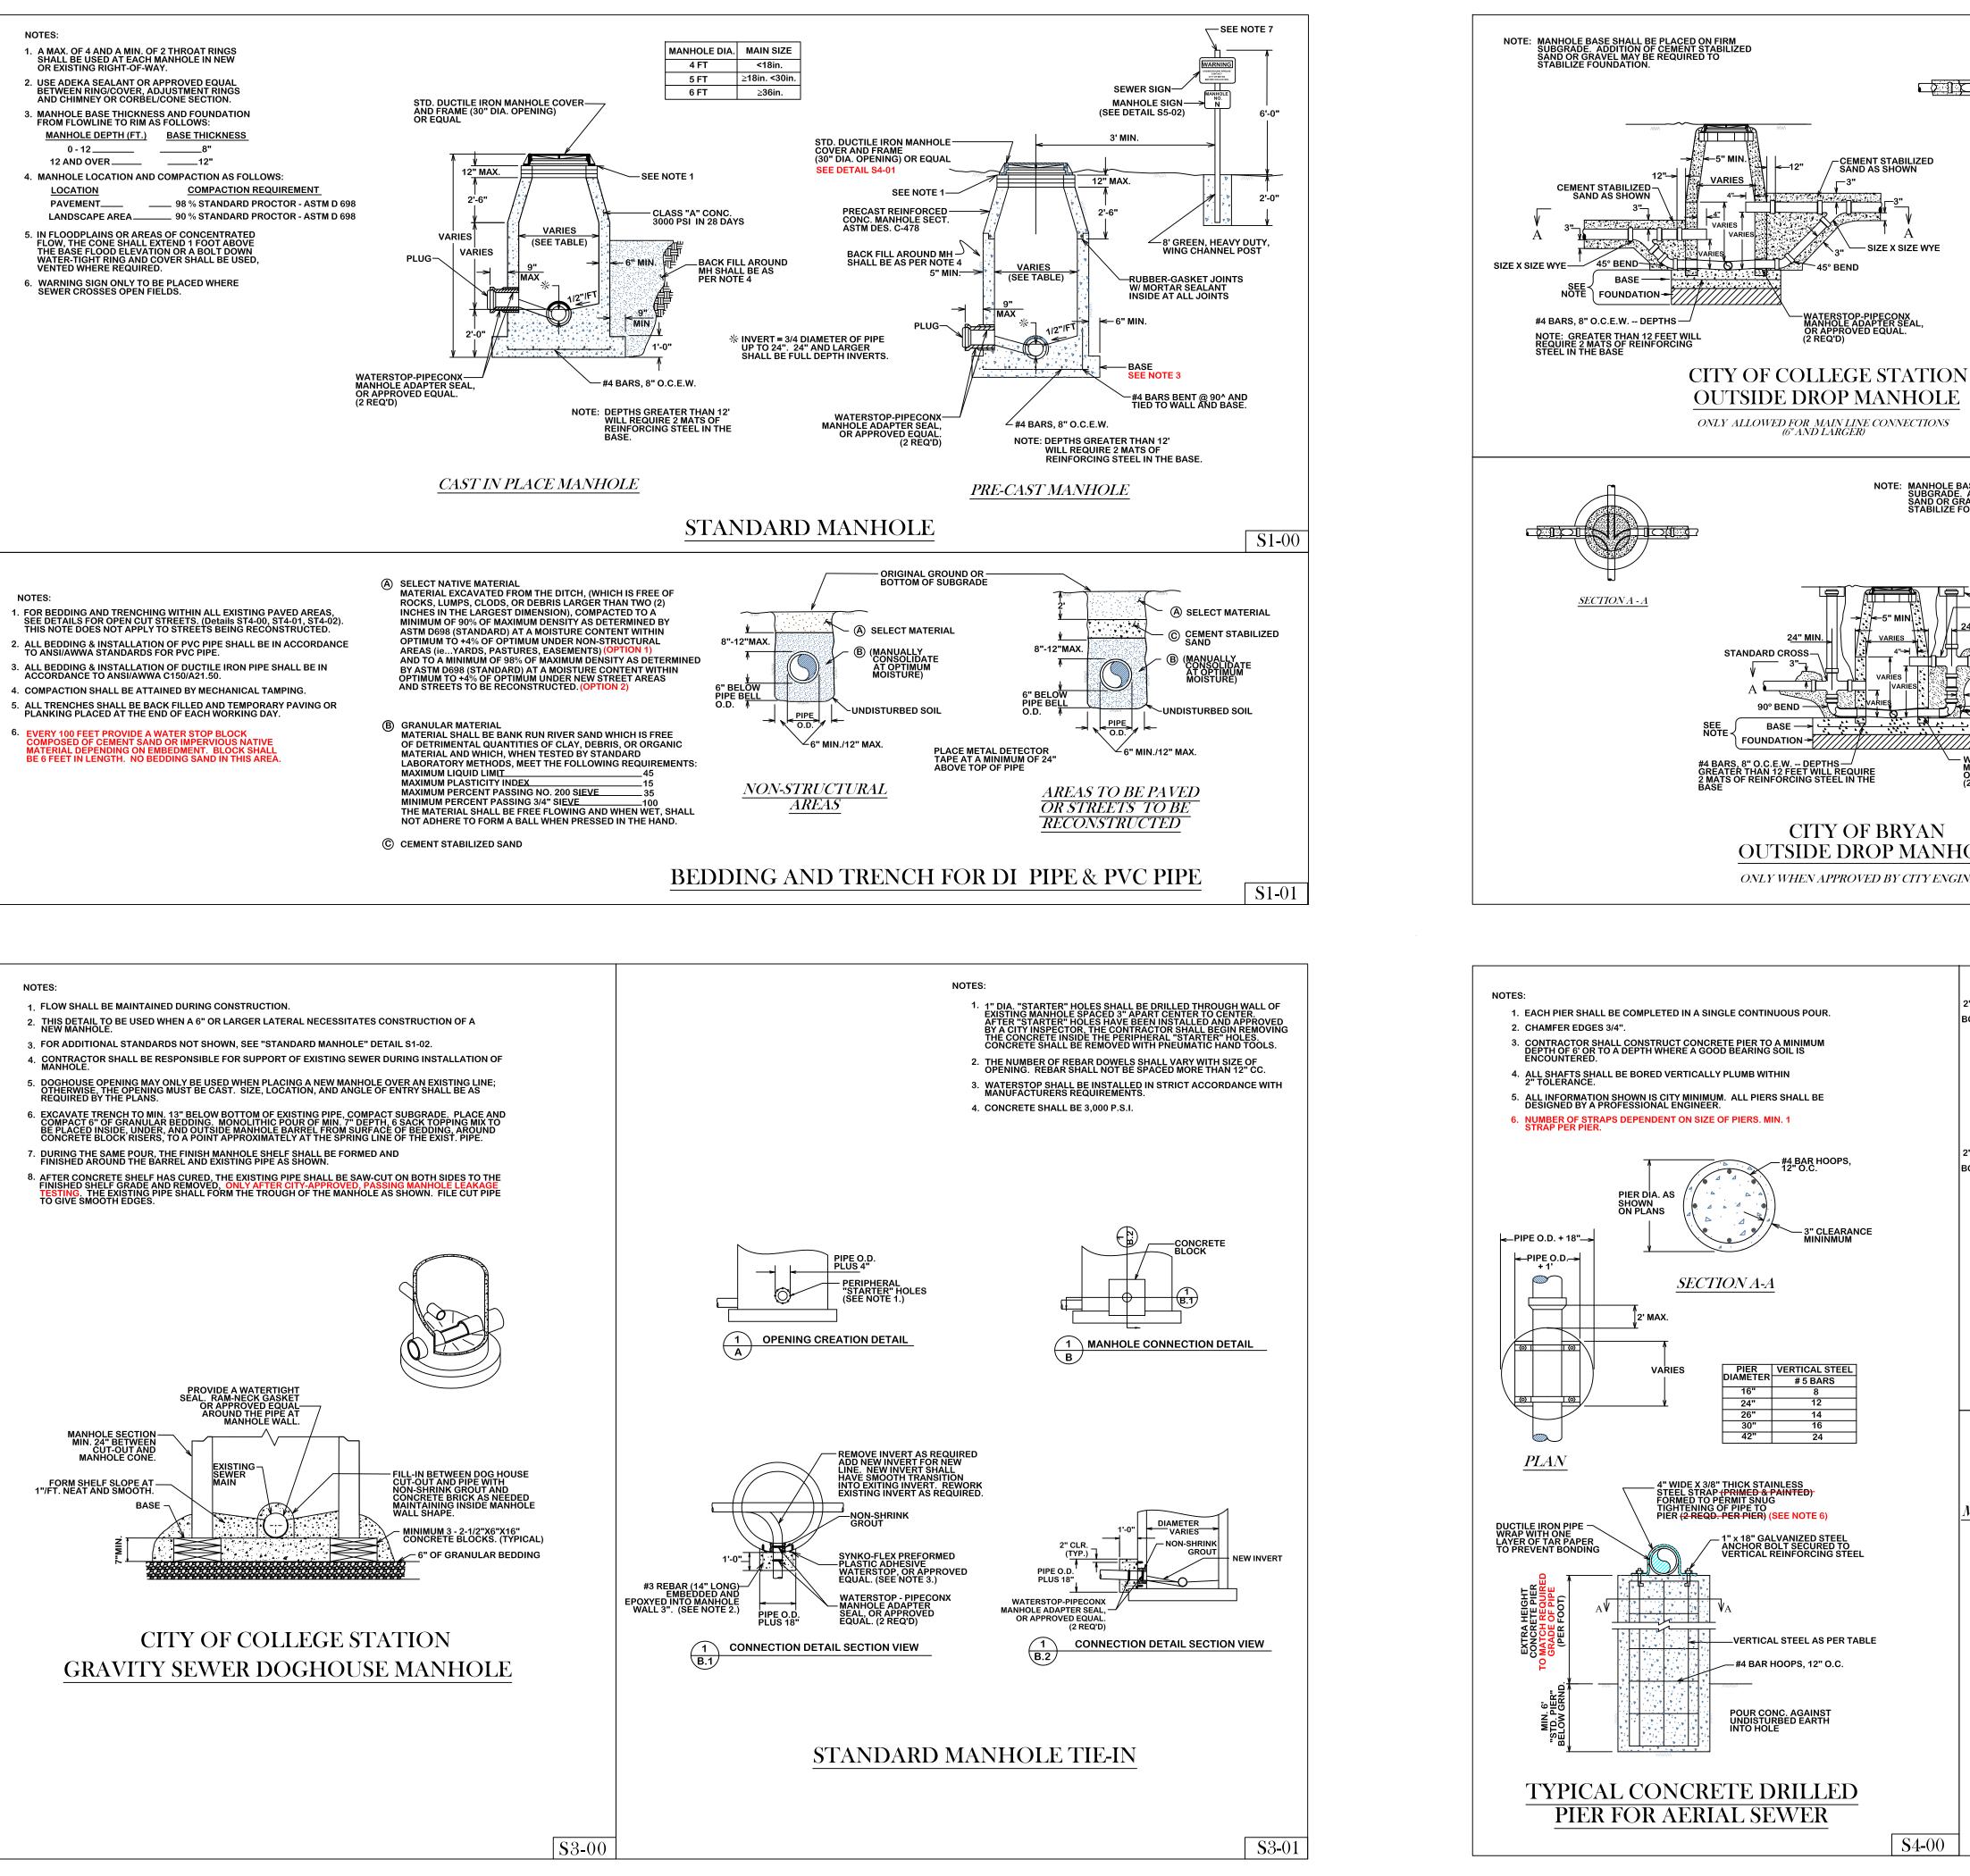


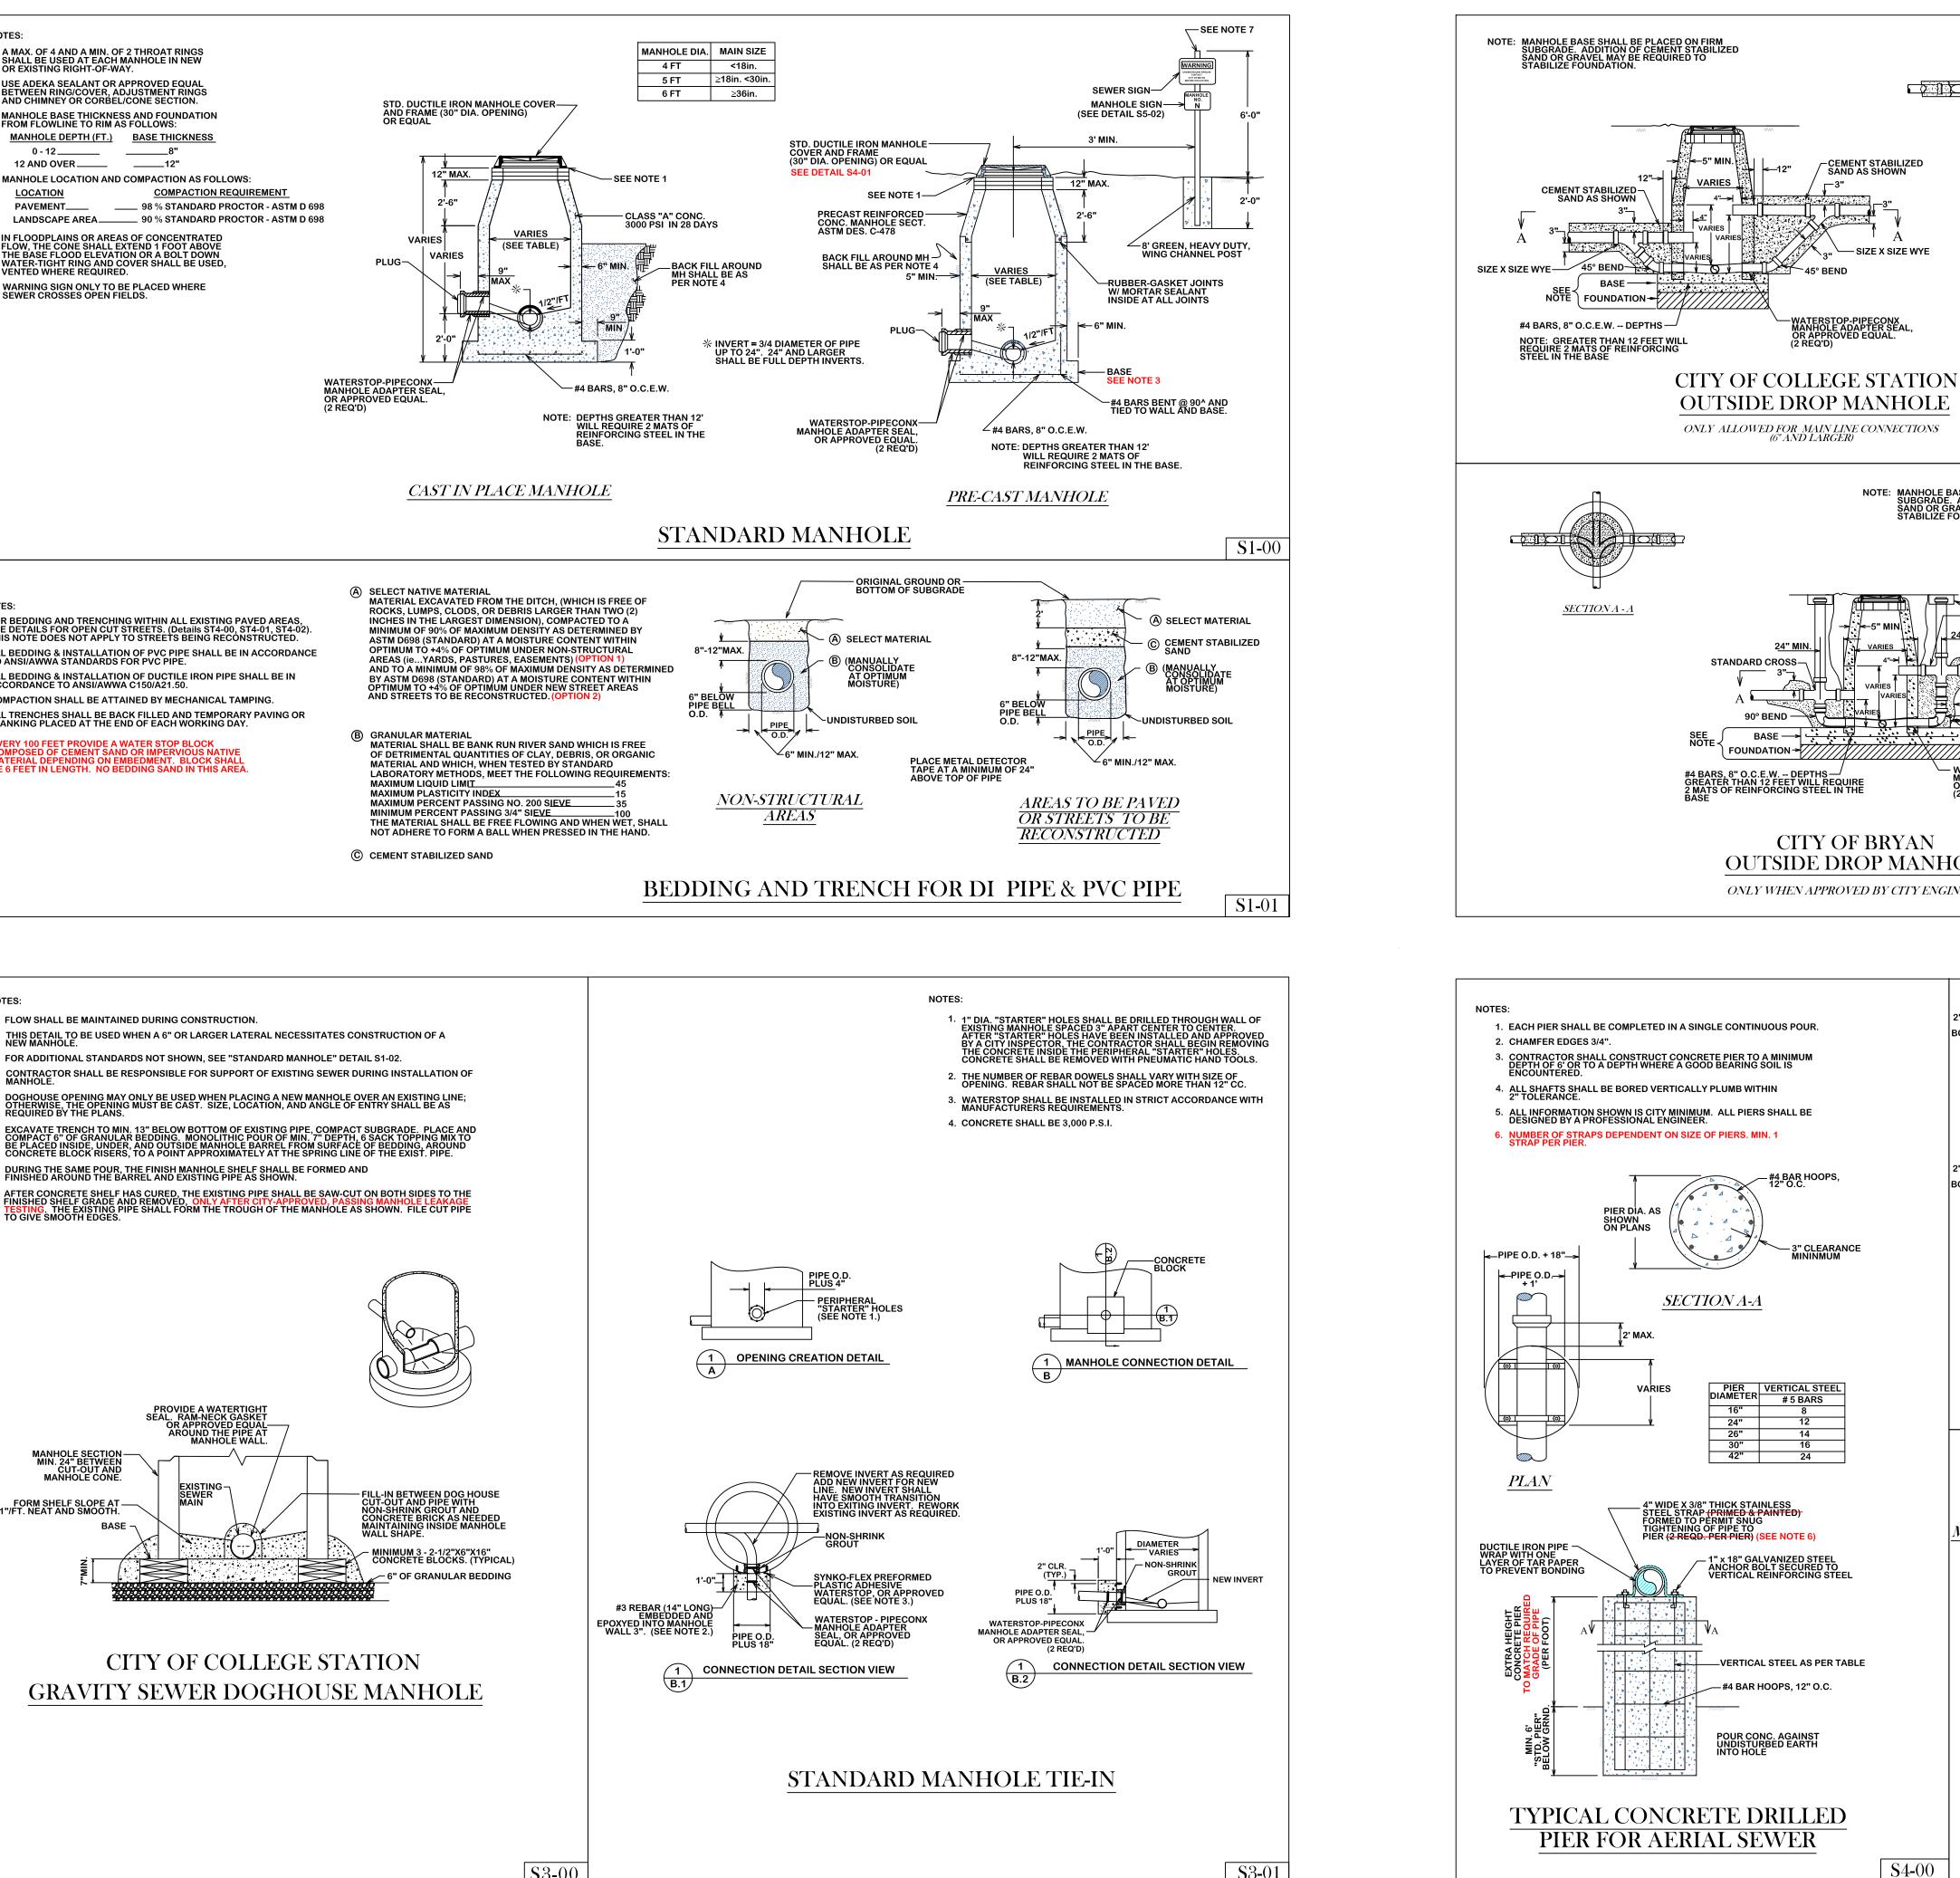

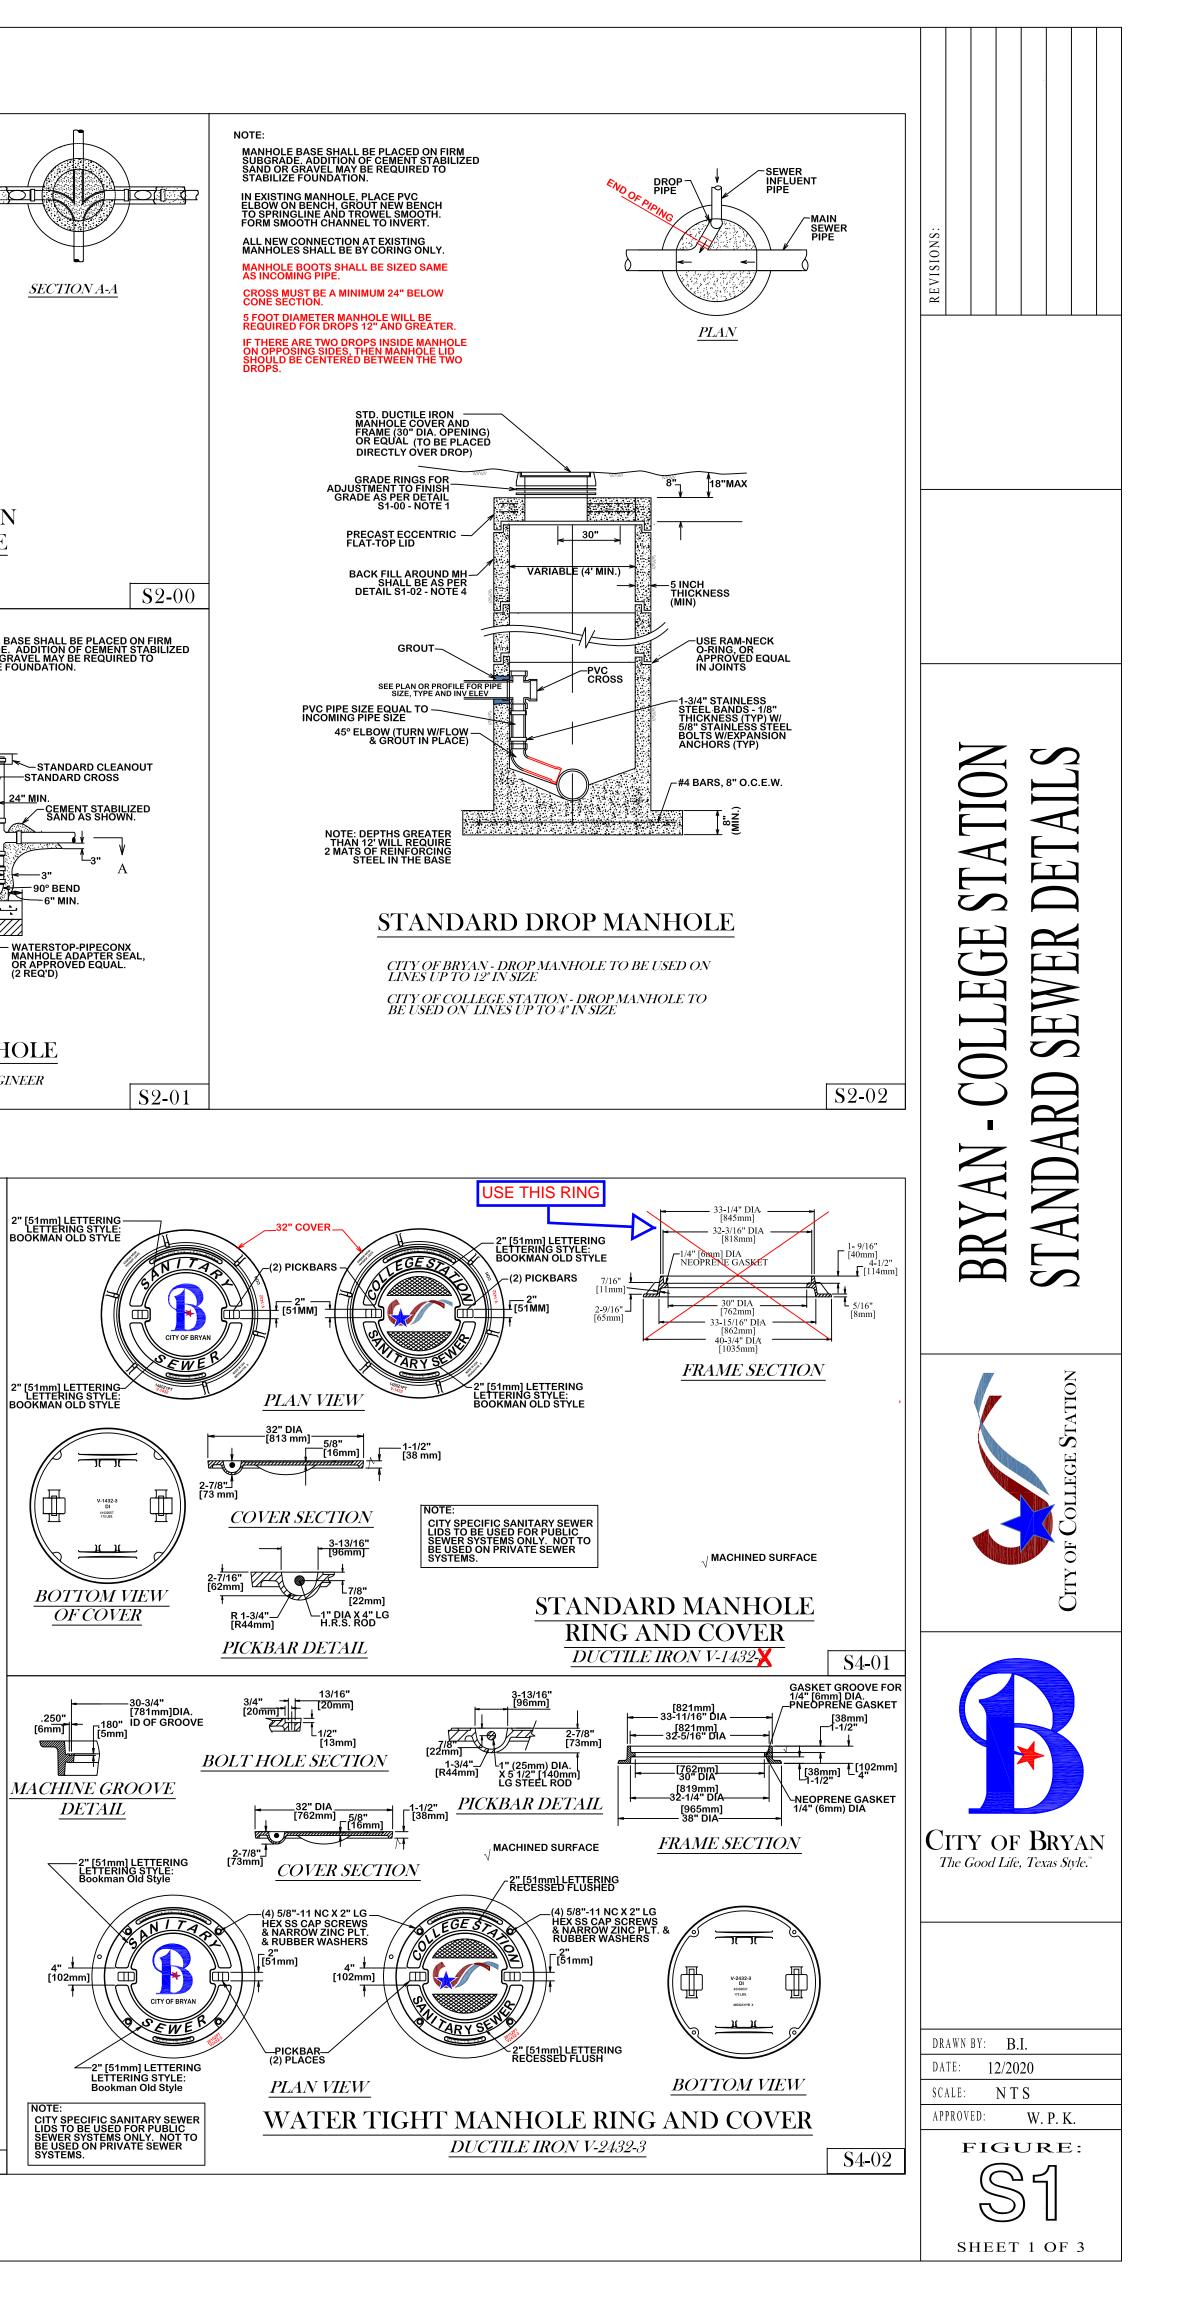

NOTE

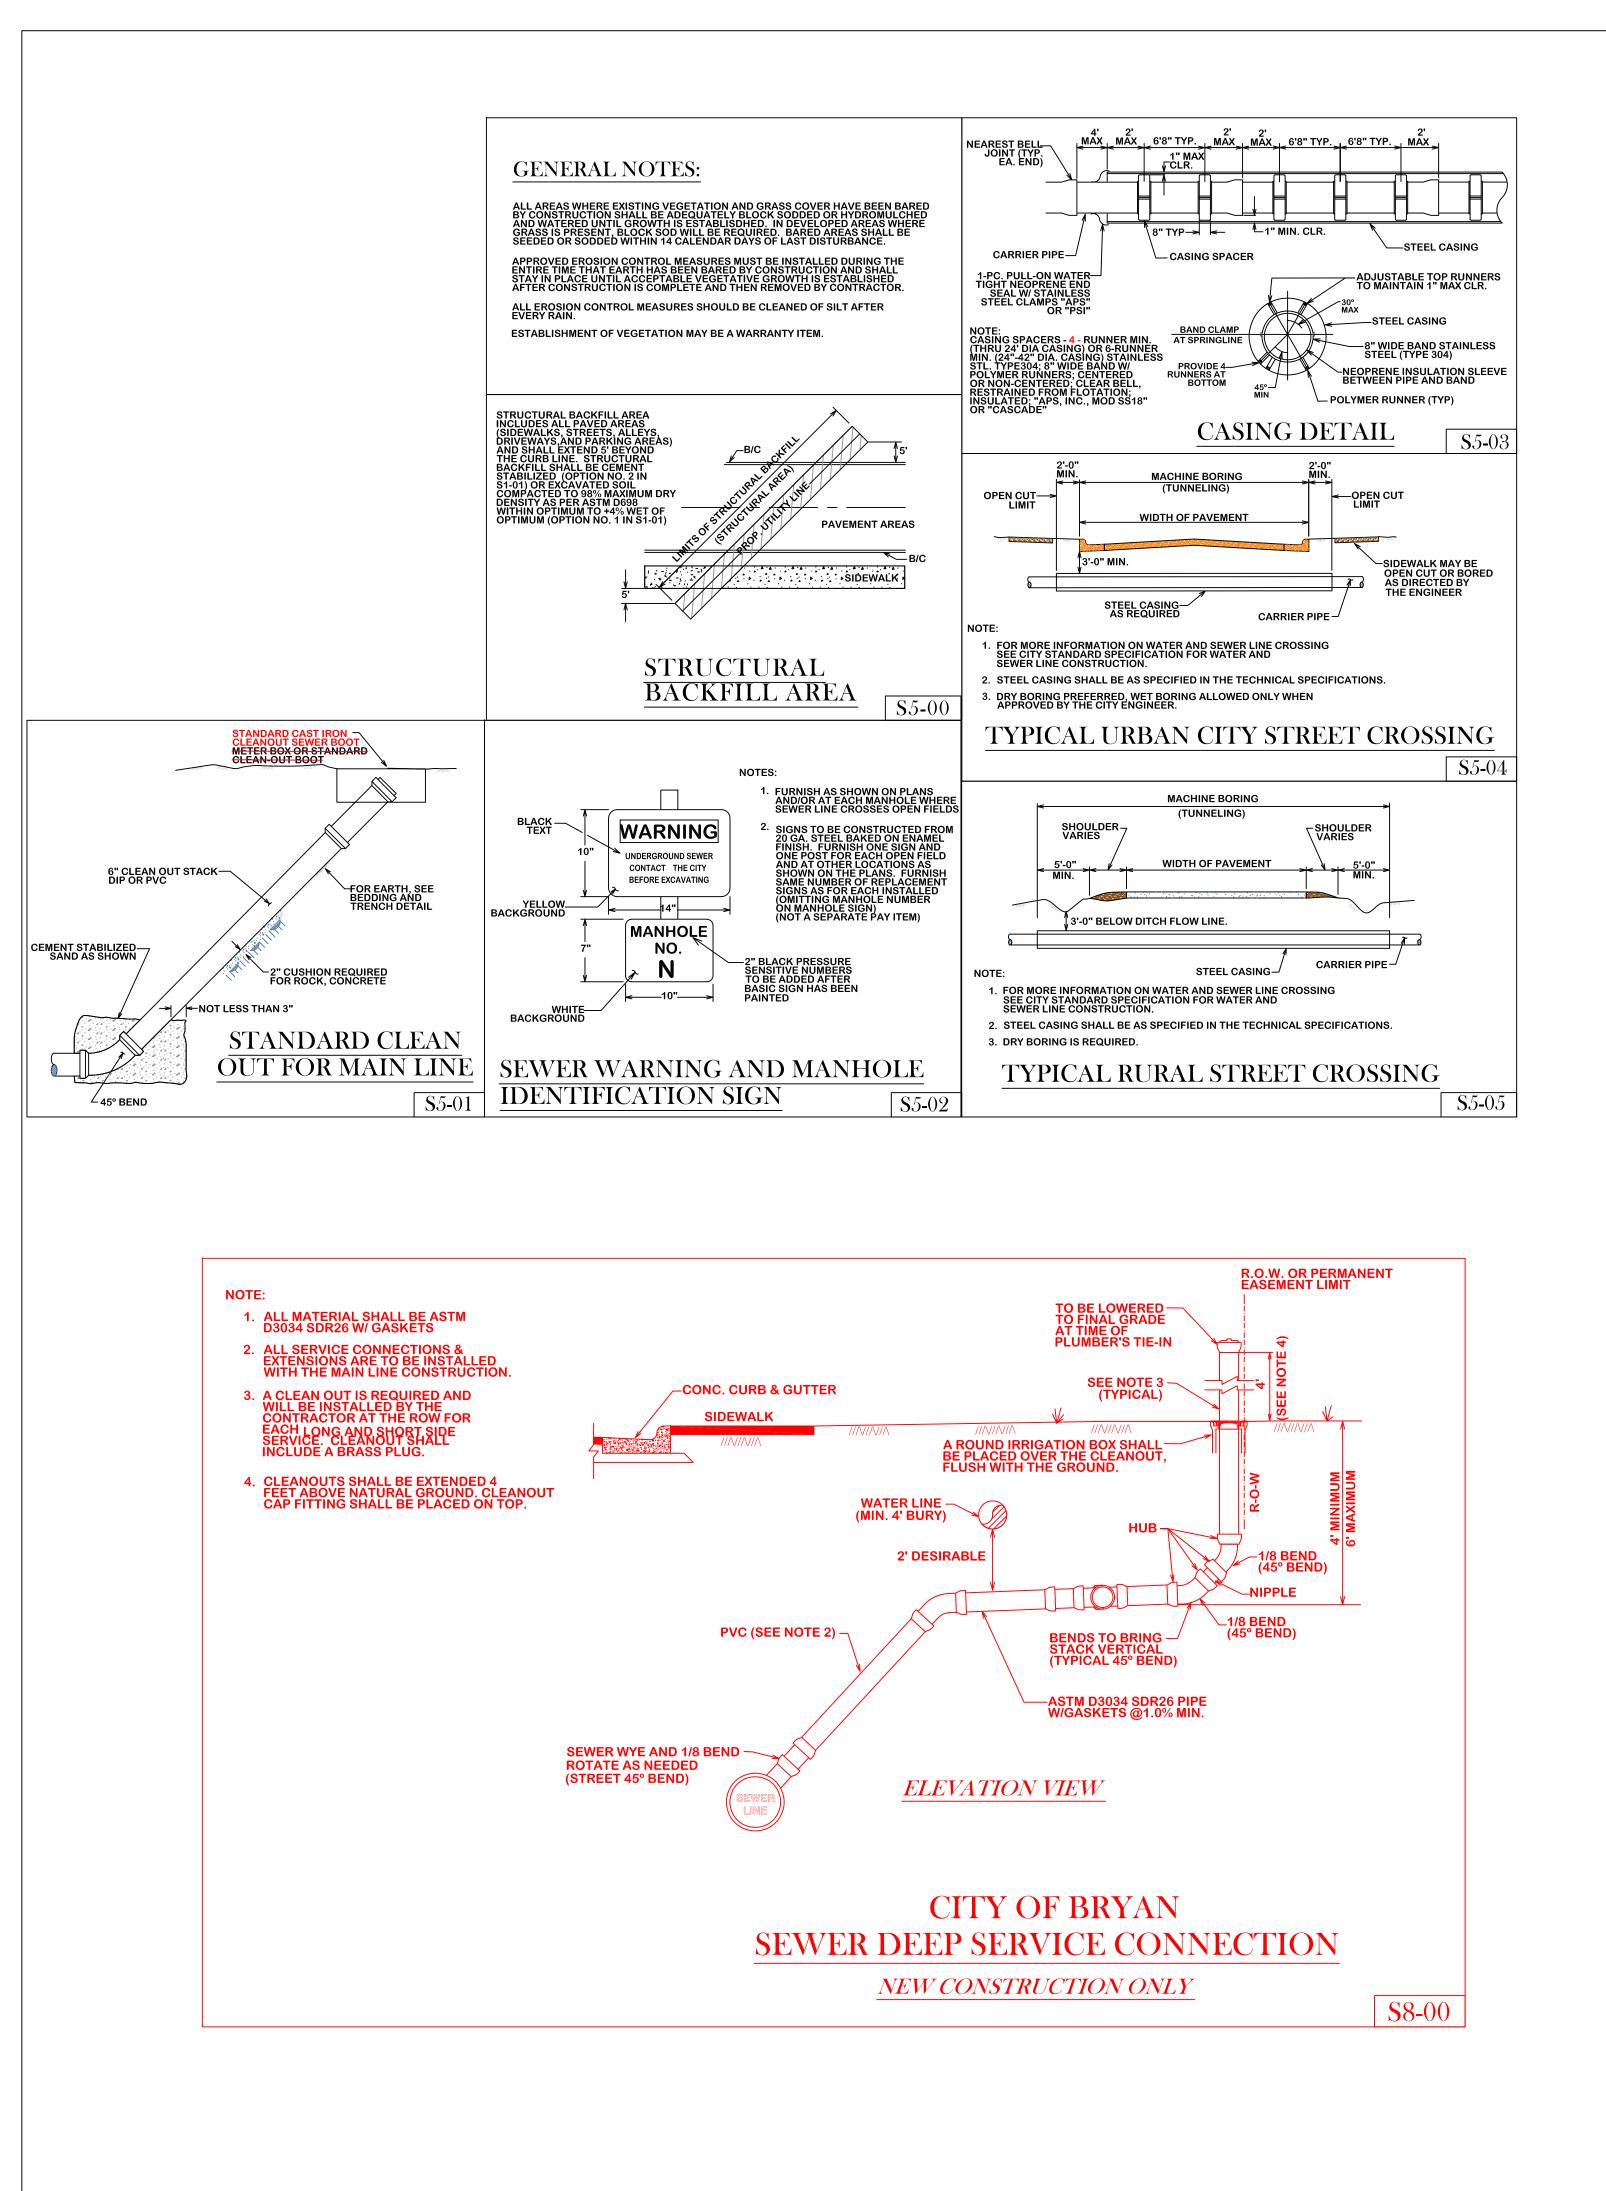

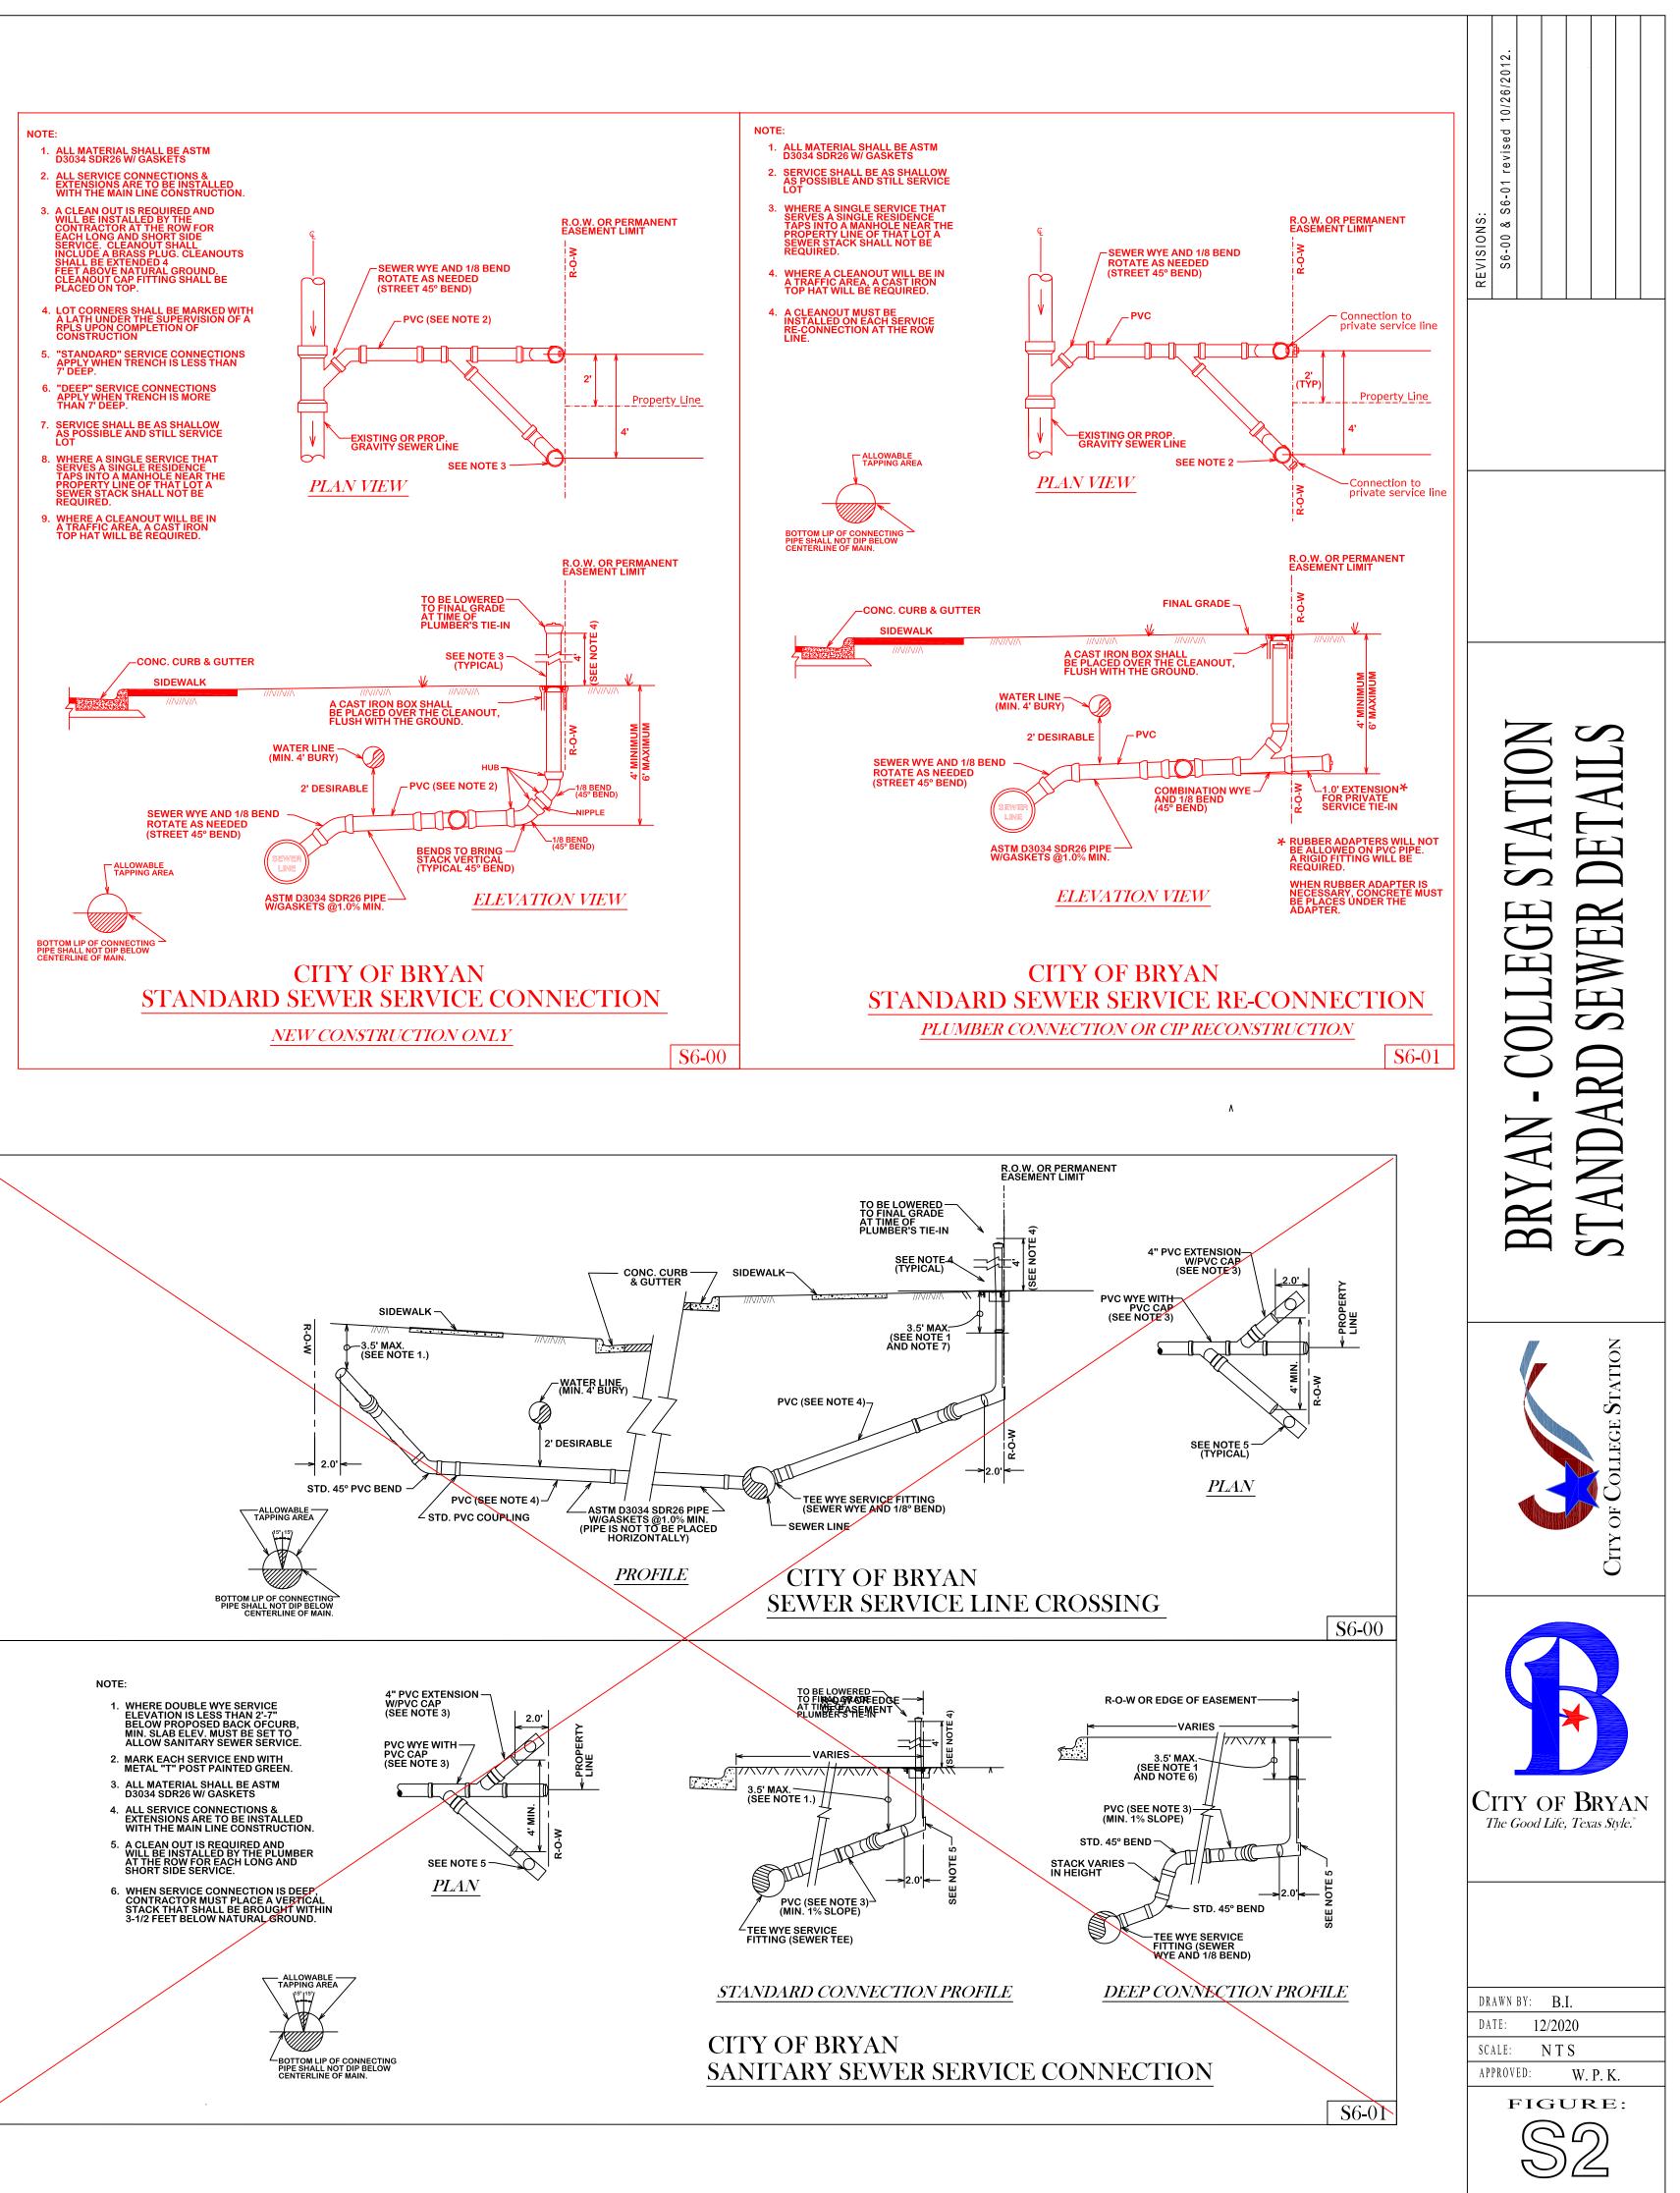

SHEET 2 OF 3

