

Site Plans for:

# Tabor Road Apartments

Siegert Subdivision  
Block 2, Lot 6R - 1.051 Acres,  
2816 Tabor Road  
Bryan, Brazos County, Texas



VICINITY PLAN  
N.T.S

OWNER/DEVELOPER:

*Haswell Park Properties, LLC*  
4215 FM 974  
Bryan, TX 77808

ENGINEER:



Firm # 9951  
PO Box 5192  
Bryan, Texas 77805  
979-739-0567



Know what's below.  
Call before you dig.

| Sheet List Table |                              |
|------------------|------------------------------|
| Sheet Number     | Sheet Title                  |
| C1               | Notes                        |
| C2               | Site Plan                    |
| C3               | Utility Plan                 |
| C4               | PVMT & Grading Plan          |
| L1               | Landscape Plan               |
| S1               | BCS Unified Sewer Details    |
| S2               | BCS Unified Sewer Details    |
| W1               | BCS Unified Water Details    |
| W2               | BCS Unified Water Details    |
| D                | BCS Unified Drainage Details |
| ST               | BCS Unified Street Details   |
| SW               | BCS Unified Sidewalk Details |

**Preliminary Plans Only  
Not for Construction**

This document is released for the purpose of  
interim review under the authority of Glenn Jones,  
P.E. 97800 on 2-Sep-26. It is not to be used  
for construction, bidding, or permitting purposes.

**Released for Review**

September 2026

J4 Engineering 9/2/2026 J4E Project #26-016 J4E\2026\26-016 Tabor Road Townhomes\Tabor Road Townhomes-Site Plan.dwg

General Notes:

- The contractor shall promptly notify the engineer of any discrepancies between these plans and other drawings of differing disciplines & specifications.
- The contractor is specifically cautioned that the location and/or elevation of the existing utilities as shown on these plans is based on records of the various utility companies and, where possible, measurements taken in the field. The information is not to be relied upon as being exact or complete. It is the contractor's responsibility to avoid all existing utilities and repair any damaged lines, at his own expense, whether the utility is shown on these plans or not. The contractor shall notify the appropriate utility company 48 hours prior to any excavation. The contractor shall also notify the engineer if design changes need to be made in the field.
- Contractor to verify all underground utilities in the field prior to construction.
- It is the responsibility of the contractor to comply with all state and federal regulations regarding construction activities near energized over head power lines.
- The contractor shall be responsible for the protection of all existing utilities or service lines that are crossed or exposed during construction operations. Where existing utilities or service lines are cut, broken, or damaged, the contractor shall repair or replace the utilities or service line with the same type of material and construction or better. This material and work shall be at the contractor's own expense.
- During the execution of the work, the contractor shall maintain the project site in an orderly and acceptable manner as far as practical. The contractor shall clean and remove from the project area all surplus and discarded materials, temporary structures, and debris of any kind and shall leave the project site in a neat and orderly condition. All clean up will be done to the satisfaction of the engineer.
- Contractor is responsible for OSHA established trench safety as described in the federal register 29 CFR Part 1926, a trench safety plan should be prepared and a "competent person" appointed prior to any and all excavating operations exceeding 5' depth. The plan is to be prepared and sealed by a registered texas professional engineer and shall be submitted to the City of College Station and consulting engineer prior to any excavation on the project.
- A copy of the approved construction plans shall be kept on site at all times throughout the entire construction of the project. Contractor shall maintain a set of redline drawings, recording as-built conditions during construction. These redline marked up drawings will be submitted to the design consultant who will make the changes on the original tracings, labeling each sheet in the set as "record drawings".
- The contractor shall be responsible for safeguarding and protections all material and equipment stored on the jobsite. The contractor shall be responsible for the storage of materials in a safe and workmanlike manner to prevent injuries, during and after working hours, until project completion.
- Contractor to store materials at location(s) approved by & coordinated with the owner. Equipment is to be stored overnight at locations so as not to block streets or drives. Materials are to be protected from damage by the elements.
- Contractor shall saw cut remove and replace concrete pavement, and curb & gutter as required to construct proposed improvements.
- It shall be the responsibility of the contractor to pay for and obtain all required permits and inspection approvals for all work shown.
- Any adjacent property and right-of-way disturbed during construction will be returned to their existing condition or better. The contractor agrees to repair any damage to the public right-of-way in accordance with the standards of the applicable regulatory agency.
- All exposed dirt surfaces shall be seeded, hydro-mulched, or sodded.
- The contractor shall not create a dirt nuisance or safety hazard in any street or driveway. the pavement be cleaned daily.
- Adequate drainage shall be maintained at all times during construction and any drainage ditch or structure disturbed during construction shall be restored to existing conditions or better.
- The contractor shall coordinate all fence removal and replacement with the Owner.
- The contractor shall protect all monuments, iron pins, and property corners during construction.
- The contractor must provide construction staking from the information provided on the plans.

General Utility Note (Private & Public):

- All excavation for underground utilities shall be made true to grade. Excavation shall be made a minimum of six inches below the required grade and provide a sand bed for the piping. Backfill over piping shall be made with earth or fill sand , free of debris, and shall be tamped by hand or mechanical means to the density of the adjacent undisturbed earth or to 95% standard proctor density (ASTM D698), which ever is greater. All trenching and excavation shall be done in strict accordance with current OSHA requirements and all other applicable safety codes and standards.
- Minimum bury or cover specified is to be measured from finish grades. Where utility line extend under pavement, the bury or cover shall be measured from the bottom of the structure.
- Utility installations in non-structural areas shall be bedded and initial backfill consistent with non-structural requirements. In structural areas (i.e. under foundations, pavement, walks, etc.) the utility shall be bedded and initial backfill with cement stabilized sand. Final backfill in these areas shall be compacted by mechanical tamping to structural compaction requirements.
- Regardless of elevations shown for manhole rims, clean-out covers, or grates, these items shall be placed flush with the pavement elevations and slopes. Manholes and clean-outs not in pavement areas shall be set 3 inches above the finish grade.
- Contractor shall uncover existing utilities at all "points of interest" to determine if conflicts exist before commencing and construction. Notify the engineer at once of any conflict.
- The contractor shall coordinate all utility installation so that grade critical elements (i.e. storm drain, sanitary sewer, etc.) do not conflict with non-grade critical elements (i.e. electrical conduit, water services, etc.).
- The contractor shall furnish all materials, equipment, and labor for excavation, boring, installation, and backfilling of utility lines and relates appurtenances, as shone on the plans.
- The loading and unloading of all pipe and other accessories shall be in accordance with the manufacturer's recommended practices and shall, at all times, be performed with care to avoid any damage to the material. The contractor shall locate and provide the necessary storage areas for materials and equipment.
- Contractor shall be responsible for coordinating all connections to public systems and installations with regulatory inspector.
- This project shall be built by means of open cut except as noted on the drawings. Contractor to determine the locations of bore pits in the field subject to the inspector's approval.
- Structural backfill will be required for all excavation within 5 feet of public roadway pavements or walks.

Private Utility Notes:

- The contractor shall install the proposed private utility lines in accordance with local codes, latest national plumbing code, and all applicable state and local laws. Other private or public utilities shall be installed in accordance with the utility company's specifications. Should these drawings or specifications differ with other utility company's specifications, the stricter of the two shall apply.
- It shall be the responsibility of the contractor to pay for and obtain all required permits and inspection approvals for all work shown.
- The contractor shall coordinate all installations of service lines, conduits, meters, etc., with the appropriate utility company.

Water Line Notes (Public & Private):

- All domestic water line pipe shall be constructed out of PVC (Sch 40). Public or fire water line pipe shall be constructed out of C900-DR14 and public services shall be copper.

Storm Sewer Notes (Private):

- All 15 inch to 42 inch storm sewer pipe, shall be constructed out of reinforced concrete pipe (RCP), C443 ASTM C76, Class III except as noted.
- All 6 inch to 12 inch storm sewer pipe, except as noted, shall be HDPE. SDR-35, ASTM D-3034, PVC pipe may be used in place of HDPE pipe.
- Contractor shall provide a minimum of 12 inch clearance at storm sewer and water line crossings and a minimum of 6 inch clearance at storm sewer and sanitary sewer crossings.
- Unless otherwise specified, the contractor shall install all storm sewer pipe in accordance with the trench detail contained in these construction drawings.

Demolition & Construction Notes:

- Demolition of existing structures and improvements shall include all work contained on these plans, but shall not be limited to the items specially identified. Any materials to be demolished or cleared shall be completely removed and disposed of. This work will not only consist of above ground items, but underground elements as well, including but not limited to: tree roots, foundation systems, old pipes, etc. The contractor shall notify the engineer of any additional items that require demolition, not identified on these plans, prior to removal.
- It shall be the responsibility of the contractor to stage and sequence all demolition work with utility companies to provide minimal interruption and inconvenience of utility services.
- Demolished surplus material shall be legally disposed of off-site.
- All pavement edges, bounding the construction area & matching with new construction, shall be neatly sw cut, unless gravel. Flexible pavement shall be saw cut a minimum of 24" beyond any proposed structures.
- The contractor shall clear all right-of-ways and easements contained in these construction drawings.
- The contractor shall field verify and locate all existing utilities on site prior to demolition.
- The contractor shall perform demolition activities as noted and shown on these plans and as directed by the owner/ developer.
- It shall be the responsibility of the contractor to obtain any permits and pay any fees required for demolition and disposal from the appropriate authorities.
- The contractor shall install all erosion and sediment control devices prior to commencing demolition work.
- The contractor is responsible for the protection of all utilities that are to remain in place.
- The contractor shall take all precautions to avoid damage to any existing road surface.
- All existing items that are to remain in place which are damaged during construction shall be restored to original condition, or better, at the sole expense of the contractor.
- Should any existing utilities not shown or shown incorrectly on this plan be found on site, the contractor shall contact the engineer immediately to discuss any possible conflicts before proceeding with any work in that area.
- An asbestos survey must be performed prior to the demolishing of any structures. The contractor shall adhere to the requirements set forth in the asbestos survey and report.

Dimensional Control Notes:

- The contractor may obtain an electronic copy of these plans for construction purposes. The electronic file and information generated, by J4 Engineering (J4E), for this project is considered by j4e to be confidential. When issued, it's use is intended solely for the individual or entity to which it is addressed. The material is intended for use by the recipient named, only, and permission is not granted to the recipient for distribution of these documents in any form or fashion. The recipient understands that this data is authorized "as is" without any warranty as to it performance, accuracy, freedom from error, or as to any results generated throughout its use. The recipient also understands and agrees that J4E, upon release of such data, is no longer responsible for their use or modification. The user and recipient of the electronic data accepts full responsibility and liability for any consequences arising out of their use.
- All dimensions shown are to be used in conjunction with these plans for locating all improvements and shall be field verified by the contractor for workability prior to construction of improvements.
- Unless otherwise shown, all dimensioning is to the back of curb or edge of pavement, which ever is applicable.

Grading Notes:

- All unpaved areas shall be adequately graded to drain at a minimum of 1.00% slope, unless otherwise noted, so that no ponding occurs.
- Unless otherwise specified, unpaved areas shall drain away from buildings so that the perimeter curb is a minimum 6" lower than the finished floor.
- Finish grade adjacent to curbing or sidewalk shall be ¼" below the top of concrete and 2" below in landscaping areas.
- When top of curb elevations are shown, the curb height is 6" unless otherwise specified.
- The contractor shall follow the general intent of the grading plans. Minor adjustments to the actual elevations shown on the grading plan may be required to match existing ground elevations and structures.
- Adequate drainage shall be maintained at all times during construction and any drainage ditch or structure disturbed during construction shall be restored to existing conditions or better.
- The approval of these plans is not an authorization to grade adjacent properties. When field conditions warrant off-site grading, permission must be obtained from the affected property owner(s). Any adjacent property and right-of-way disturbed during construction will be returned to there existing conditions or better.

Erosion Control Notes:

- Erosion control measures shown in these plans shall be considered the very minimum required. It shall be the responsibility of the contractor to implement all other erosion control measures (diversion berms, drainage structures, swales, additional fencing, etc...) necessary to keep the existing improvements and developments from damage of any kind, during all phases of demolition and construction.
- The site operator, or his representative established by a letter of delegation, shall make a visual inspection of all siltation controls and newly stabilized areas on a daily basis; especially after a rainfall to insure that all controls are maintained and properly functioning. Any damaged controls shall be repaired or replaced prior to the end of the work day, including re-seeding and mulching or re-sodding, if necessary.
- All sediment trapping devices shall be installed as soon as practical after the area has been disturbed. All sediment trapping devices shall be cleaned when sediment level reaches 25% capacity. Sediment shall be disposed of by spreading on site or hauling away if not suitable for fill.
- During construction, contractor shall maintain best management practice (bmp). Sediment fence, hay bale barriers, or other devices shall control all storm water leaving the site.

- The contractor shall be responsible for establishing temporary erosion control measures as required for different phases of construction. Erosion control measures shown may need to be adjusted to handle increased or concentrated flows created by various stages of construction.
- Phase II erosion control measure measures shall be implemented immediately after construction of their associated improvements. Inlet protection barriers shall be constructed with hay bales or silt fencing. Inlets located in pavements areas shall be protected with sand bags, replacing the hay bales or silt fencing once the pavement is in place. Erosion control measures shall be kept in place until upstream drainage areas are fully stabilized.
- The contractor is responsible for removing sediment control devices after the site has been seeded and/ or sodded, and ground cover has taken root.
- The contractor shall take all necessary measures to ensure that all disturbed areas are stabilized. Designated areas shall be block sodded and all other areas disturbed due to construction shall be hydro-mulched seeded. These stabilized areas shall be sodded or seeded, fertilized, and watered to establish a solid ground cover within 30 days of completion or if activities cease for 14 days.
- When hydro-mulching is required, contractor shall keep mulch moist after installation and until area shows growth.
- Erosion control measures shall be implemented prior to any excavation or demolition work.

Sidewalk Construction

- Sidewalks shall be doweled into and tie to any concrete structure adjacent to sidewalk (driveway, inlet box, curb) #4 x 12" bars @ 18" O.C.
- ADA ramps shall be constructed per the ambulatory ramp details on the pavement plan shown in these plans. All ramps shall have a detectable warning surface for the full length of the ramp.

Paving Notes:

- The pavement system shown was designed without the aid of a geotechnical investigation. Due to the plastic soils within this area, some differential movement may still occur due to seasonal soil moisture variations.
- Sub-grade
  - Existing trees, stumps, and large tree systems, shall be grubbed and removed. Vegetation shall be removed and the top 6 inches of top soil and sub-grade stripped from the areas to be covered by the proposed improvements.
  - Paving areas shall be proof-rolled with a 20 ton roller and, if required at the time of construction, the contractor shall stabilize weak areas by over excavation and backfilling.
  - Materials excavated on site, excluding the top 6 inches, may be used as fill material, under pavement areas only, if the material is free from trash, lumps, clods, organic substance, & other foreign matter.
  - Fill material shall be placed in eight inch maximum loose lifts, with each lift wetted or dried to a moisture content range of 0% to +3% of the optimum moisture content and compacted to a uniform density of 95% of the maximum dry density as determined by ASTM D698.
  - Compaction test, for fill, shall be verified by in-place density test for each lift. One in-place density test shall be performed for every 4,000 SF with a minimum of 3 tests being performed, per lift.
- Asphalt
  - All asphalt paving shall be hot-mix asphalt cement (HMAC), Type D P64-22, in accordance with TxDOT Item #340.
  - No more than 20% RAP shall be used with HMAC mix design.
  - Limestone base shall be prime coating with RC-250, MC-30, CRS-1P/2P, or approved equal in accordance with TxDOT Item #300 and item #310.
- Portland Cement Concrete
  - All concrete, unless otherwise specified, shall have a minimum compressive strength of 3,500 psi at 28 days for pavement and 3,000 psi at 28days for non-pavement applications (i.e. sidewalks, drainage flumes, and containment structures).
  - All concrete shall be vibrated when placed and not raked a distance greater than 10 feet.
  - Unless otherwise noted, joint spacing shall not exceed 15 feet in any direction to another joint or edge of pavement. Control joints shall be cut between 4 and 18 hours after placement of concrete and may be substituted with construction joints if provided, the contractor shall follow the general intent of the joint plans shown.
  - Expansion joints shall not exceed a maximum spacing of 45 feet and should not be placed through the middle of area inlets or junction boxes located in the pavement. All area inlets or junction boxes, located in pavement area, shall be installed with isolation joints between the structure and the pavement.
  - All joints shall be sealed with Sonoborn Sonolastic SL-1, or an approved equal.
  - Concrete shall not be placed if the air temperature is 50° F and falling or 95° F or higher. Concrete may be placed if the air temperature is 40° F and rising or less than 95° F.
- Steel
  - All reinforcing steel shall be deformed billed steel bar having a minimum yield strength of not less than 60 KSI conforming to ASTM A6115, Grade 60.
  - All reinforcing steel shall be free from rust or other bond reducing agents.
  - All splices in pavement and curbing steel shall be staggered and lapped 30 inches times the bar diameter or 12 inches, whichever is greater.
  - Concrete coverage for the reinforcing steel shall comply with the ACI code, latest edition. The steel shall have a minimum 1 ½ inch clearance.

Gas Company Notes:

- At all underground gas utility crossings, the contractor shall give the appropriate utility company a minimum of 72 hours notice so that their field representative may be present.
- Eighteen (18) inch clearance shall be maintained between the proposed utility and the existing underground gas line. This clearance shall be measured form outside of pipe to outside of pipe, or sleeving, whichever is more conservative.
- For excavation near the underground gas line(s), the contractor shall cover, or remove, the bucket teeth of the excavator. The final thirty-six (36) inches surrounding the gas line shall be excavated by hand digging.

Traffic Control Notes:

- Contractor shall provide and install traffic control devices in conformance with part VI of the Texas Manual on Uniform Traffic Control Devices (Texas MUTCD, most recent edition with revisions) during construction.
- Lane closure will not be allowed unless approved by the TxDOT, County, or BCS representative, as applicable.
- The work shall be completed such that the roadway will be fully opened to traffic overnight. Overnight lane closures will not be permitted, unless otherwise approved by the applicable engineer.
- Plastic drums shall be used for overnight delineation of off roadway work areas.

| Legend        |                     |                                          |                          |
|---------------|---------------------|------------------------------------------|--------------------------|
| Line Types    |                     |                                          |                          |
|               | W-8                 | Existing Water Line, Size Noted          |                          |
|               | W-6                 | Proposed Water Line, Size Noted          |                          |
|               | W                   | Existing Water Service                   |                          |
|               | W                   | Proposed Water Service                   |                          |
|               | S-8                 | Existing Sanitary Sewer Line, Size Noted |                          |
|               | S-8                 | Proposed Sanitary Sewer Line, Size Noted |                          |
|               | S                   | Existing Sanitary Sewer Service          |                          |
|               | S                   | Proposed Sanitary Sewer Service          |                          |
|               | ST                  | Existing Storm Sewer Piping              |                          |
|               | ST                  | Proposed Storm Sewer Piping              |                          |
|               | GAS                 | Existing Natural Gas Line                |                          |
|               | GAS                 | Proposed Natural Gas Line                |                          |
|               | UE                  | Existing Underground Electrical Line     |                          |
|               | UE                  | Proposed Underground Electrical Line     |                          |
|               | AE                  | Existing Aerial Electrical Line          |                          |
|               | AE                  | Proposed Aerial Electrical Line          |                          |
|               | T                   | Existing Underground Telephone           |                          |
|               | T                   | Proposed Underground Telephone           |                          |
|               |                     | Existing Contour, Elevation Noted        |                          |
|               |                     | Proposed Contour, Elevation Noted        |                          |
|               |                     | Existing Easement                        |                          |
|               | SILT                | Silt Fence                               |                          |
|               |                     | Existing Chain Link Fence                |                          |
|               |                     | Proposed Chain Link Fence                |                          |
|               | XXX                 | Existing Wire Fence                      |                          |
|               | //                  | Existing Board Fence                     |                          |
|               | //                  | Proposed Board Fence                     |                          |
| Symbols       |                     |                                          |                          |
|               | Hydrant             |                                          | Storm Grate Inlet        |
|               | Water Valve         |                                          | S.E.T.                   |
|               | Water Manhole       |                                          | Sewer Manhole            |
|               | Water Meter         |                                          | Sewer Clean-Out          |
|               | Phone Pedestal      |                                          | Mail Box                 |
|               | Sign                |                                          | Power Pole               |
| Abbreviations |                     |                                          |                          |
| TP            | Top of Pavement     | ROW                                      | Right of Way             |
| TC            | Top of Curb         | W/                                       | With                     |
| TG            | Top of Ground       | W/OUT                                    | With Out                 |
| TW            | Top of Walk         | S.E.W.                                   | Sloped End Treatment     |
| TI            | Top of Inlet        | BM                                       | Bench Mark               |
| TR            | Top of Wall         | TBM                                      | Temporary Bench Mark     |
| FL            | Flow Line           | SY                                       | Square Yard              |
| EG            | Existing Grade      | LF                                       | Linear Foot              |
| PG            | Proposed Grade      | CO                                       | Clean Out                |
| TS            | Top of Step         | O.C.                                     | On Center                |
| Min           | Minimum             | O.C.E.W.                                 | On Center Each Way       |
| Max           | Maximum             | PSI                                      | Pounds per Square Inch   |
| N.T.S.        | Not to Scale        | PVC                                      | Polyvinyl Chloride       |
| PI            | Point of Inflection | RCP                                      | Reinforced Concrete Pipe |
| PT            | Point of Tangency   | PVMT                                     | Pavement                 |
| PC            | Point of Curvature  | H                                        | Horizontal               |
| Sch           | Schedule            | V                                        | Vertical                 |

# Notes

General Notes:

- It is the intent of these plans to comply with all BCS guidelines, details, and specifications.

## Preliminary Plans Only Not for Construction

This document is released for the purpose of interim review under the authority of Glenn Jones, P.E. 97600 on 2-Sep-26. It is not to be used for construction, bidding, or permitting purposes.

## Released for Review

|     |                |      |
|-----|----------------|------|
|     |                |      |
|     |                |      |
|     |                |      |
|     |                |      |
| No. | Revision/Issue | Date |

Firm Name and Address:

PO Box 5192 - Bryan, Texas - 77805  
979-739-0367 www.J4Engineering.com  
Firm# 9951

Project Name and Address:

**Tabor Road Apartments**  
Siebert Subdivision  
Block 2, Lot 6R - 1.051 Acres  
2816 Tabor Road  
Bryan, Brazos County, Texas

Date:

September 2026


Scale:

As Noted

Drawn By:





CB

C1

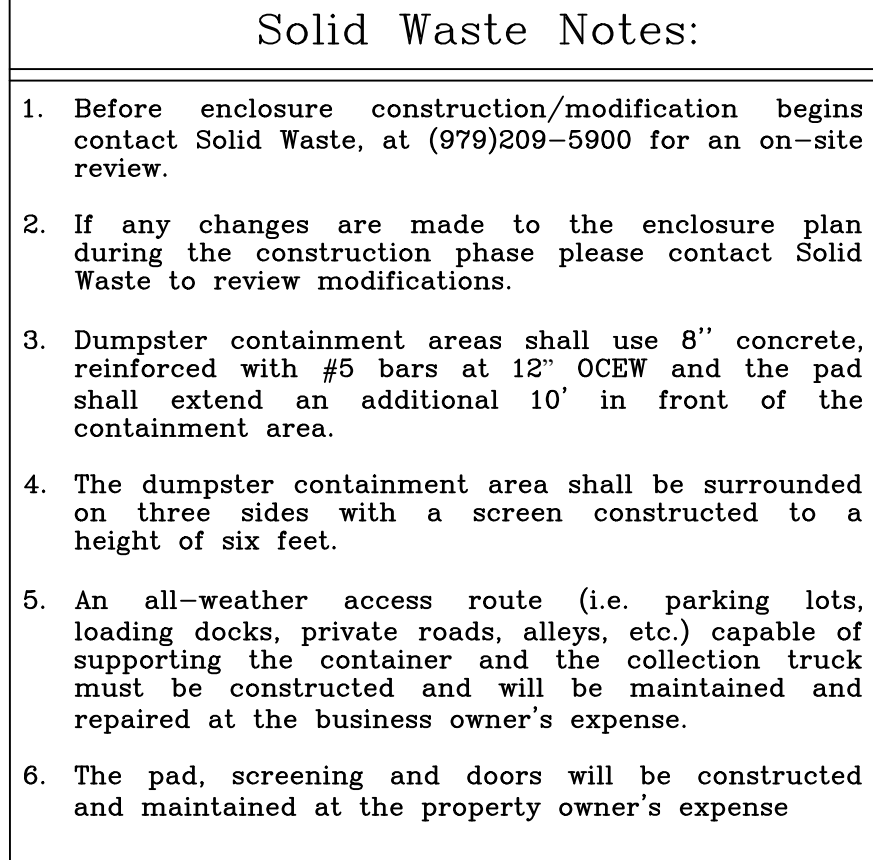

**Notes:**

1. The sign shall be 12" wide by 18" in height stating "FIRE LANE DESIGNATED PARKING ONLY" with a companion sign 12" wide and 6" in height stating "TOW AWAY ZONE" and be mounted in the location shown.
2. Sign shall be painted on white background with symbols, letters, and border in red.
3. Sign shall comply with City of Bryan Ordinance 42-6.




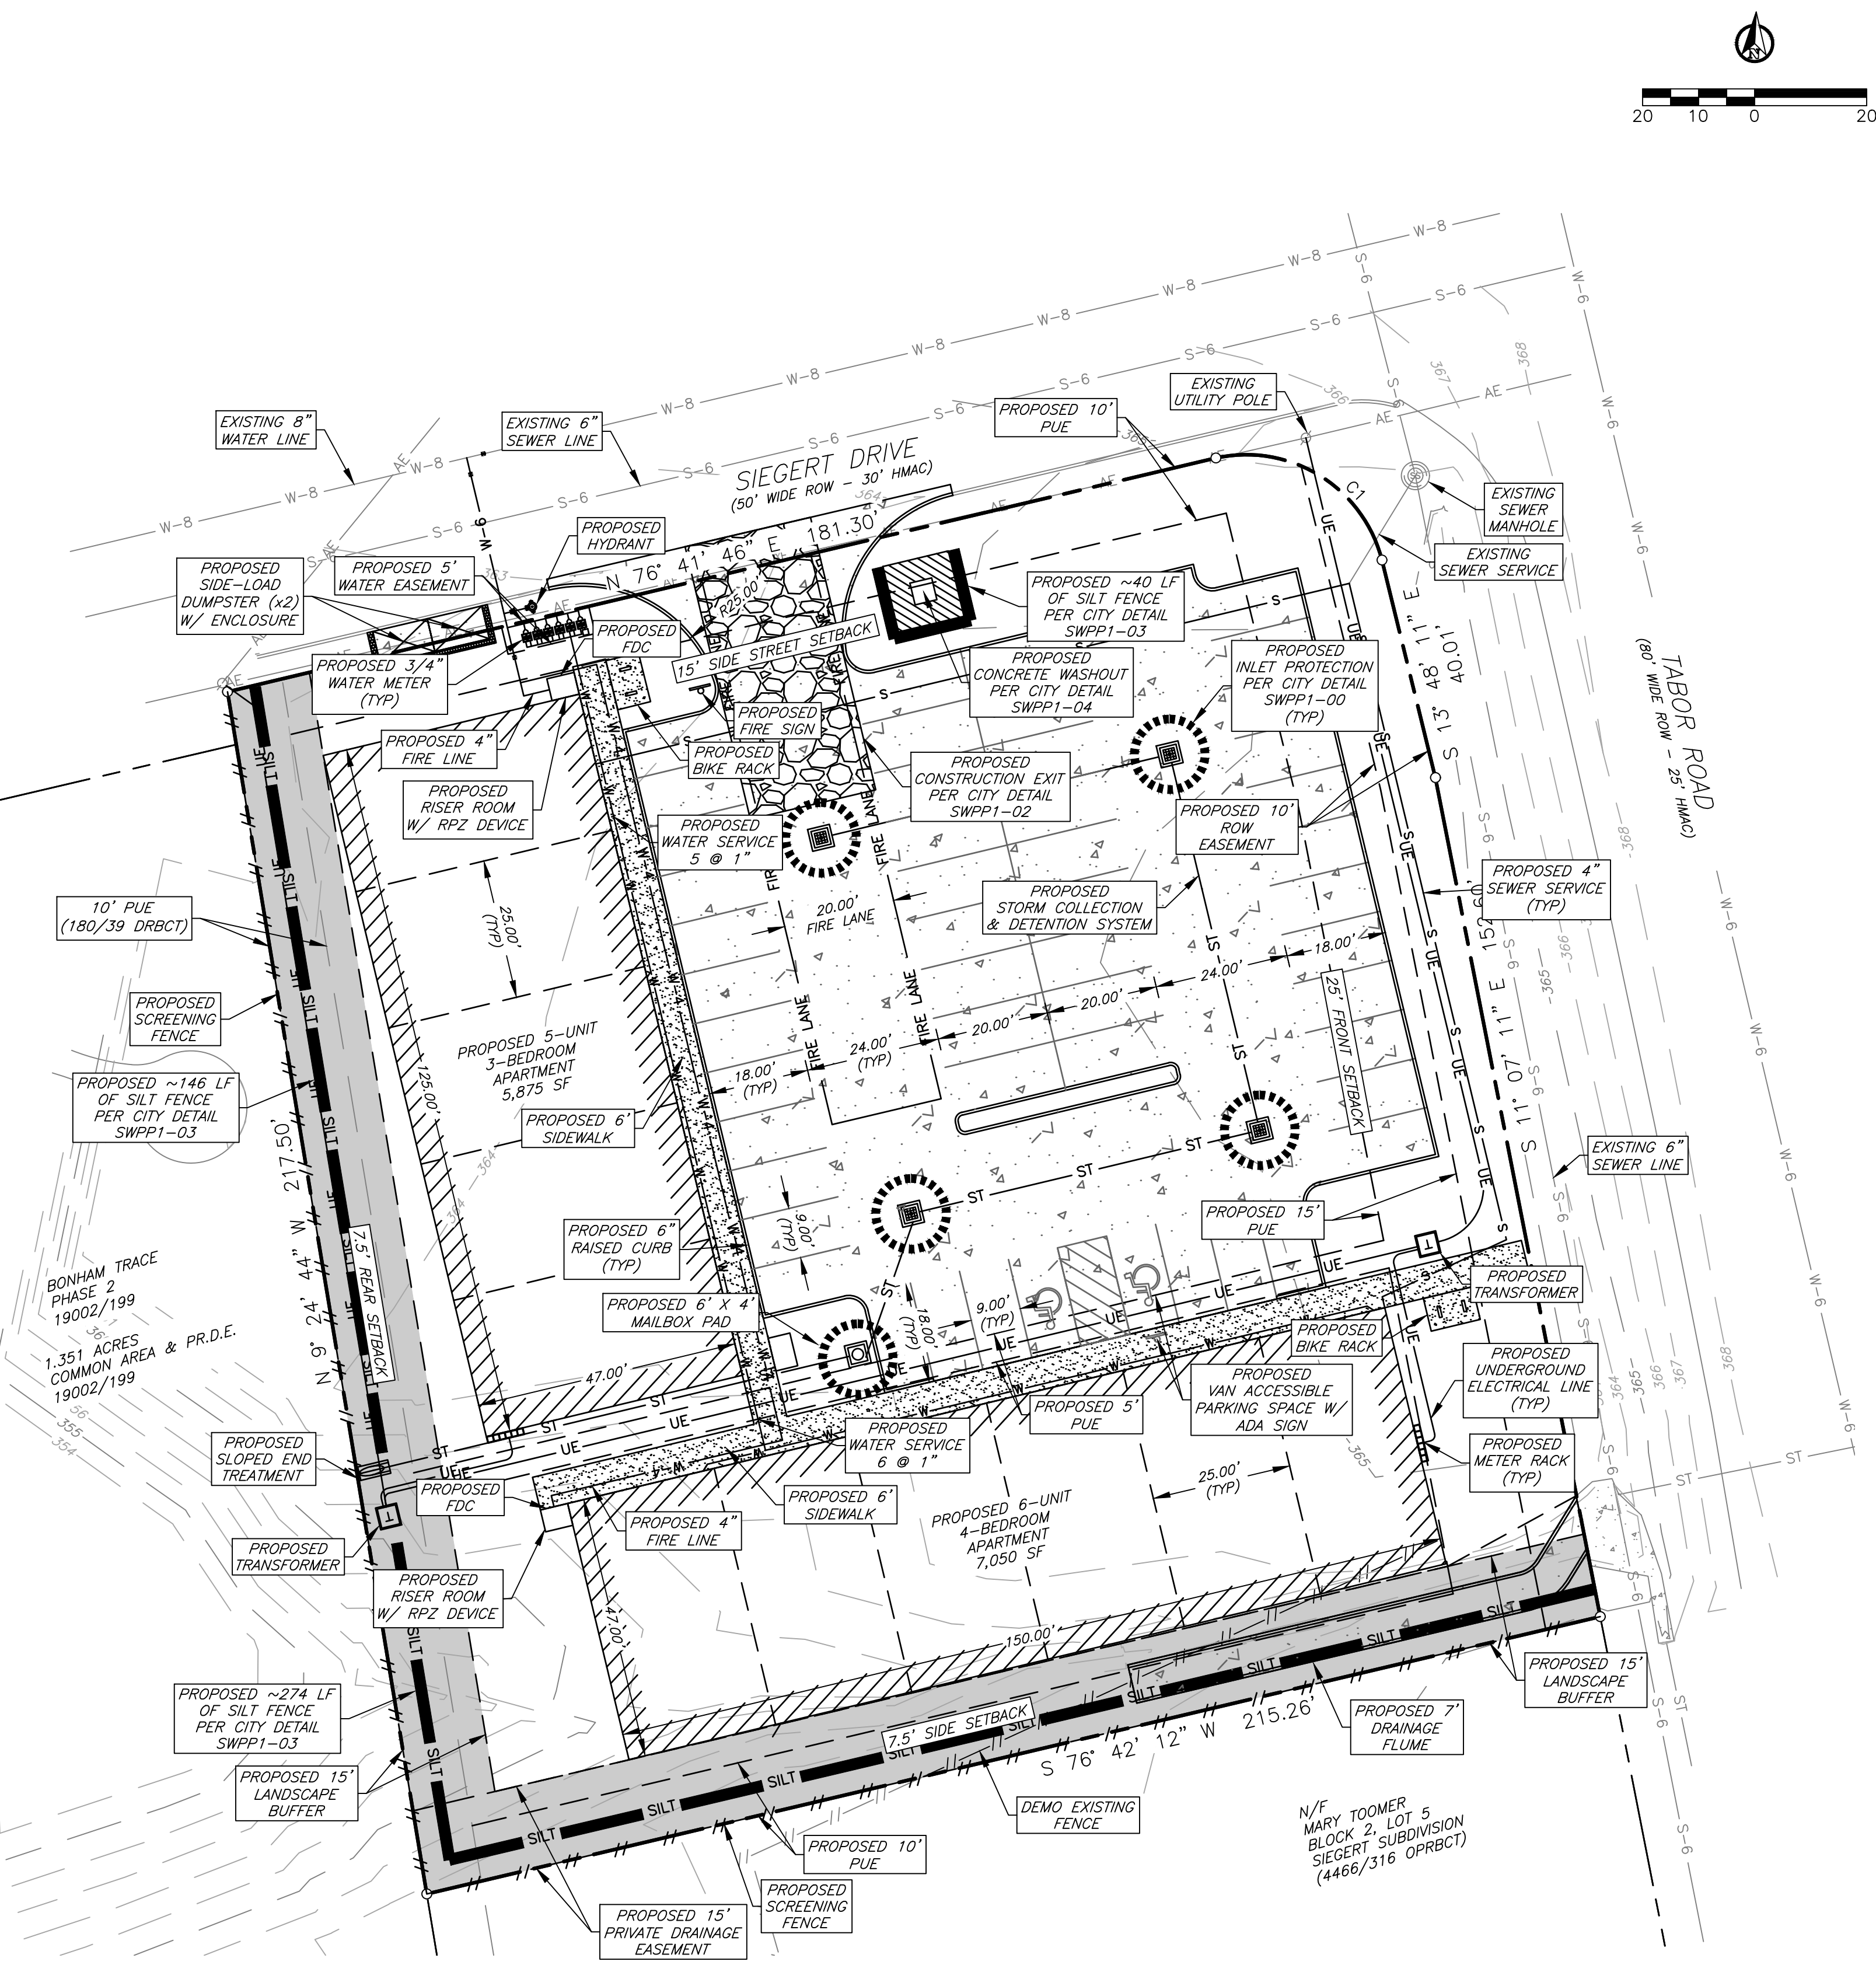
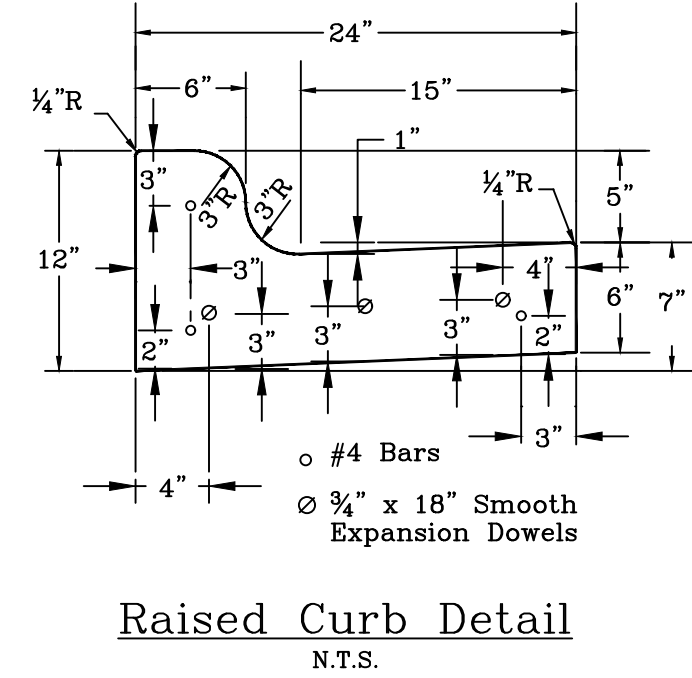
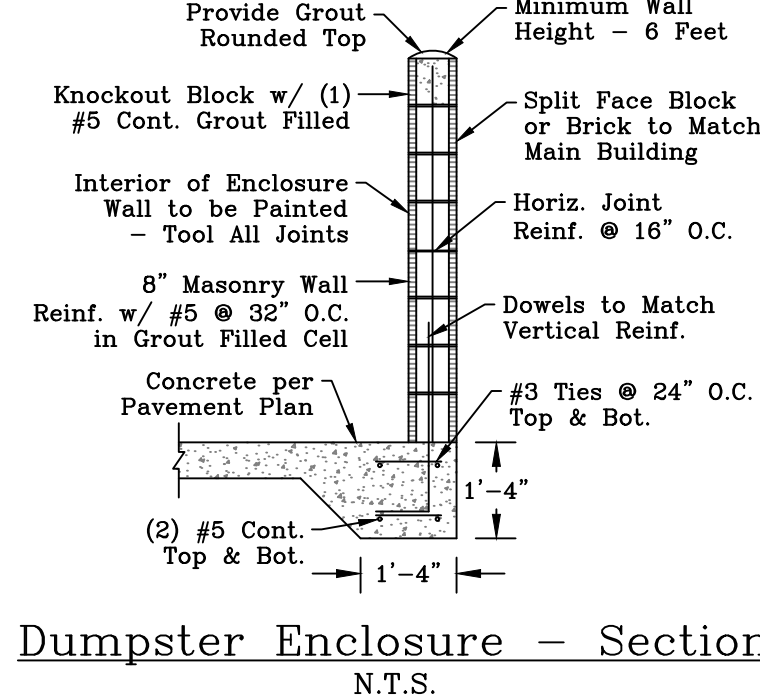
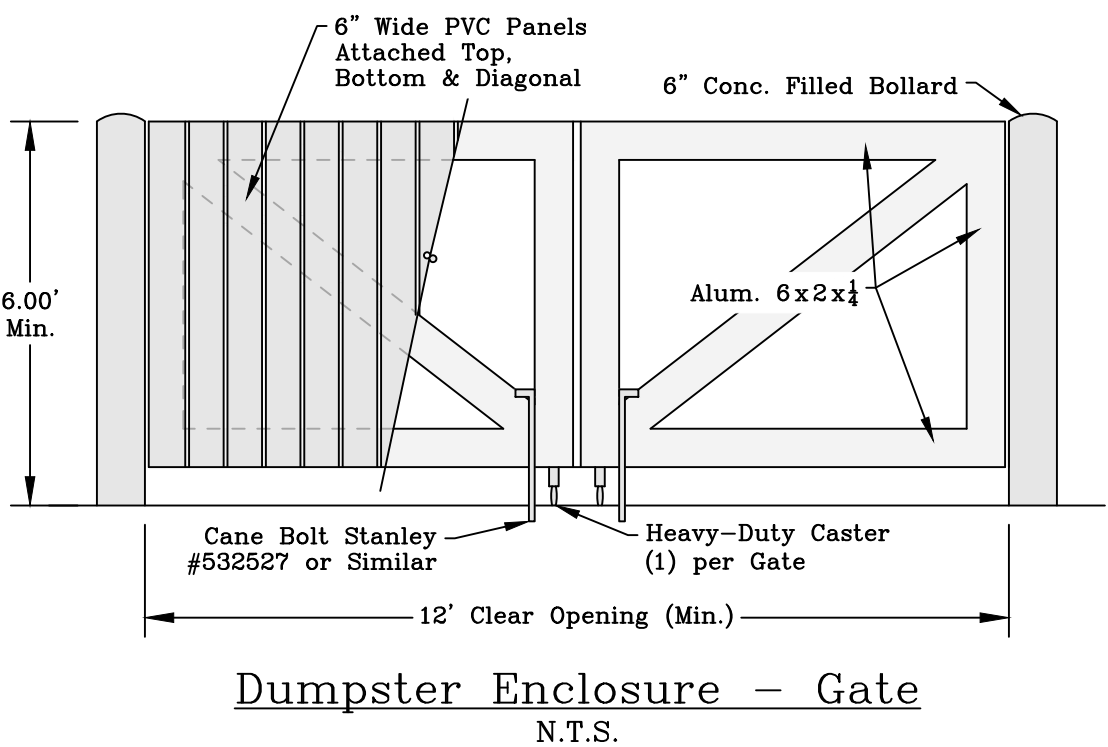


| CURVE TABLE |        |        |             |                 |              |         |
|-------------|--------|--------|-------------|-----------------|--------------|---------|
| CURVE #     | LENGTH | RADIUS | DELTA       | CHORD DIRECTION | CHORD LENGTH | TANGENT |
| C1          | 38.48' | 25.00' | 88° 11' 08" | S 58° 27' 06" E | 34.79'       | 24.22'  |

|           |                       |        |           |
|-----------|-----------------------|--------|-----------|
| Date:     | <i>September 2026</i> | Sheet: | <i>C2</i> |
| Scale:    | <i>As Noted</i>       |        |           |
| Drawn By: | <i>CB</i>             |        |           |

## Utility Notes:

1. Private water line and private sanitary sewer line construction shall be in accordance with the plumbing code. Cleanouts shall be installed per plumbing code.
2. Private water and sewer line service materials to be in accordance with plumbing code.
3. Contractor shall coordinate conduit and/or line installation for telecommunication providers for the site.
4. Depth of the existing water and sewer lines to be verified by the contractor.
5. Where electric facilities are installed, BTU has the right to install, operate, relocate, construct, reconstruct, add to, maintain, inspect, patrol, enlarge, repair, remove, and replace said facilities upon, over, under, and across the property included in the PUE, and the right of ingress and egress on the property adjacent to the PUE to access electric facilities.

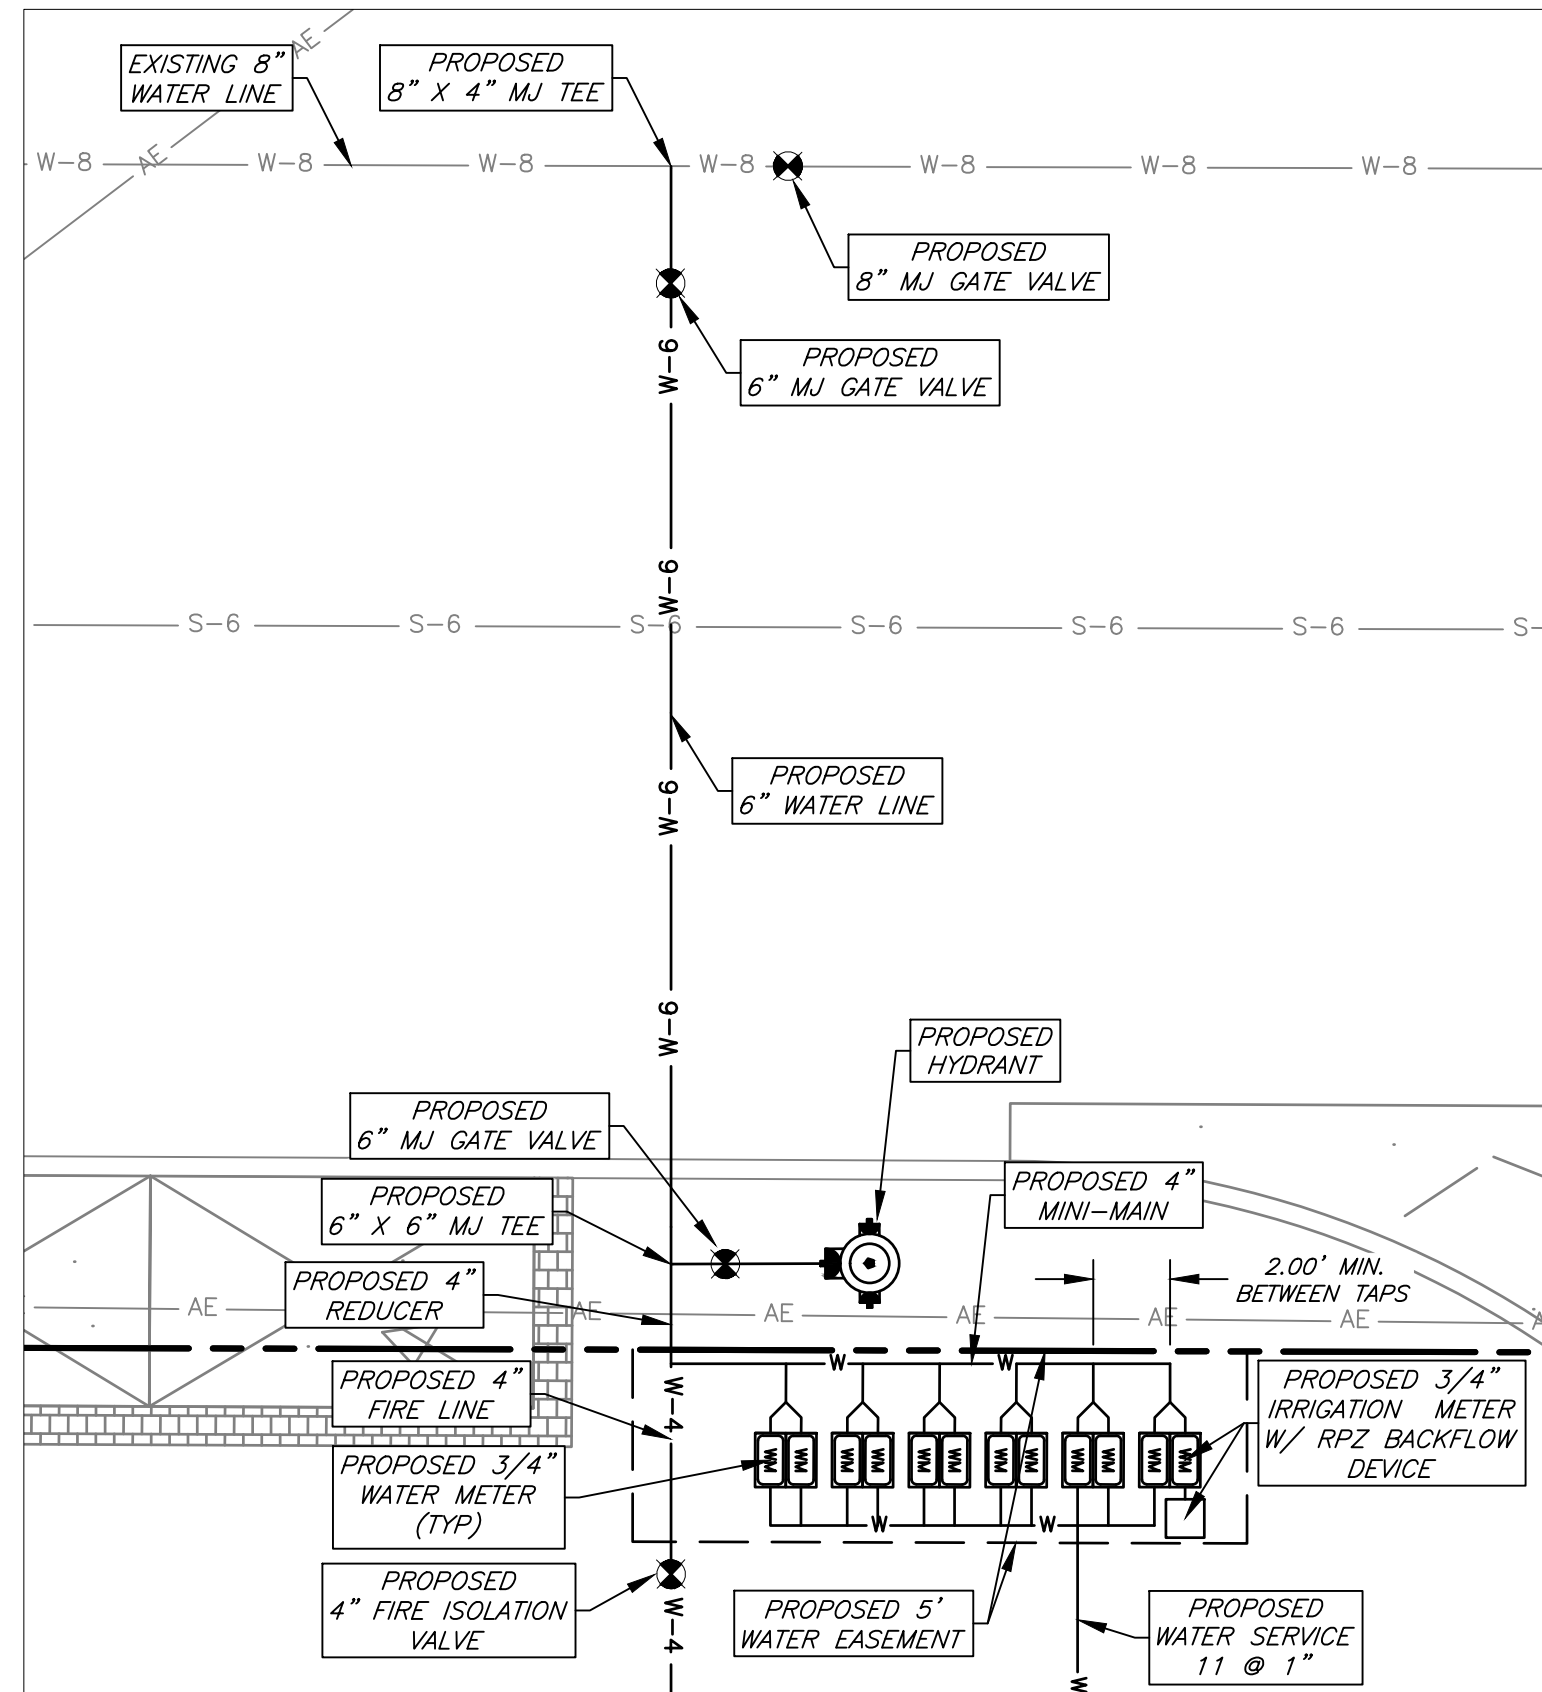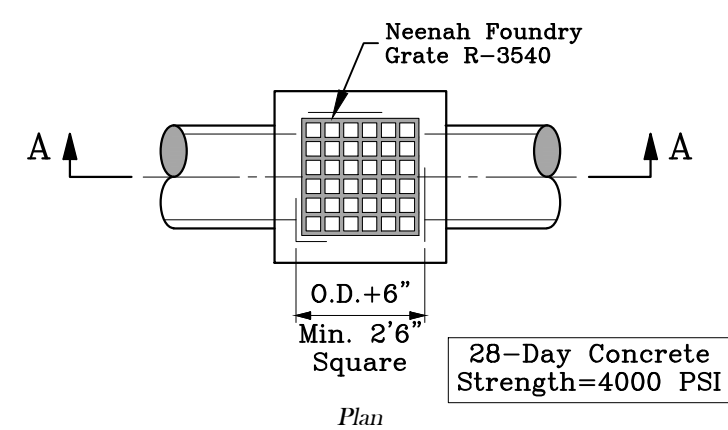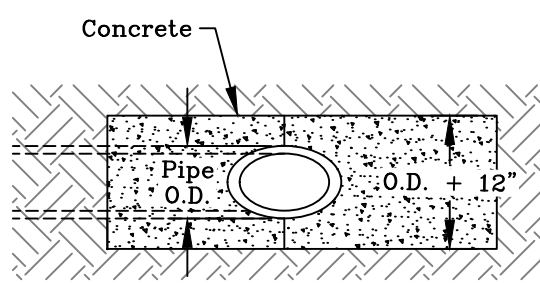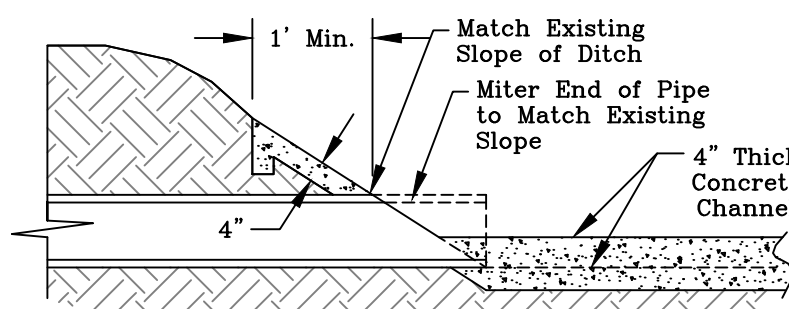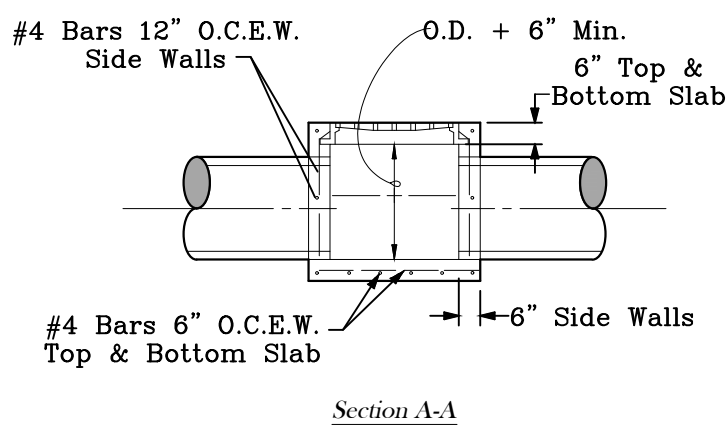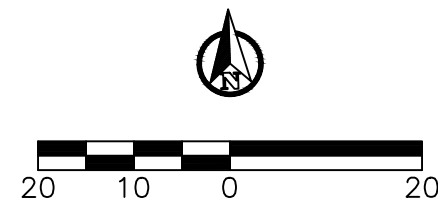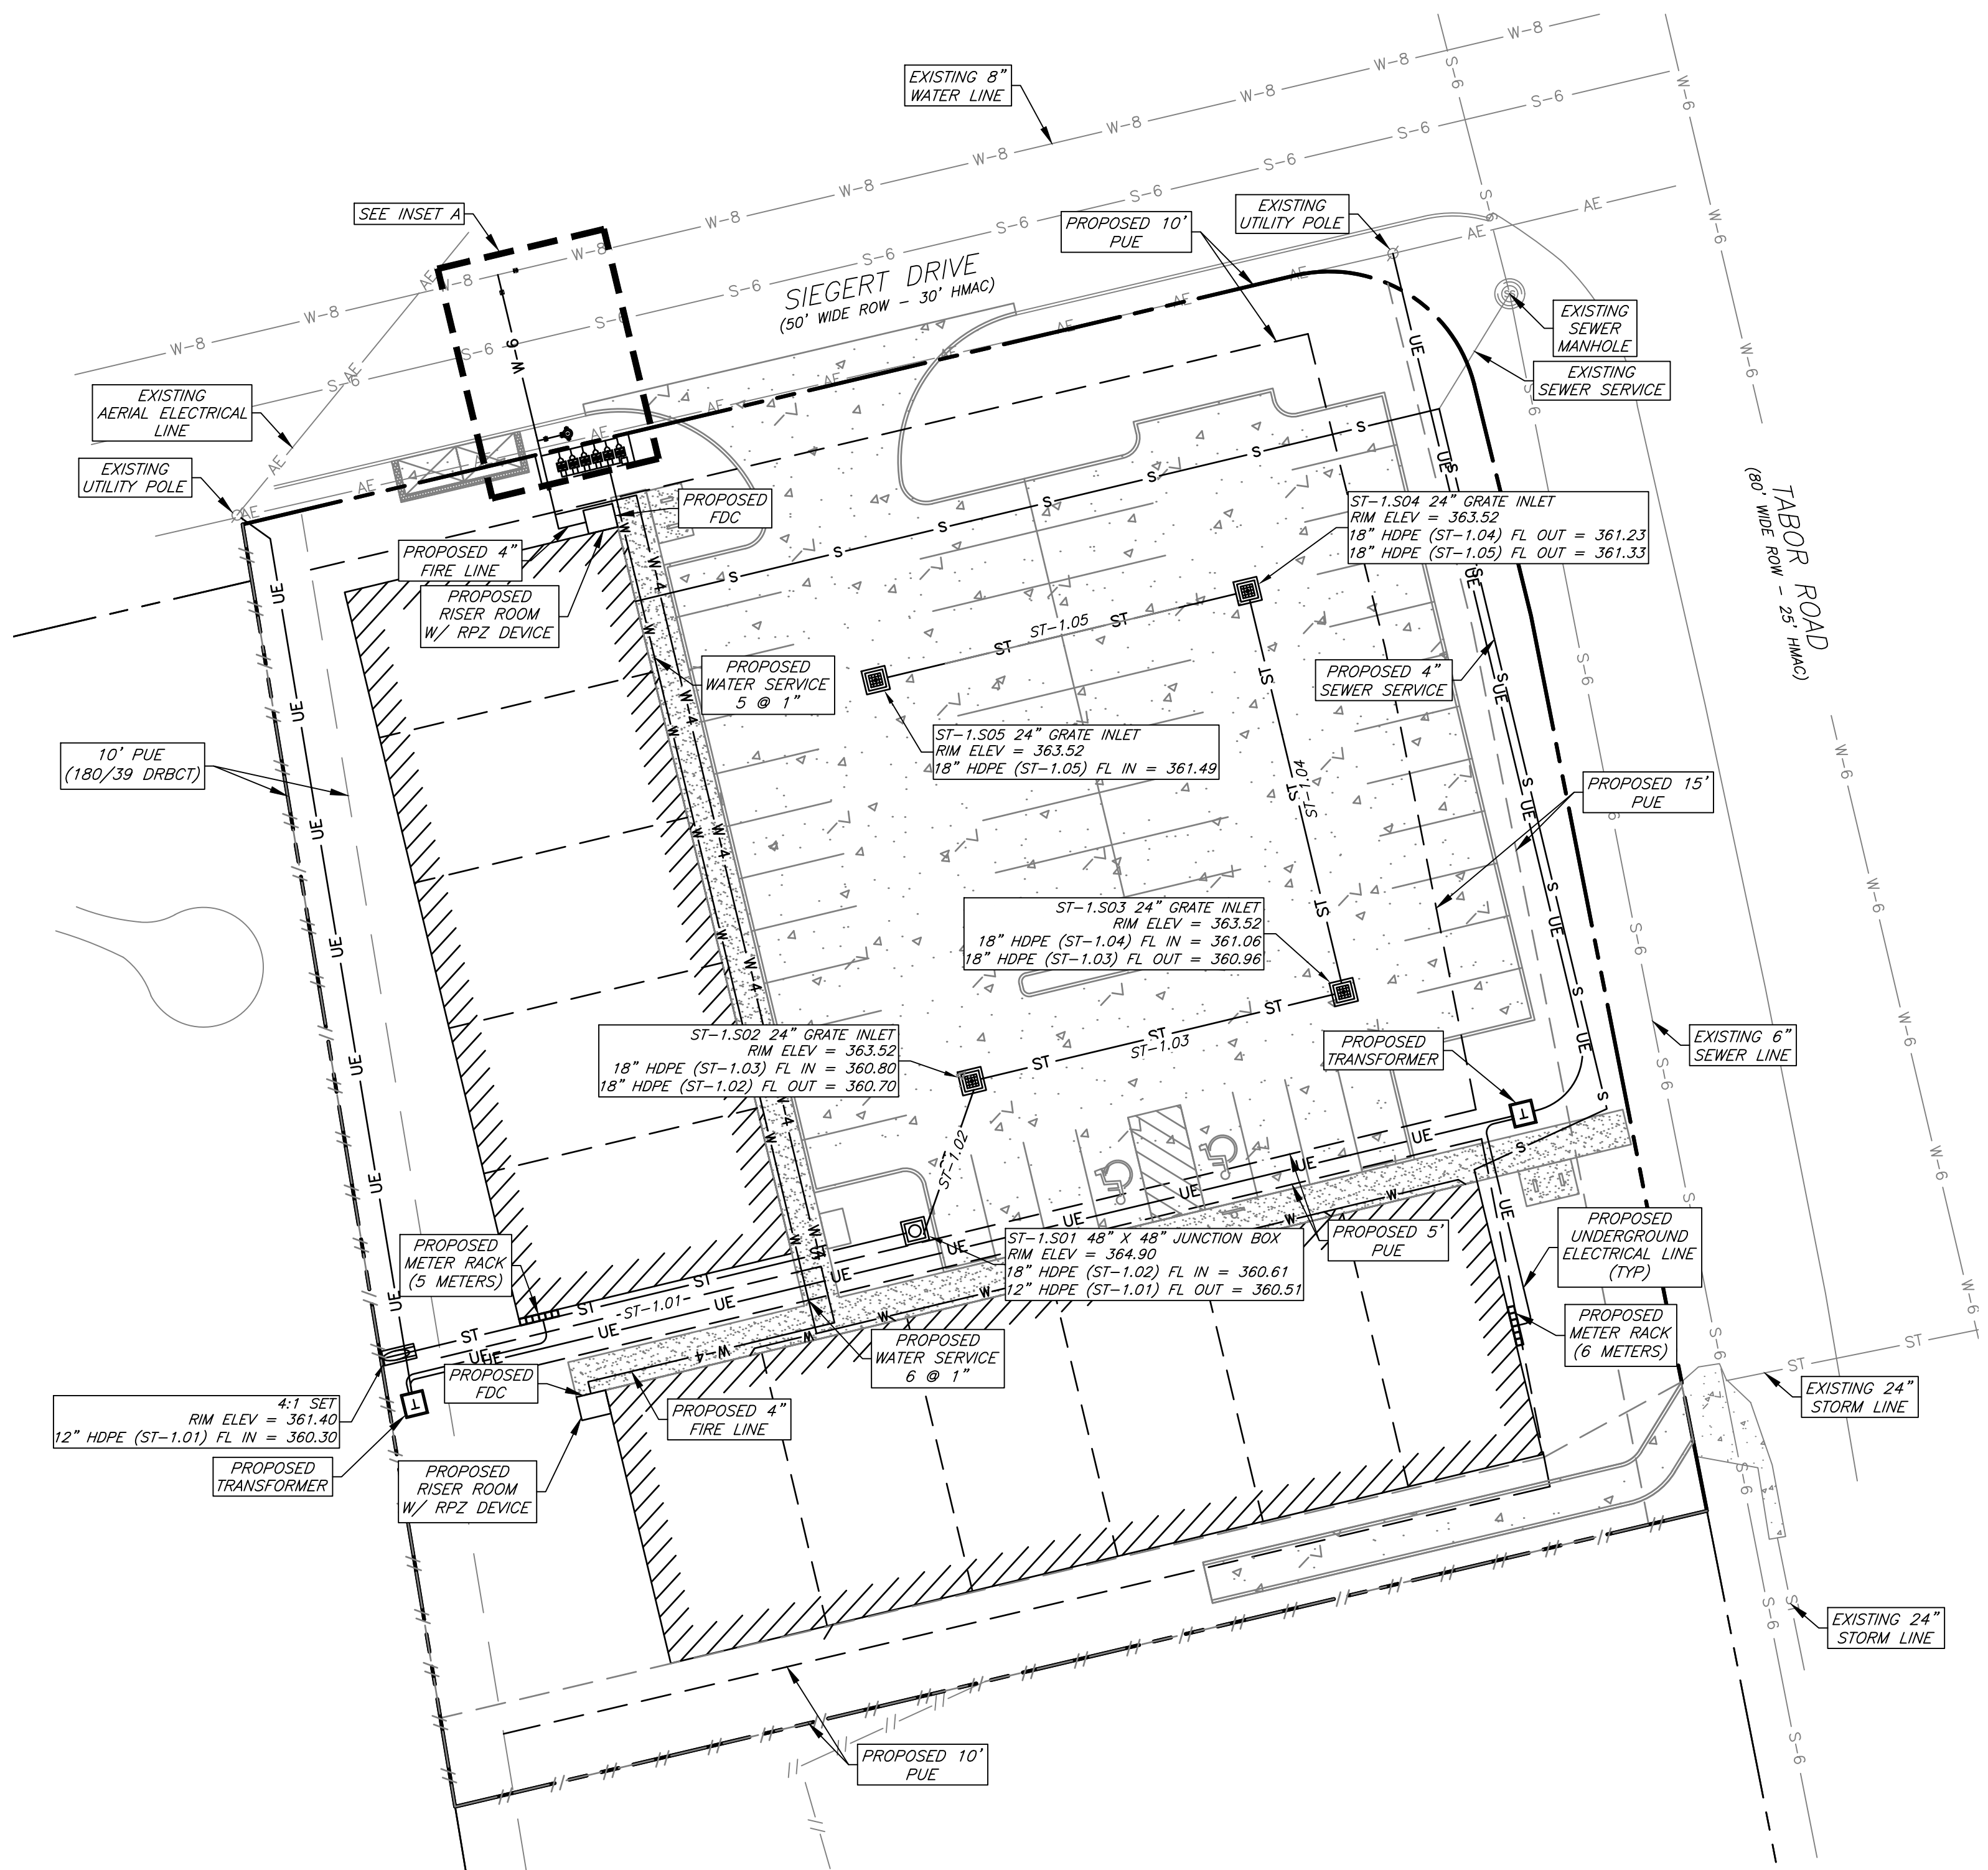Inset A  
Scale: 1"=5'Grate Inlet Detail  
N.T.S.Sloped End  
Treatment - Plan  
N.T.S.Sloped End  
Treatment - Profile  
N.T.S.Utility  
Plan

## General Notes:

1. Adjust manhole ring and covers to match final grade.
2. Refer to the Plan View for sewer service line locations.
3. Sewer line pipe material shall be 6" PVC conforming to ASTM D3034, SDR-26, Class 150, except where the cover over the sewer line is 3.5 feet or less, where the pipe material shall be 8" Ductile Iron conforming to AWWA C151, Class 350.
4. Sewer service line pipe material shall be PVC conforming to ASTM D3034, SDR-26, with gaskets.
5. Sewer service leads must have a minimum cover of 2 feet, including at drainage channels.
6. Separation of public water and wastewater mains will be consistent with the current Rules and Regulations for Public Water Systems of TCDQ. Separation of public water and wastewater mains from other underground utilities (storm, gas, etc.) shall be a minimum of 2' longitudinally.
7. Sewer services must be extended to 4 feet above natural ground at the end of the line.
8. Existing ground profile shown is based on field survey data.
9. It is the intent of these plans to comply with all City of Bryan guidelines, details & specifications.
10. See Sheet C1 - General Notes.

Preliminary Plans Only  
Not for Construction

This document is released for the purpose of interim review under the authority of Glenn Jones, P.E. 97800 on 2-Sep-26. It is not to be used for construction, bidding, or permitting purposes.

## Released for Review

| No. | Revision/Issue | Date |
|-----|----------------|------|
|     |                |      |
|     |                |      |
|     |                |      |
|     |                |      |

Firm Name and Address:



PO Box 5192 - Bryan, Texas - 77805  
979-739-0567 www.J4Engineering.com  
Firm # 9951

Project Name and Address:

**Tabor Road Apartments**  
Siebert Subdivision  
Block 2, Lot 6R - 1.051 Acres  
2816 Tabor Road  
Bryan, Brazos County, Texas

Date:

September 2026

Sheet:

Scale:

As Noted

Drawn By:

CB

C3

Paving Notes:

1.

All concrete for pavement construction shall be to the minimum depth shown on the plans and shall have a minimum 28-day compressive strength of 3,500 PSI. The maximum percentage of fly ash replacement of Portland cement shall be 20 percent by weight.

2.

Item 360 of the TxDOT "Standard Specifications for Construction and Maintenance of Highways, Street, & Bridges" shall be used as a technical specification for reinforced concrete pavement.

3.

Subgrade shall be stabilized per the "Subgrade Stabilization Table."

4.

The subgrade beneath the concrete sidewalks shall be compacted and "proof-rolled". Any weak or soft areas identified by the "proof-rolling" shall be removed and replaced.

5.

A sand leveling course under concrete pavement is NOT permitted.

6.

Joint sealant material to be Sonneborn SL-1 or approved equal.

7.

Curing compound shall be applied uniformly to the concrete after the surface finishing is complete at the rate recommended by the manufacturer. The curing compound shall meet the requirements of TxDOT Item 526.

8.

Contractor shall provide engineer with a proposed pavement expansion and contraction joint plan prior to pavement construction.

9.

See Sheet C1-General Notes.

Subgrade Stabilization Table:

PI = Plasticity Index

LL = Liquid Limit

If PI >20 and LL <35, Then Lime Stabilize Subgrade

If PI >15 and LL >36, Then Lime Stabilize Subgrade

If PI <5, Then Cement Stabilize Subgrade

Acceptable soils other than those defined by the limits above, do not require stabilization.

| PI    | % Required              | Material |
|-------|-------------------------|----------|
| <5    | 5%                      | Cement   |
| <25   | 5%                      | Lime     |
| 26-33 | 6%                      | Lime     |
| 34-40 | 7%                      | Lime     |
| >40   | Determined by ASTM C977 | Lime     |

Grading Notes:

1.

Fill material used to achieve grade in areas to receive pavement or within the street right-of-way shall be compacted to at least 98% of the maximum dry density as determined by the standard proctor test, (ASTM D698), at a moisture content from optimum moisture content to 4% above the optimum moisture content. Areas outside of the street right-of-way shall be compacted to 95% of the maximum dry density.

2.

The subgrade beneath the concrete sidewalks shall be compacted and "proof-rolled". Any weak or soft areas identified by the "proof-rolling" shall be removed and replaced.

3.

ADA ramp slopes shall not exceed 1v:12h.

4.

The topography shown is from field survey data.

5.

Structural backfill for utility or storm drain trenches is required whenever the trench is within 5' of pavement or sidewalk.

6.

The contractor shall follow the general intent of the grading plans. minor adjustments to the actual elevations shown on the grading plan may be required to match existing ground elevations and structures. the proposed contour lines shown are approximate only, the design grade spot elevations should be used for construction of the site work.

7.

Refer to pavement plan for pavement construction details and notes.

8.

The contractor shall salvage all topsoil and replace it on all disturbed areas. all parking lot islands and areas adjacent to parking and sidewalk areas shall receive 6" sandy loam topsoil prior to placement of grass sod or hydromulch.

9.

The contractor shall field verify and locate all existing utilities on site prior to demolition.

10.

The contractor shall install all erosion and sediment control devices, as shown, prior to commencing demolition work.

11.

Should any existing utilities not shown or shown incorrectly on this plan be found on site, the contractor shall contact the design engineer immediately to discuss any possible conflicts before proceeding with any work in that area.

Typical Sidewalk

N.T.S.

3,500 PSI Concrete

4" Thick Min.

Per Plans

2% Max Slope

Edge of Bldg.

Varies

Natural Ground or Pavement

#3 Bars @ 12" O.C.E.W

Note:

Install expansion joints at 40' (max) longitudinal spacing and install contraction joints spaced at a maximum interval equal to the sidewalks width.

All Sidewalks shall have a light broom finish.

Legend

Existing HMAc Pavement

Existing Concrete Sidewalk

Existing Concrete PVMt

Proposed HMAc Pavement

Proposed 4" Concrete Sidewalk

Proposed 6" Concrete Pavement

Typical Concrete Paving Section

N.T.S.

Steel Reinforcing Bars

Concrete Pavement

Per Plan

6" Stabilized Subgrade to Extend 1' outside the Edge of PvmT

1. 6" Pavement - use #4 rebar @ 18" O.C.E.W.

Contraction Joint Detail

N.T.S.

3/4" Seal w/ 1/2" Joint Material

1" Deep and sealed with Sonoborn SL-1 or approved equal

3/4"-1/2" Dia. Smooth Dowel Bar 16" in Length installed 12" O.C.

Full Depth

Non-Extruding Joint Filler

Metal or plastic cap, inside diameter to be 1/16" greater than diameter of dowel bar

Pavement Beam Detail

N.T.S.

Top Of Curb

Proposed Concrete PvmT.

Varies

Stirrups #4 Bars @ 18" O.C.

#5 Bars (TYP)

6" Min

6"

12"

6"

Undisturbed Natural Ground

Expansion Joint Detail

N.T.S.

3/4" Seal w/ 1/2" Joint Material

1" Deep and sealed with Sonoborn SL-1 or approved equal

3/4"-1/2" Dia. Smooth Dowel Bar 16" in Length installed 12" O.C.

Full Depth

Non-Extruding Joint Filler

Metal or plastic cap, inside diameter to be 1/16" greater than diameter of dowel bar

ADA Parking Sign

N.T.S.

0.080" Alum. Sign Blank (Typ.)

Green Lettering, Arrow & Border

White Symbols on Blue Square

White Background

Green Lettering on White Background

2" Galv. Steel Pipe

6" (MAX)

60" (MIN)

48" (MIN)

36"

12"

3,000 PSI Concrete Base to be Centered on ADA Parking Space as Per Layout Plan

ADA Pavement Markings

N.T.S.

4" Wide Stripe Painted White 2' O.C. for Access Aisle

45°

4" Wide Stripe Painted White for Stalls (TYP)

ADA symbol painted blue (TYP)

9' Van Accessible

9'

9'

NO PARKING

Inset A

Scale: 1"=10'

PROJECT BENCHMARK:  
CHISELED SQUAR EIN  
BACK OF CURB  
N: 10242497.98, E: 3541059.35,  
ELEV: 362.74'

SAW-CUT AND MATCH TO EXISTING GRADE OF HMAc

DEMO EXISTING CURB & GUTTER THROUGHOUT PROPOSED DRIVEWAY

Legend

Existing HMAc Pavement

Existing Concrete Sidewalk

Existing Concrete PVMt

Proposed HMAc Pavement

Proposed 4" Concrete Sidewalk

Proposed 6" Concrete Pavement

Typical Sidewalk

N.T.S.

3,500 PSI Concrete

4" Thick Min.

Per Plans

2% Max Slope

Edge of Bldg.

Varies

Natural Ground or Pavement

#3 Bars @ 12" O.C.E.W

Note:

Install expansion joints at 40' (max) longitudinal spacing and install contraction joints spaced at a maximum interval equal to the sidewalks width.

All Sidewalks shall have a light broom finish.

Legend

Existing HMAc Pavement

Existing Concrete Sidewalk

Existing Concrete PVMt

Proposed HMAc Pavement

Proposed 4" Concrete Sidewalk

Proposed 6" Concrete Pavement

Typical Concrete Paving Section

N.T.S.

Steel Reinforcing Bars

Concrete Pavement

Per Plan

6" Stabilized Subgrade to Extend 1' outside the Edge of PvmT

1. 6" Pavement - use #4 rebar @ 18" O.C.E.W.

Contraction Joint Detail

N.T.S.

3/4" Seal w/ 1/2" Joint Material

1" Deep and sealed with Sonoborn SL-1 or approved equal

3/4"-1/2" Dia. Smooth Dowel Bar 16" in Length installed 12" O.C.

Full Depth

Non-Extruding Joint Filler

Metal or plastic cap, inside diameter to be 1/16" greater than diameter of dowel bar

Pavement Beam Detail

N.T.S.

Top Of Curb

Proposed Concrete PvmT.

Varies

Stirrups #4 Bars @ 18" O.C.

#5 Bars (TYP)

6" Min

6"

12"

6"

Undisturbed Natural Ground

Expansion Joint Detail

N.T.S.

3/4" Seal w/ 1/2" Joint Material

1" Deep and sealed with Sonoborn SL-1 or approved equal

3/4"-1/2" Dia. Smooth Dowel Bar 16" in Length installed 12" O.C.

Full Depth

Non-Extruding Joint Filler

Metal or plastic cap, inside diameter to be 1/16" greater than diameter of dowel bar

ADA Parking Sign

N.T.S.

0.080" Alum. Sign Blank (Typ.)

Green Lettering, Arrow & Border

White Symbols on Blue Square

White Background

Green Lettering on White Background

2" Galv. Steel Pipe

6" (MAX)

60" (MIN)

48" (MIN)

36"

12"

3,000 PSI Concrete Base to be Centered on ADA Parking Space as Per Layout Plan

ADA Pavement Markings

N.T.S.

4" Wide Stripe Painted White 2' O.C. for Access Aisle

45°

4" Wide Stripe Painted White for Stalls (TYP)

ADA symbol painted blue (TYP)

9' Van Accessible

9'

9'

NO PARKING

Inset A

Scale: 1"=10'

Cut/Fill Report

Volume Summary

| Name        | Depth (ft) | 2d Area (sq-ft) | Cut (yards) | Fill (yards) | Net (yards)  |
|-------------|------------|-----------------|-------------|--------------|--------------|
| Cut/Fill    | N/A        | 45458.00        | 482.00      | 980.00       | 498.00<fill> |
| Foundations | 2.00       | 12925.00        | 957.41      | -            | -957.41<cut> |
| Pavment     | 0.33-0.67  | 17945.00        | 320.63      | -            | -320.63<cut> |
| Total       |            |                 |             |              | -780.04<cut> |

PVMT & Grading Plan

General Notes:

1.

The topography shown is from field survey data.

2.

Refer to Final Plat for all lot dimensions and bearings.

3.

All utilities shown are taken from the best available information based on construction utility documents obtained by J4 Engineering from City and Independent agencies and/or above ground field evidence. Shown positions may not represent as-built conditions.

4.

The contractor shall be responsible for verifying the exact location of all existing underground utilities, whether shown on these plans or not. Notification of the utility companies 48 hours in advance of construction is required.

5.

Contractor is responsible for field verifying existing and proposed grades prior to any construction and reporting any inconsistencies to the Owner.

6.

All construction shall be in accordance with the current BCS Standard Specifications, Details, and Design Guidelines for Water, Sewer, Streets, and Drainage, unless otherwise noted.

7.

The contractor shall be responsible for the containment and proper disposal of all liquid and solid waste associated with the project and shall use all means necessary to prevent the occurrence of wind blown litter.

8.

It is the intent of these plans to comply with all BCS guidelines, specifications & details.

9.

See Sheet C1 - General Notes

TC - Top of Curb

FL - Flow Line

TW - Top of Sidewalk

TP - Top of PVMt

EG - Existing Grade

PG - Proposed Grade

Preliminary Plans Only

Not for Construction

This document is released for the purpose of interim review under the authority of Glenn Jones, P.E. 97800 on 2-Sep-26. It is not to be used for construction, bidding, or permitting purposes.

Released for Review

| No. | Revision/Issue | Date |
|-----|----------------|------|
|     |                |      |
|     |                |      |
|     |                |      |
|     |                |      |

Firm Name and Address:

J4 Engineering

PO Box 5192 - Bryan, Texas - 77805

979-739-0567 - www.J4Engineering.com

Firm # 9951

Project Name and Address:

Tabor Road Apartments

Siebert Subdivision

Block 2, Lot 6R - 1.051 Acres

2816 Tabor Road

Bryan, Brazos County, Texas

Date:

September 2026

Sheet:

C4

Scale:

As Noted

Drawn By:

CB

J:\2026\28-016 Tabor Road Townhomes-Site Plan.dwg

J4E Project #28-016

9/2/2026


J4 Engineering

Landscape Notes:

- All trees shall be provided as container grown trees.
- All landscaping plant material shall be guaranteed for a period of thirty days from the date of installation by contractor. After thirty days, the owner will be responsible for maintenance of all landscaping.
- The property owner is responsible for regular weeding, mowing, fertilizing, and other maintenance of all plantings following acceptance from Contractor. The required landscaping must be maintained in a healthy, growing condition at all times.
- Plant material shown here is represented at its mature size. Plantings to be installed will be significantly smaller than those shown and should not be expected to reach maturity for several years dependant on growing conditions.
- Contractor is to seed all disturbed areas left unpaved and guarantee coverage of vegetation until establishment of grass. Grass type shall be Bermuda grass or Rye/Bermuda mixture.
- All water meters, hydrants, valves, manholes, and cleanouts, on or adjacent to the property, must remain accessible during construction and upon the completion of necessary grading and landscaping.
- "Cal." indicates caliper at 12" above the ground. Multi-trunk trees' caliper is measured with the single, largest cane.
- Existing Trees used for landscape credit must have a minimum trunk diameter of four and one-half inches or larger and be in a healthy physical state. Should existing trees used for landscape credit die, they shall be replaced with new trees according to the requirements of section 62-429(a)(2)c. Existing trees with a trunk diameter less than four and one-half inches may be given the same landscape credit as that given newly planted trees with similar characteristics.
- Replacement of dead landscaping shall occur within 90 days of notification. Replacement material must be of similar character as the dead landscaping. Failure to replace dead landscaping as required by the zoning official or his/her designee, shall constitute a violation of this article subject to the general penalty provisions of City Code section 1-14.
- To ensure the growth of trees in end islands, a minimum 24-inch soil depth and 250 cubic feet of appropriate planting medium is required per tree, with topsoil mounded to a center height.


Landscape Analysis:


|                               |   |        |    |
|-------------------------------|---|--------|----|
| Construction Activities:      |   |        |    |
| Parking & Pavement            | = | 17,540 | SF |
| Buildings                     | = | 12,925 | SF |
| Net Total                     | = | 30,465 | SF |
| Requirements:                 |   |        |    |
| Building, Parking, & Pavement | = | 4,570  | SF |
| 30,465 SF @ 15%               | = | 4,570  | SF |
| Provided:                     |   |        |    |
| Canopy Trees                  | = | 2,400  | SF |
| 12 @ 200 SF                   | = | 2,400  | SF |
| Non-Canopy Trees              | = | 2,200  | SF |
| 22 @ 100 SF                   | = | 2,200  | SF |
| Net Total                     | = | 4,600  | SF |

| Symbol                                                                            | Qty. | Common Name  | Botanical Name       | Size     |
|-----------------------------------------------------------------------------------|------|--------------|----------------------|----------|
|  | 12   | Cedar Elm    | Ulmus crassifolia    | >3" cal. |
|  | 24   | Crepe Myrtle | Lagerstroemia indica | >3" cal. |

Landscape Buffer Analysis:

|                                                                                              |   |        |    |
|----------------------------------------------------------------------------------------------|---|--------|----|
| 15' Reduced Landscape Buffer:<br>(The full 25' will be provided in the reduced buffer area.) |   |        |    |
| 25' Buffer Area                                                                              | = | 10,180 | SF |
| Net Total                                                                                    | = | 10,180 | SF |
| Requirements:                                                                                |   |        |    |
| 10,180 SF @ 15%                                                                              | = | 1,527  | SF |
| Net Total                                                                                    | = | 1,527  | SF |
| Provided:                                                                                    |   |        |    |
| Canopy Trees                                                                                 | = | 800    | SF |
| 4 @ 200 SF                                                                                   | = | 800    | SF |
| Non-Canopy Trees                                                                             | = | 1,500  | SF |
| 15 @ 100 SF                                                                                  | = | 1,500  | SF |
| Net Total                                                                                    | = | 2,300  | SF |


| Symbol                                                                              | Qty. | Common Name  | Botanical Name       | Size     |
|-------------------------------------------------------------------------------------|------|--------------|----------------------|----------|
|  | 4    | Cedar Elm    | Ulmus crassifolia    | >3" cal. |
|  | 15   | Crepe Myrtle | Lagerstroemia indica | >3" cal. |

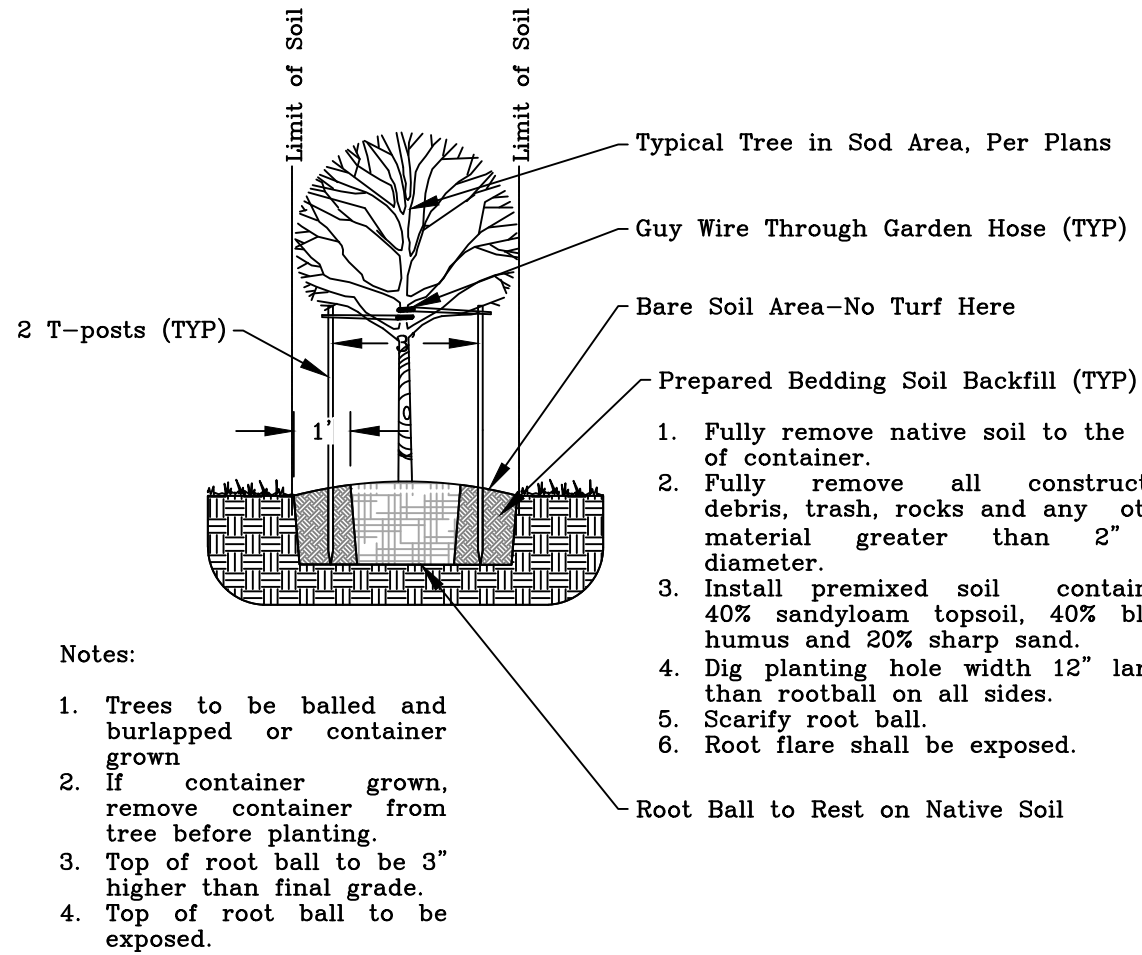


Tree Staking & Planting  
N.T.S

Notes:

- All lumber shall be weather resistant cedar or pressure treated.
- Pickets are to be 1x6, dog-eared, fastened w/ 1 1/2" galv. screws, min 2 per connection.
- Pickets shall be installed in a staggered board design where adjacent pickets are on opposite sides of the fence.
- Rails are to be 2x4 fastened w/ 3" galv. screws, min. 3 per connection.
- Post are to be 4x4, placed 6' O.C., & set in 3,000 PSI concrete.

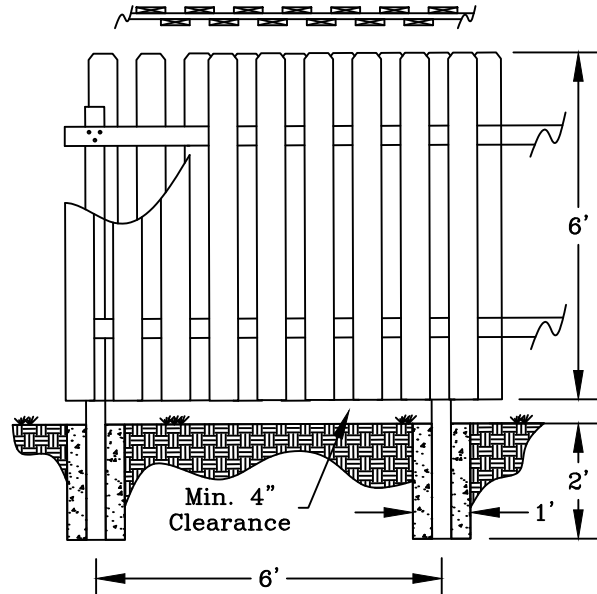

Alternating Plank  
Screening Fence Detail  
N.T.S

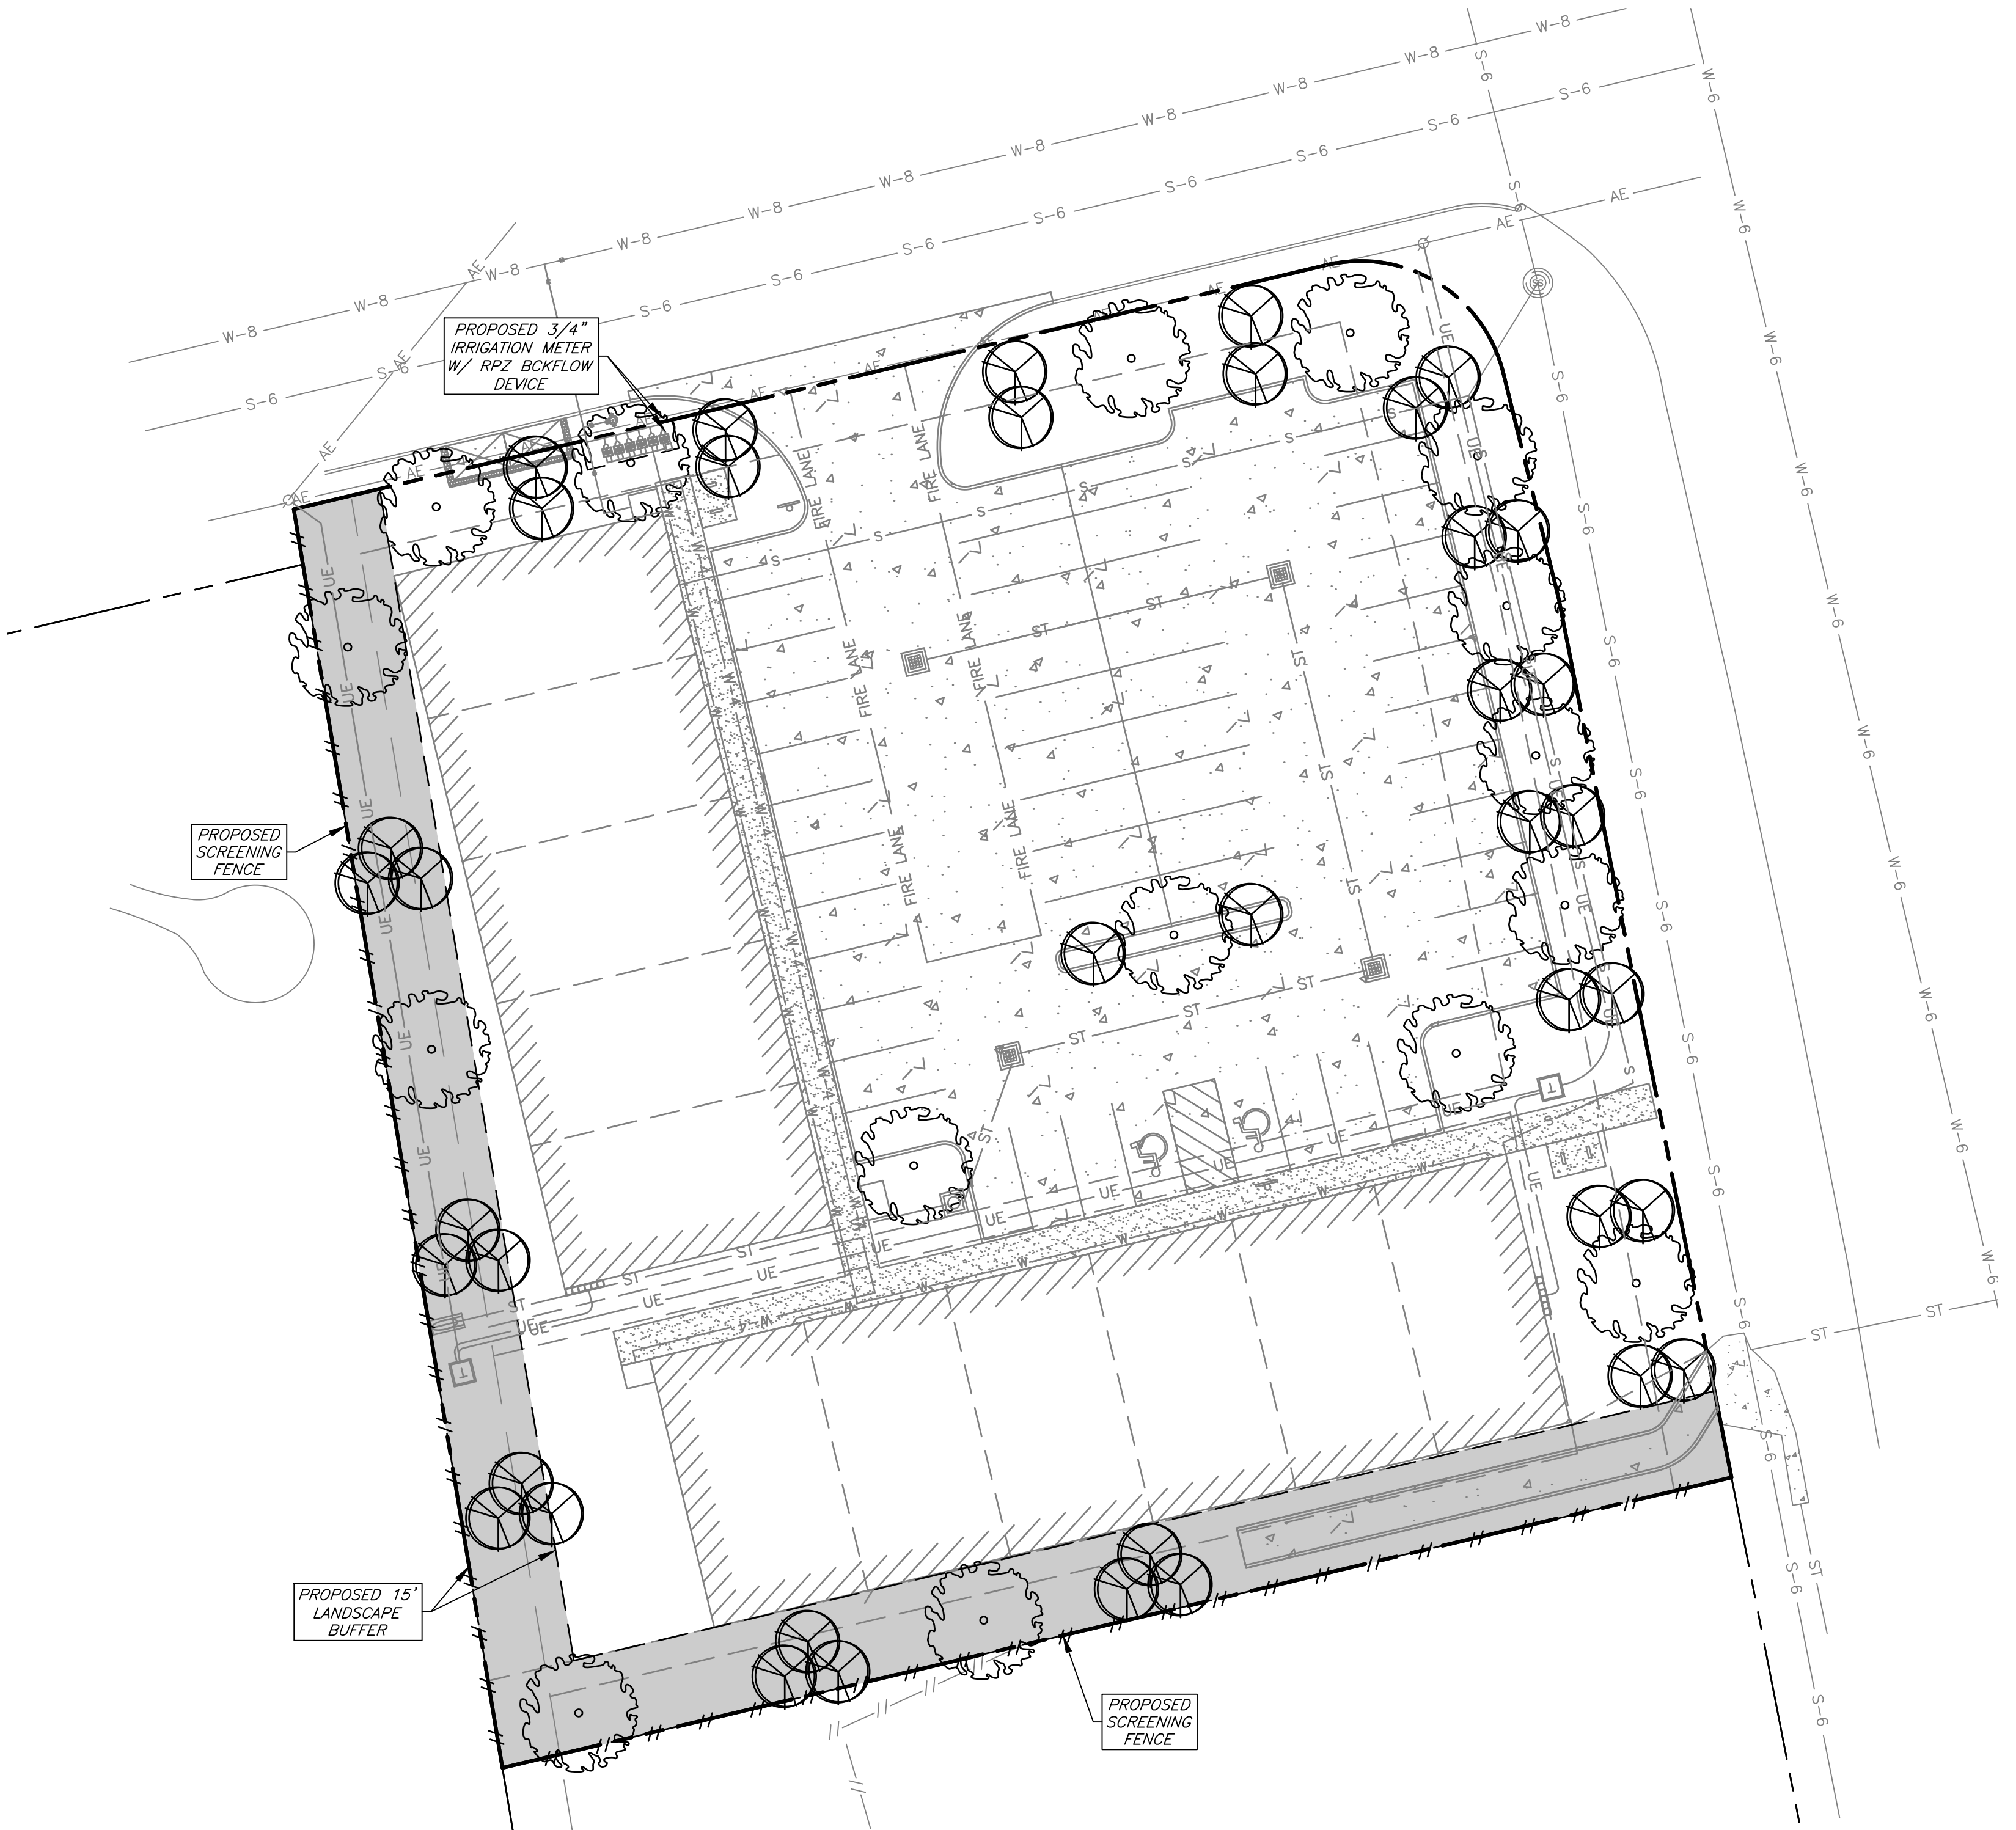

# Landscape Plan

General Notes:

- An irrigation system to service all new plantings will be installed by a certified installer prior to a certificate of occupancy being issued.
- Irrigation system must be protected by either a pressure vacuum breaker, reduced pressure principle back flow device, or a double-check back flow device and installed as per city ordinance 2394.
- All backflow devices must be installed and tested upon installation as per city ordinance 2394.
- 100% coverage of groundcover, decorative paving, decorative rock(not loose) or a perennial grass is required in parking lot islands, swales and drainage areas, the parking lot setback, rights-of-way, and adjacent property disturbed during construction.
- It is the intent of these plans to comply with all City of Bryan guidelines, specifications, & details.
- See Sheet C1-General Notes.

| No. | Revision/Issue | Date |
|-----|----------------|------|
|-----|----------------|------|


Firm Name and Address:



Project Name and Address:

**Tabor Road Apartments**  
Siebert Subdivision  
Block 2, Lot 6R - 1.051 Acres  
2816 Tabor Road  
Bryan, Brazos County, Texas

|           |                |        |
|-----------|----------------|--------|
| Date:     | September 2026 | Sheet: |
| Scale:    | As Noted       | L1     |
| Drawn By: | CB             |        |

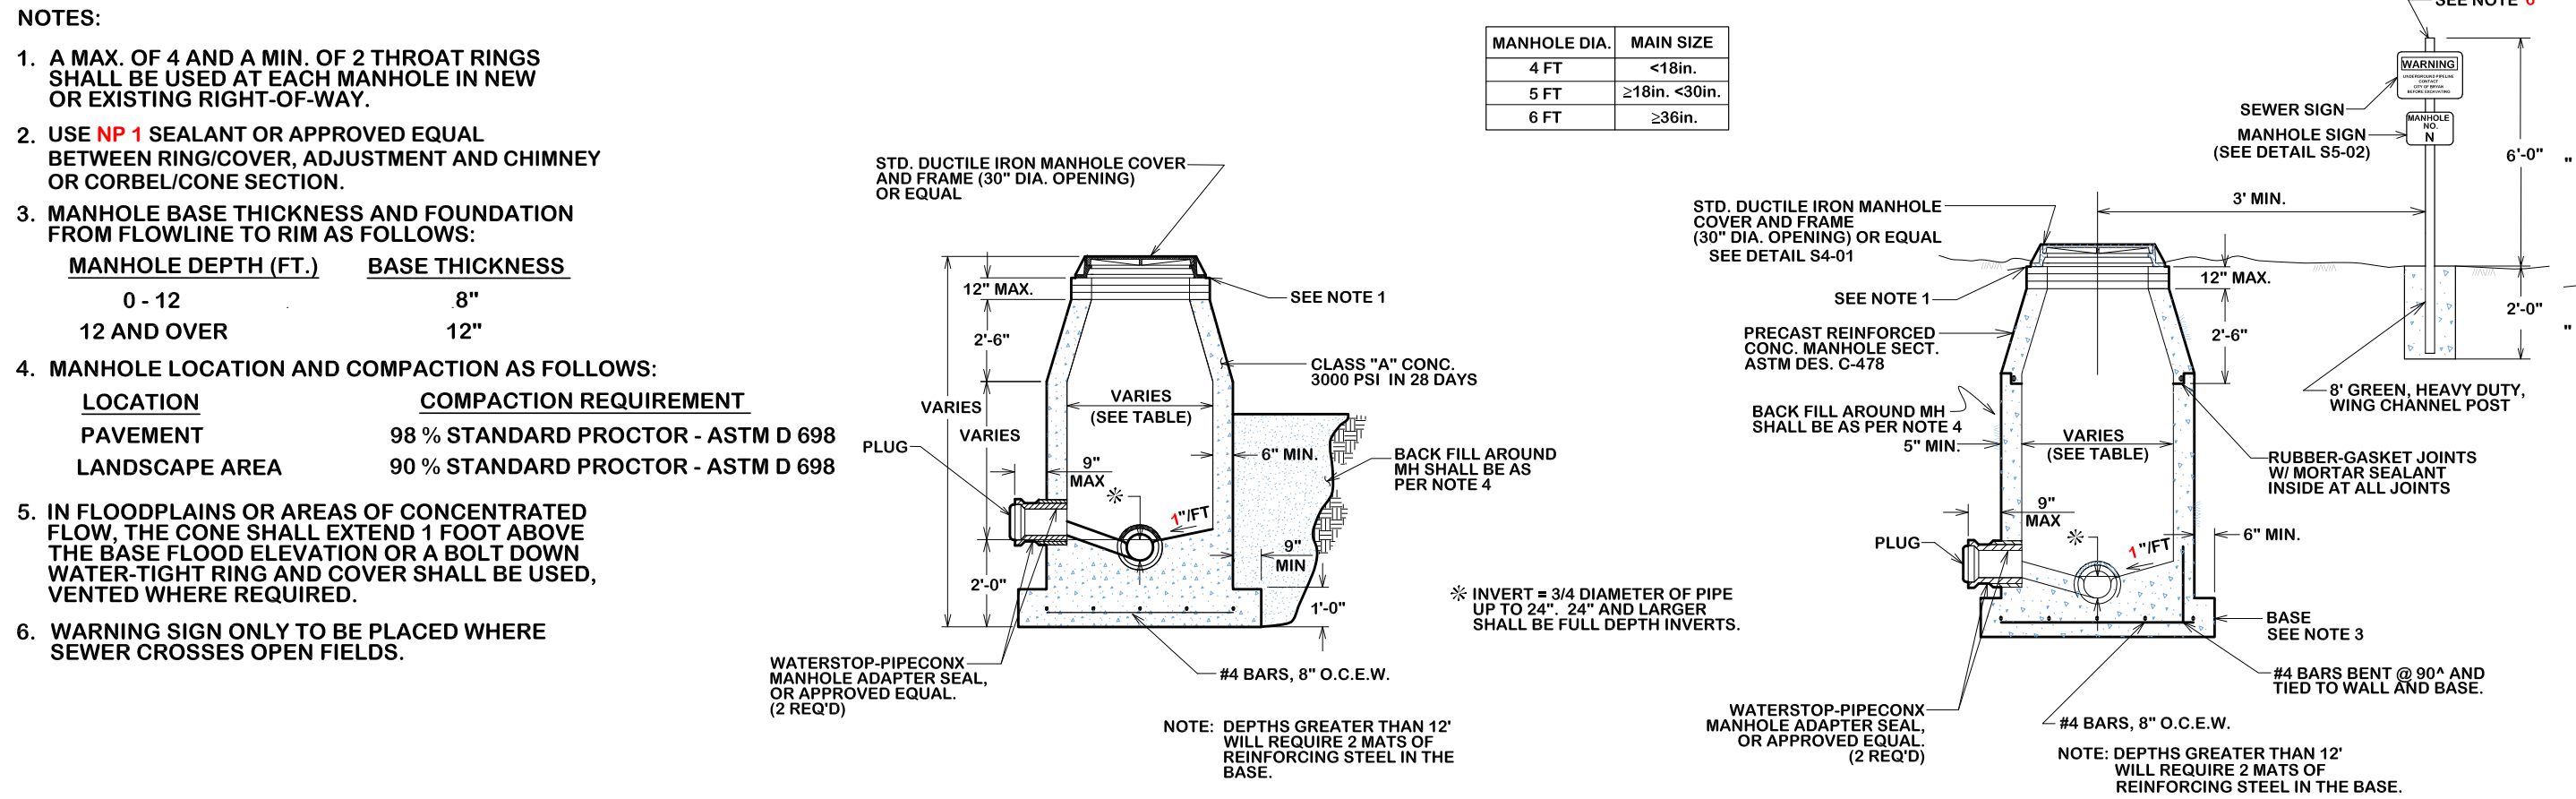


CAST IN PLACE MANHOLE

PRE-CAST MANHOLE


STANDARD MANHOLE

S1-00

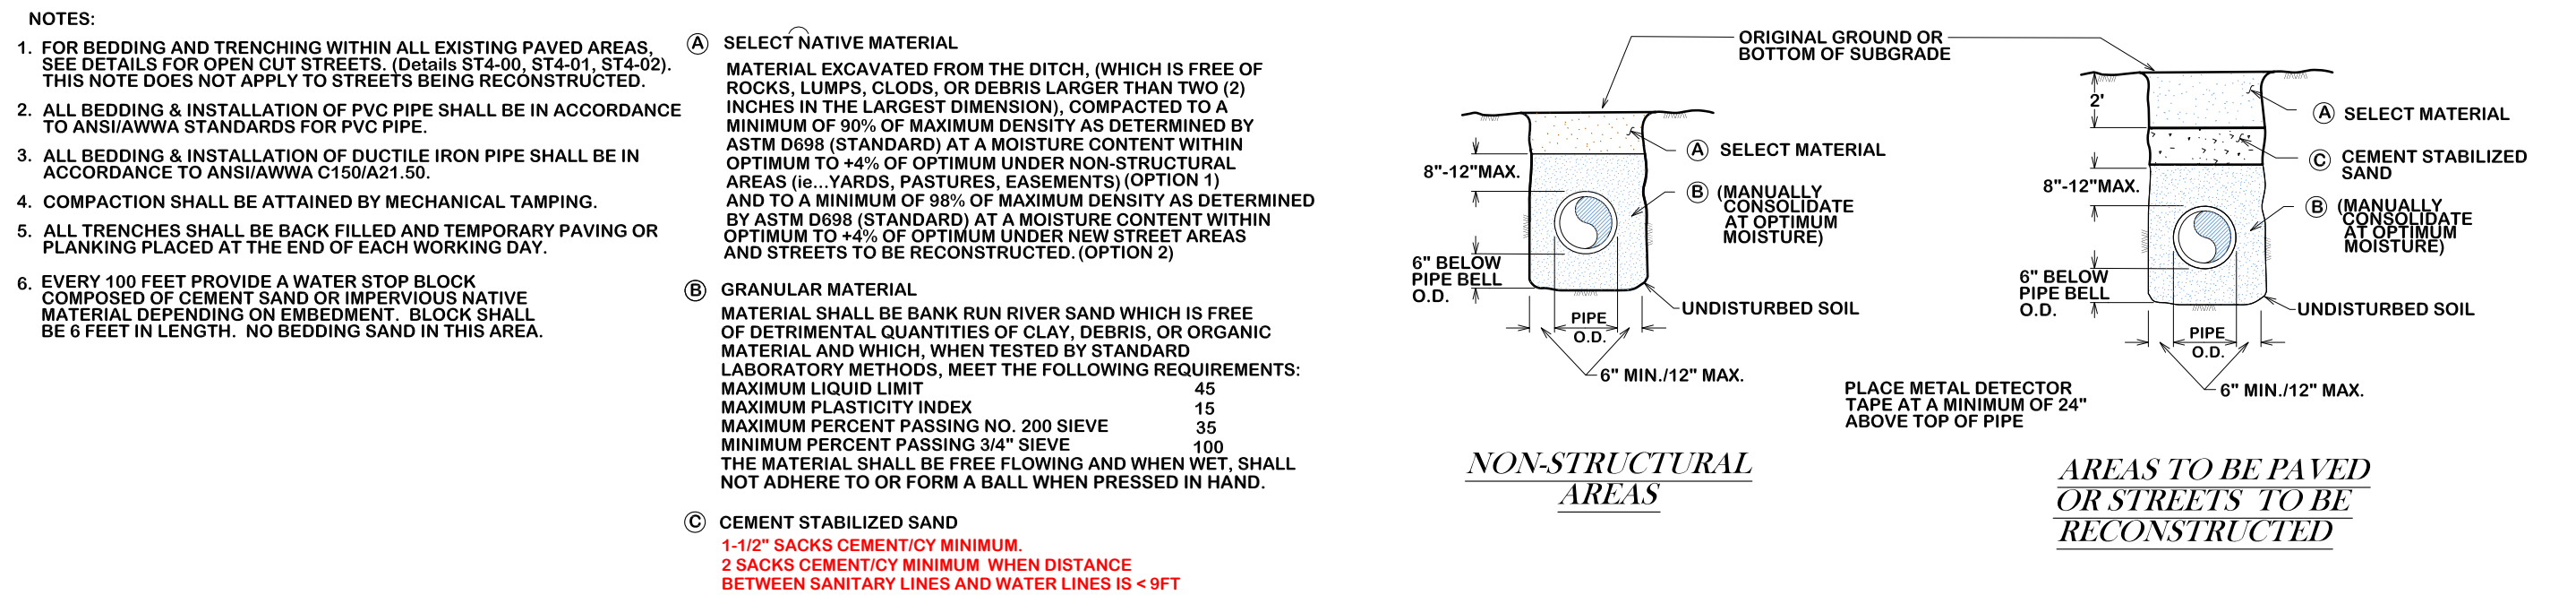

BEDDING AND TRENCH FOR DI PIPE & PVC PIPE

S1-01

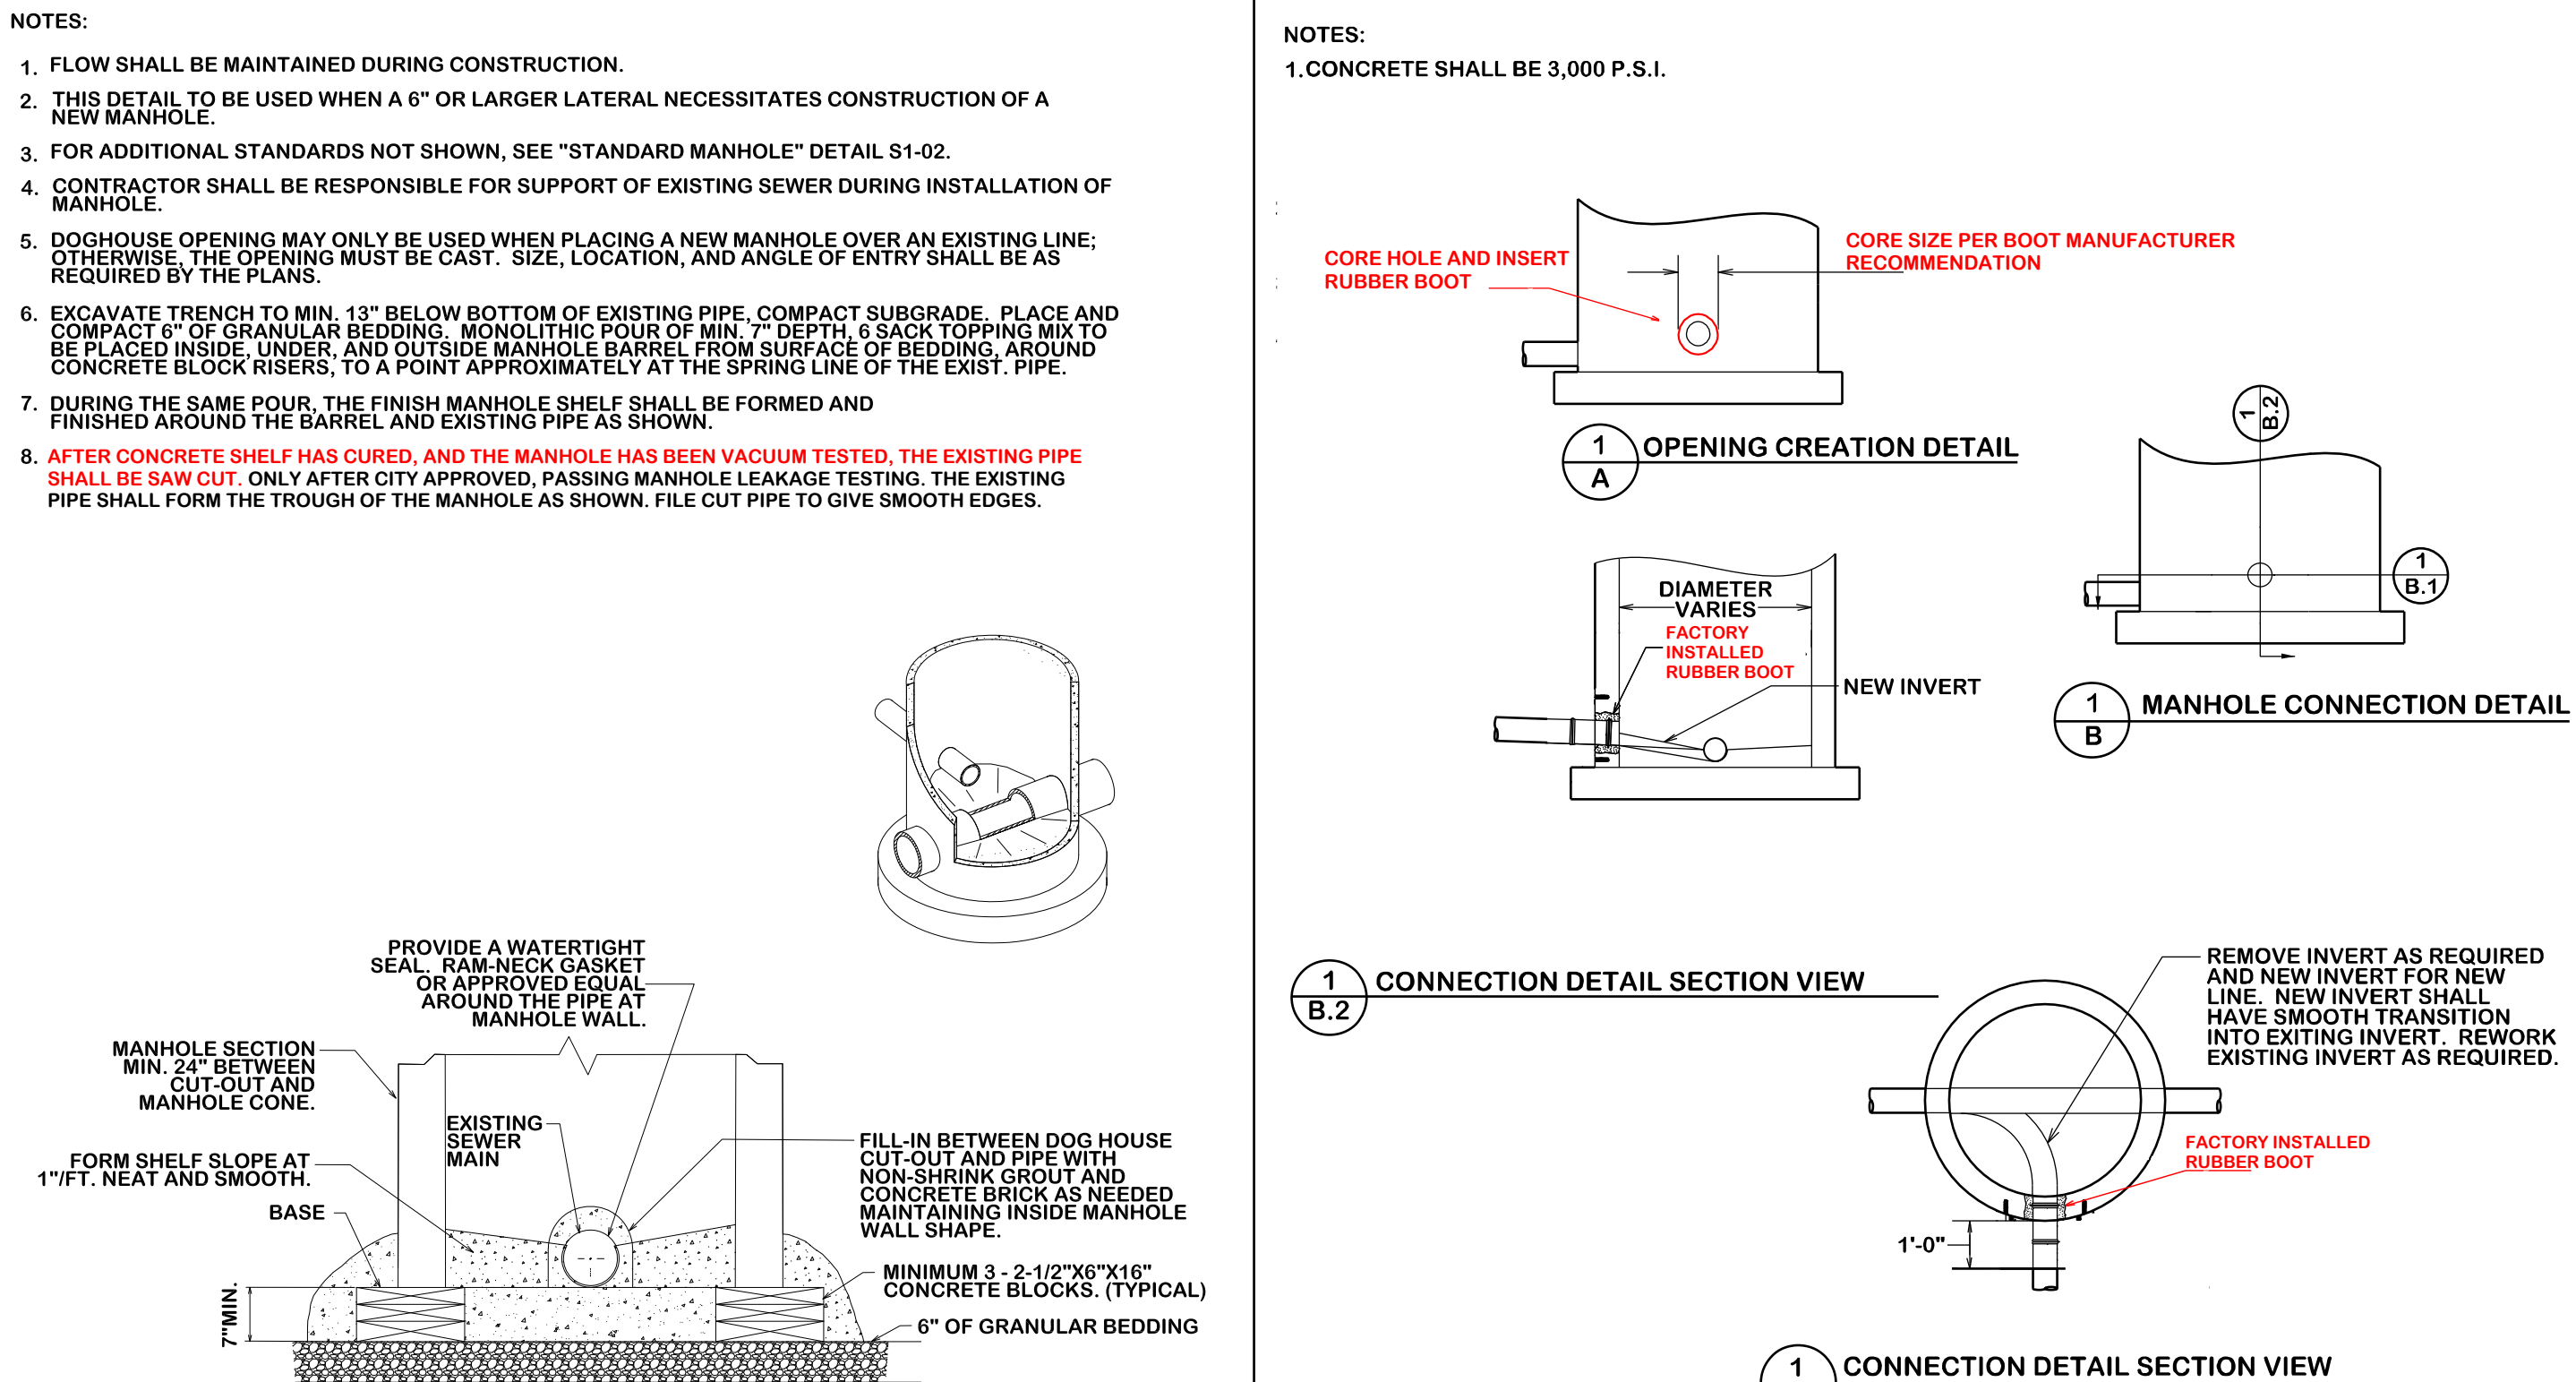


STANDARD MANHOLE TIE-IN

S3-01

CITY OF COLLEGE STATION  
GRAVITY SEWER DOGHOUSE MANHOLE


S3-00

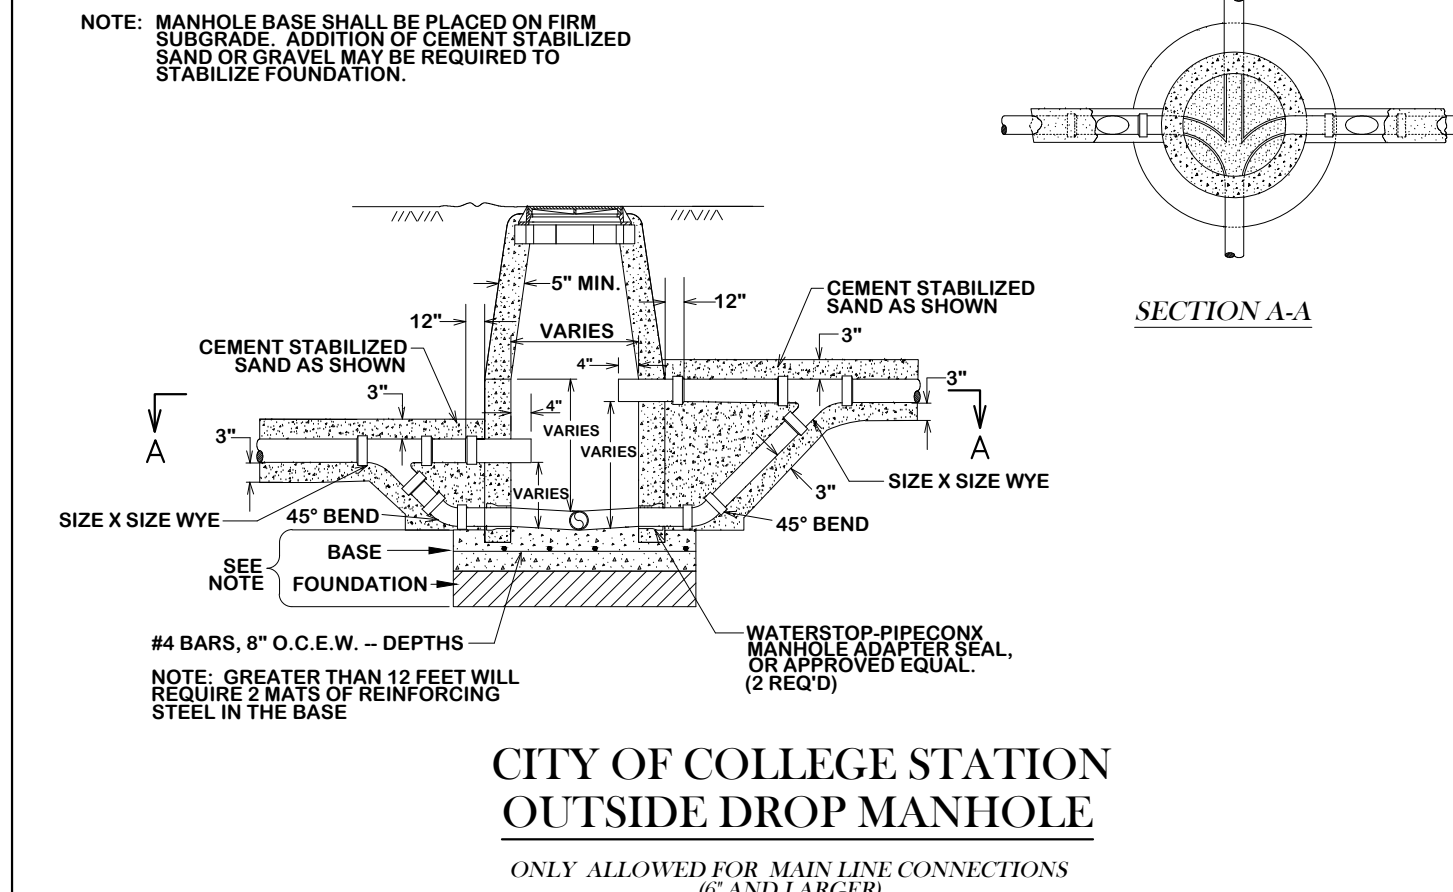

CITY OF COLLEGE STATION  
OUTSIDE DROP MANHOLE

ONLY ALLOWED FOR MAIN LINE CONNECTIONS  
(6" AND LARGER)


S2-00

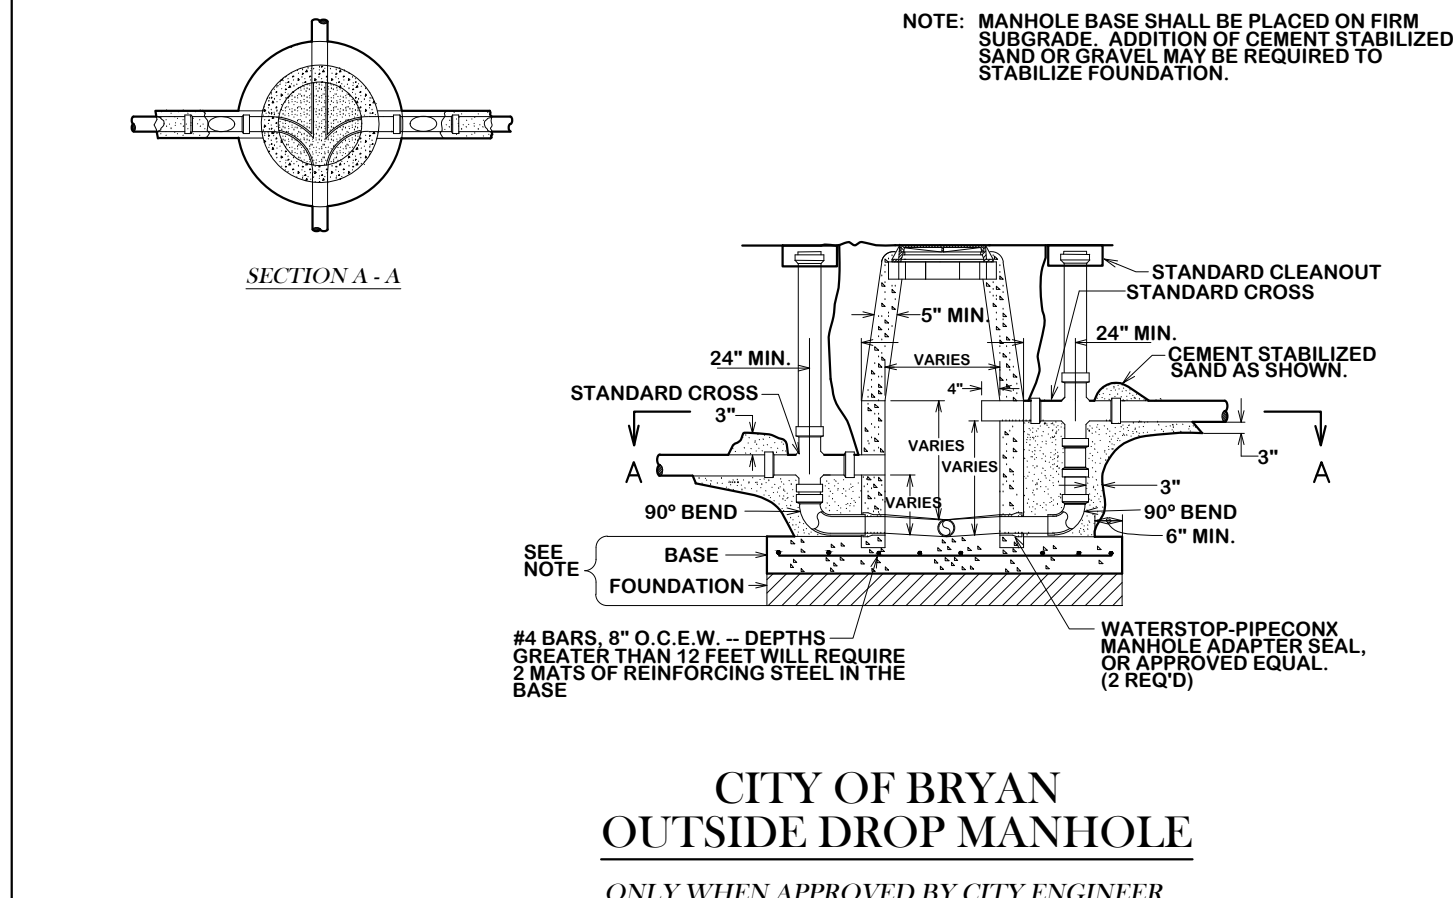

CITY OF BRYAN  
OUTSIDE DROP MANHOLE

ONLY WHEN APPROVED BY CITY ENGINEER

S2-01

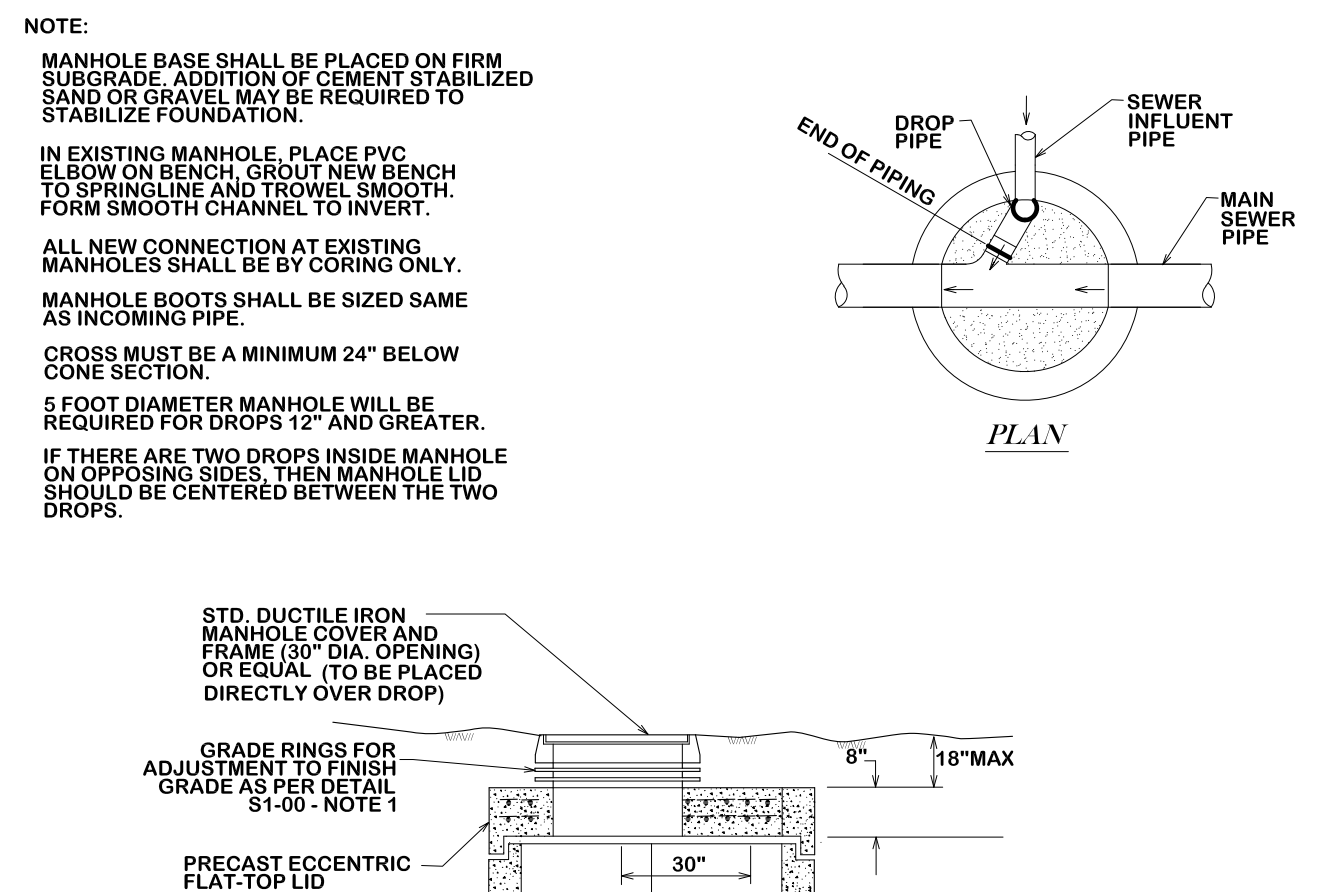


STANDARD DROP MANHOLE

CITY OF BRYAN - DROP MANHOLE TO BE USED ON LINES UP TO 12" IN SIZE


CITY OF COLLEGE STATION - DROP MANHOLE TO BE USED ON LINES UP TO 1" IN SIZE

S2-02

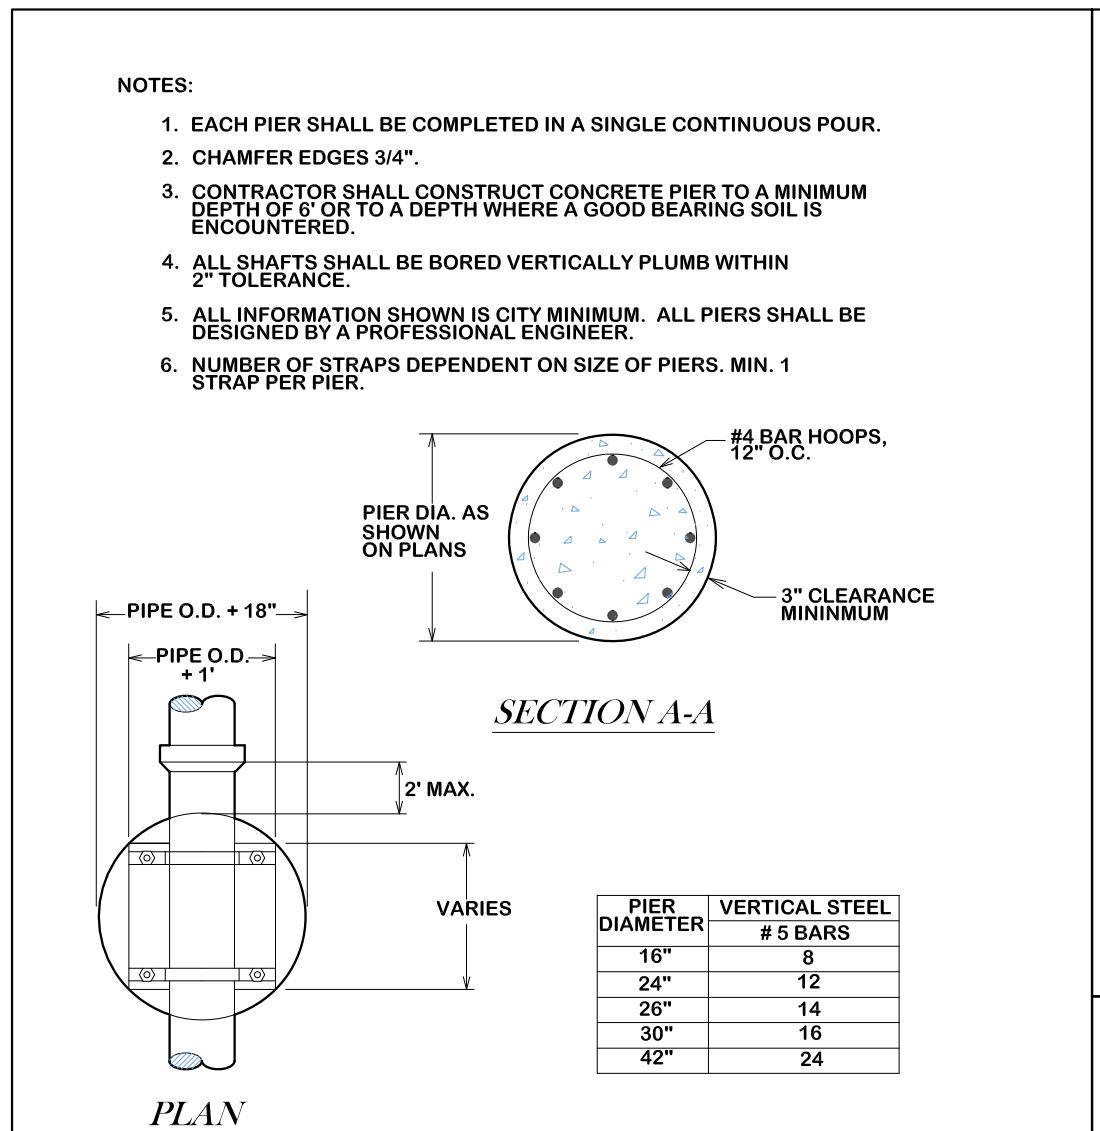

TYPICAL CONCRETE DRILLED  
PIER FOR AERIAL SEWER


S4-00

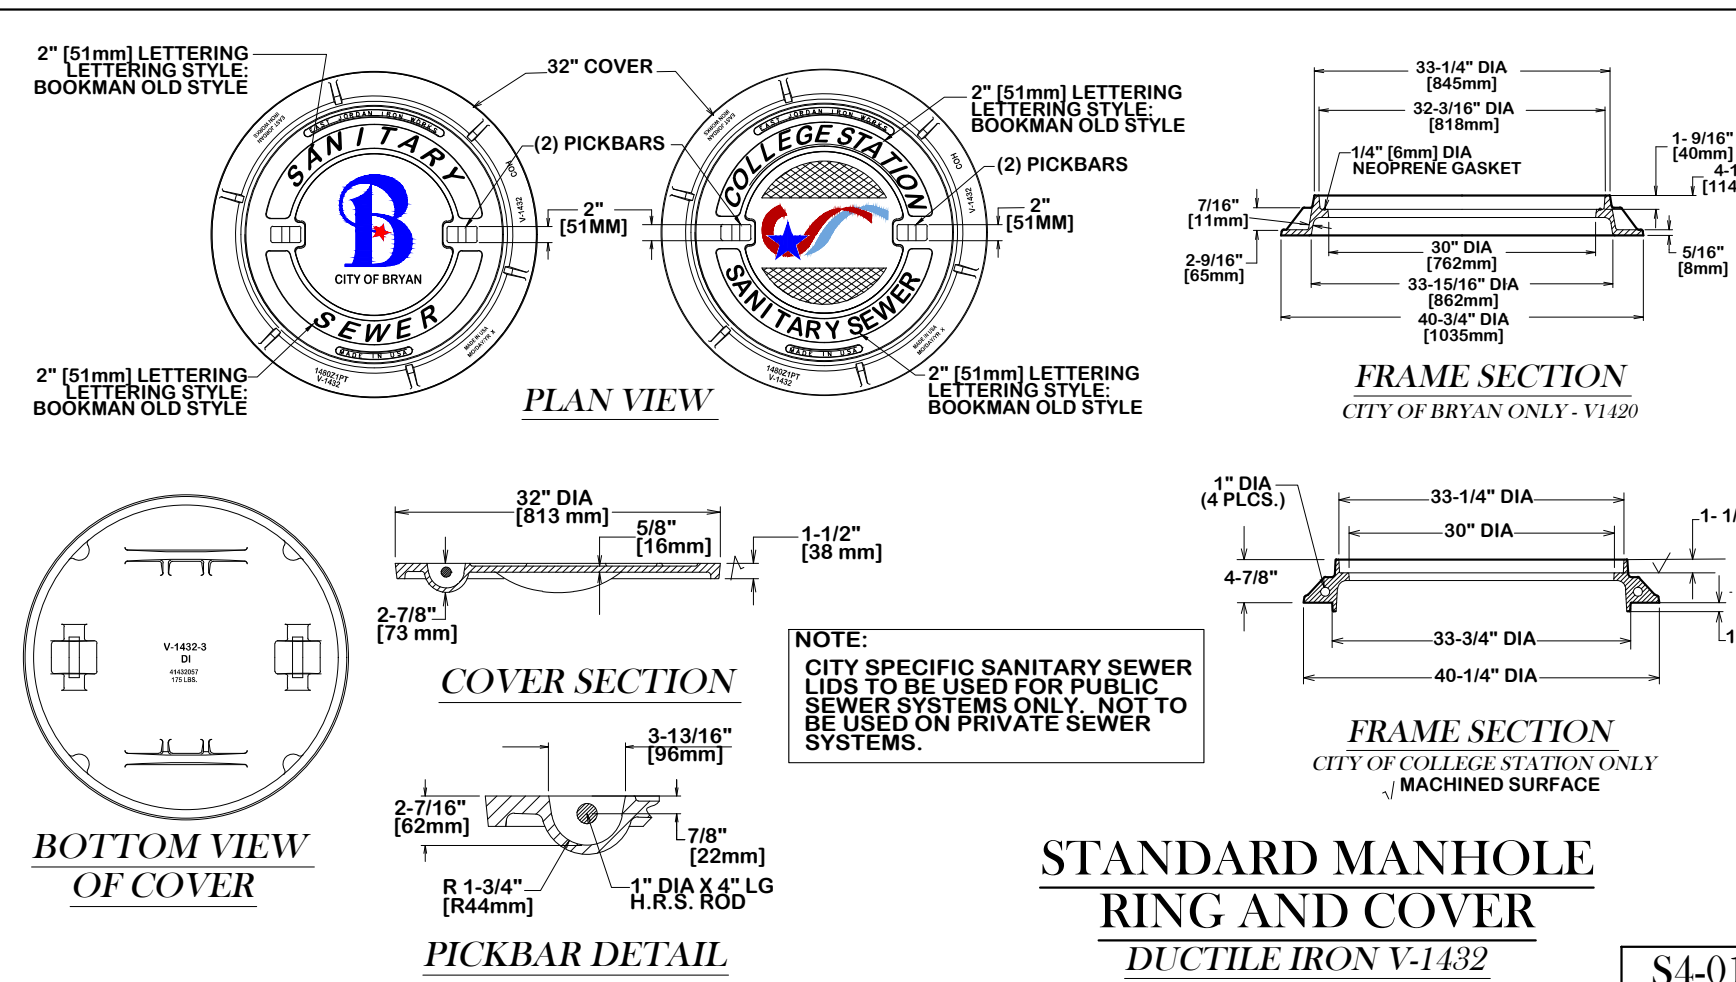

STANDARD MANHOLE  
RING AND COVER

DUCTILE IRON V-1432

S4-01

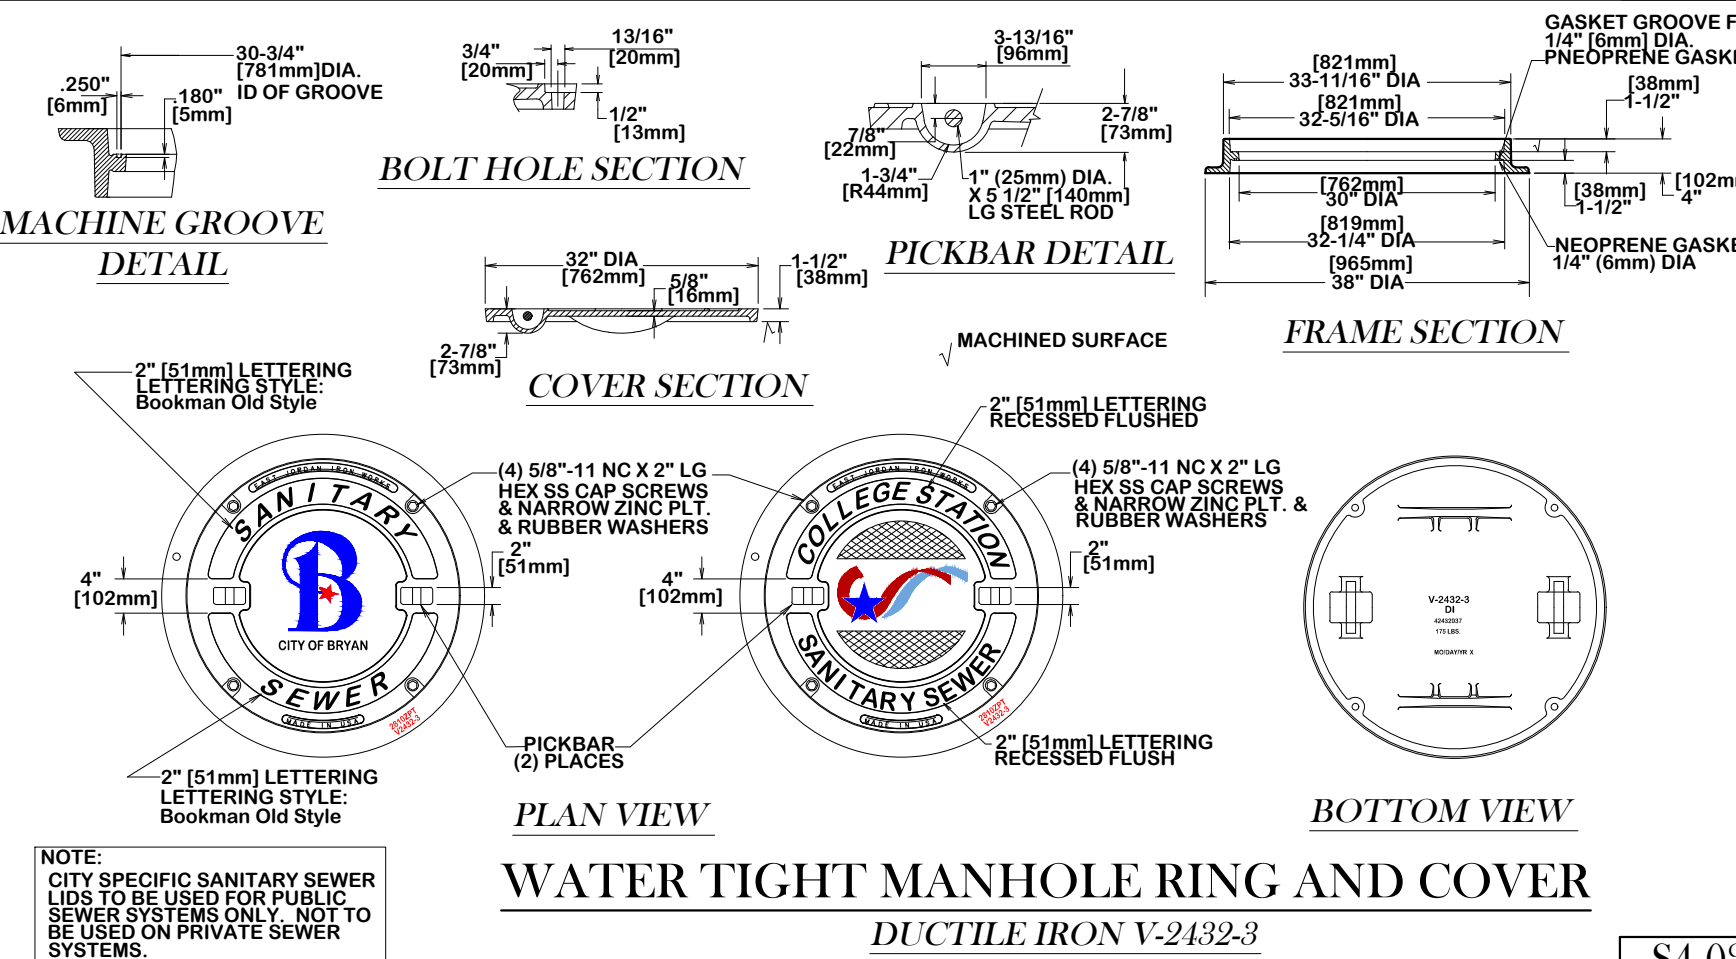

WATER TIGHT MANHOLE RING AND COVER

DUCTILE IRON V-2432-3

S4-02


BRYAN - COLLEGE STATION  
STANDARD SEWER DETAILS



DRAWN BY: K.L.  
DATE: APR 2024  
SCALE: NTS  
APPROVED: W. P. K.


GENERAL NOTES:

- ALL AREAS WHERE EXISTING VEGETATION AND GRASS COVER HAVE BEEN BARED BY CONSTRUCTION SHALL BE ADEQUATELY BLOCK SOODED OR HYDROMULCHED AND WATERED UNTIL GROWTH IS ESTABLISHED. IN DEVELOPED AREAS WHERE GRASS IS PRESENT, BLOCK SOO WILL BE REQUIRED. BARED AREAS SHALL BE SEEDED OR SOODED WITHIN 14 CALENDAR DAYS OF LAST DISTURBANCE.
- APPROVED EROSION CONTROL MEASURES MUST BE INSTALLED DURING THE ENTIRE TIME THAT EARTH HAS BEEN BARED BY CONSTRUCTION AND SHALL STAY IN PLACE UNTIL ACCEPTABLE VEGETATIVE GROWTH IS ESTABLISHED. AFTER CONSTRUCTION IS COMPLETE AND THEN REMOVED BY CONTRACTOR.
- ALL EROSION CONTROL MEASURES SHOULD BE CLEANED OF SILT AFTER EVERY RAIN.
- ESTABLISHMENT OF VEGETATION MAY BE A WARRANTY ITEM.

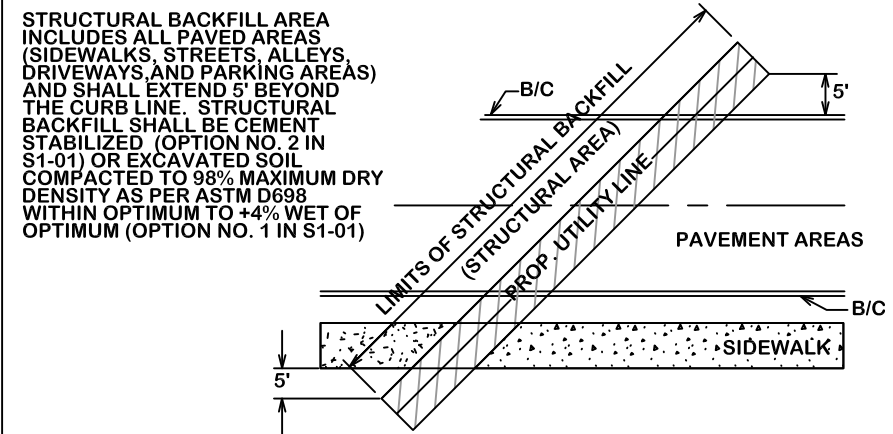


STRUCTURAL BACKFILL AREA

S5-00

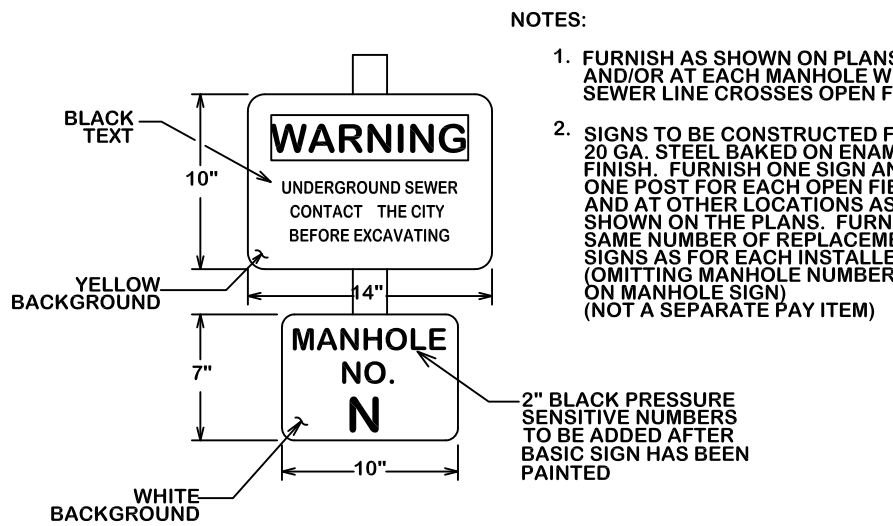


SEWER WARNING AND MANHOLE IDENTIFICATION SIGN

S5-02

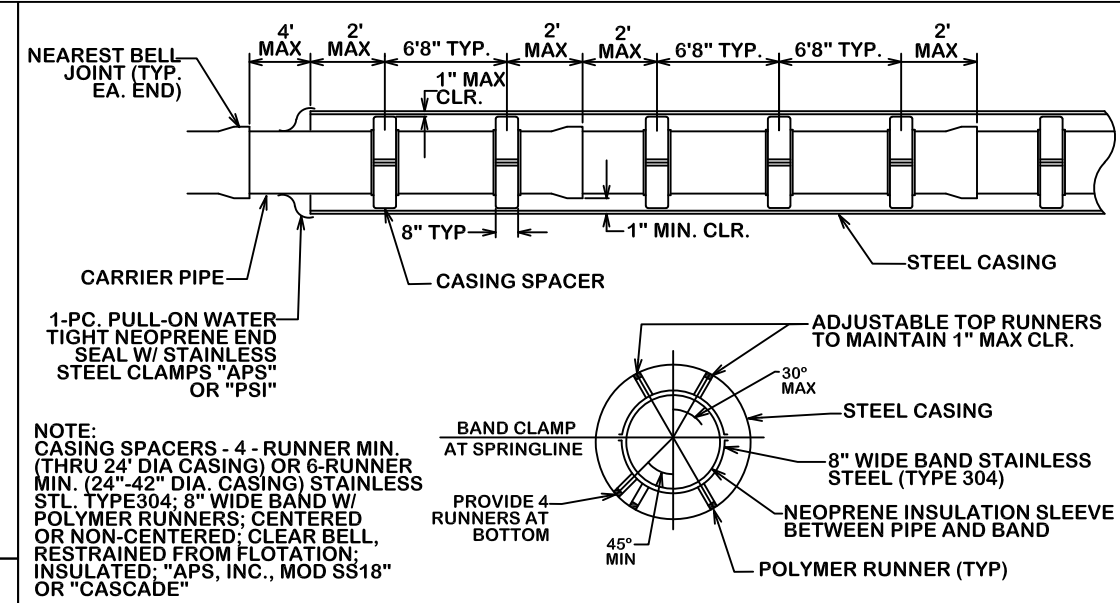

CASING DETAIL


S5-03

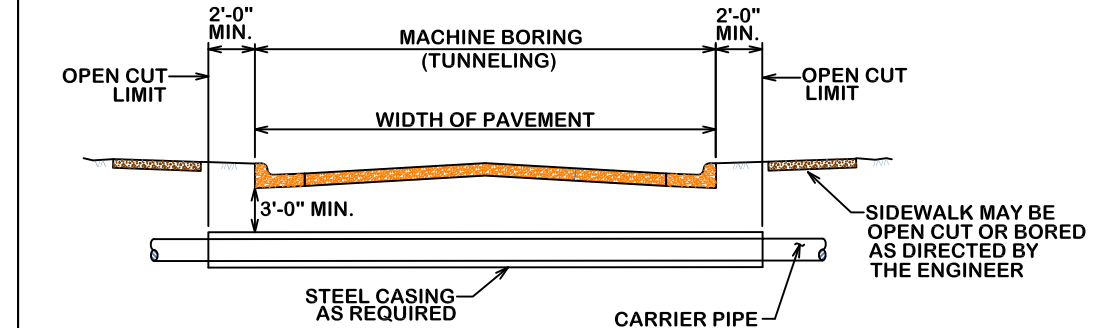

- NOTE:
- FOR MORE INFORMATION ON WATER AND SEWER LINE CROSSING SEE CITY STANDARD SPECIFICATION FOR WATER AND SEWER LINE CONSTRUCTION.
  - STEEL CASING SHALL BE AS SPECIFIED IN THE TECHNICAL SPECIFICATIONS.
  - DRY BORING IS REQUIRED.

TYPICAL URBAN CITY STREET CROSSING

S5-04

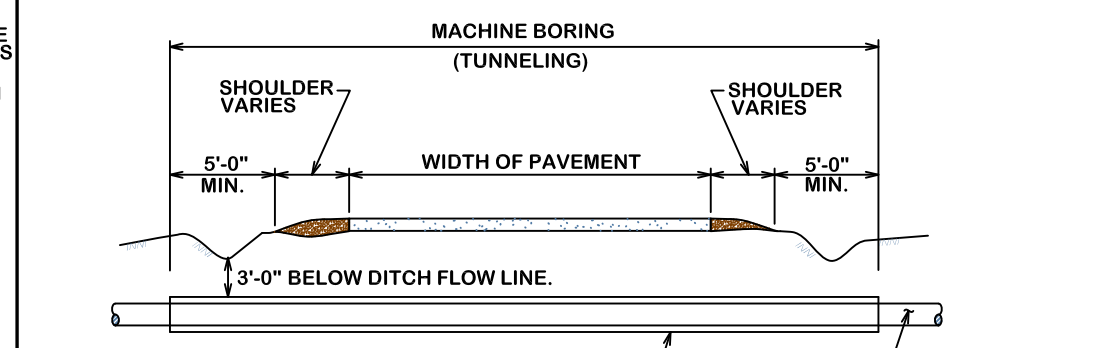


- NOTE:
- FOR MORE INFORMATION ON WATER AND SEWER LINE CROSSING SEE CITY STANDARD SPECIFICATION FOR WATER AND SEWER LINE CONSTRUCTION.
  - STEEL CASING SHALL BE AS SPECIFIED IN THE TECHNICAL SPECIFICATIONS.
  - DRY BORING IS REQUIRED.


TYPICAL RURAL STREET CROSSING

S5-05

- NOTE:
- ALL MATERIAL SHALL BE ASTM D3034 SDR26 W/ GASKETS
  - ALL SERVICE CONNECTIONS & EXTENSIONS ARE TO BE INSTALLED WITH THE MAIN LINE CONSTRUCTION.
  - A CLEAN OUT IS REQUIRED AND WILL BE INSTALLED BY THE CONTRACTOR AT THE ROW FOR EACH LONG AND SHORT SIDE SERVICE. CLEANOUT SHALL INCLUDE A BRASS PLUG. CLEANOUTS SHALL BE EXTENDED 4 FEET ABOVE NATURAL GROUND. CLEANOUT CAP FITTING SHALL BE PLACED ON TOP.
  - LOT CORNERS SHALL BE MARKED WITH A LATH UNDER THE SUPERVISION OF A SPLS UPON COMPLETION OF CONSTRUCTION
  - "STANDARD" SERVICE CONNECTIONS APPLY WHEN TRENCH IS LESS THAN 7' DEEP.
  - "DEEP" SERVICE CONNECTIONS APPLY WHEN TRENCH IS MORE THAN 7' DEEP.
  - SERVICE SHALL BE AS SHALLOW AS POSSIBLE AND STILL SERVICE LOT.
  - WHERE A SINGLE SERVICE THAT SERVES A SINGLE RESIDENCE TAPS INTO A MANHOLE NEAR THE PROPERTY LINE OF THAT LOT A SEWER STACK SHALL NOT BE REQUIRED.
  - WHERE A CLEANOUT WILL BE IN A TRAFFIC AREA, A CAST IRON TOP HAT WILL BE REQUIRED.
  - NEW CONSTRUCTION (TEMPORARY) USE GLUE CAP IN PLACE OF FEMALE ADAPTER AND BRASS PLUG.

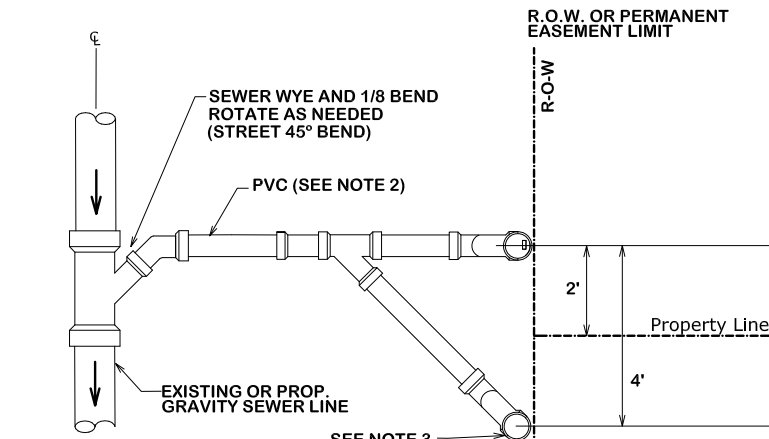

PLAN VIEW

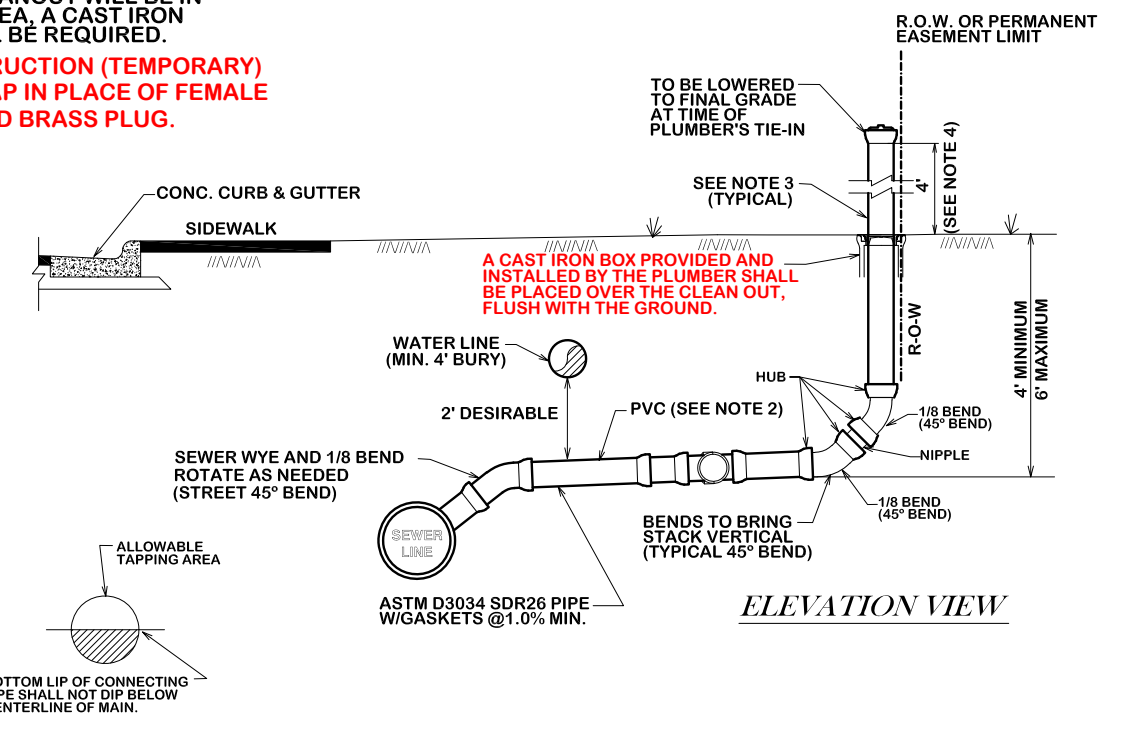


STANDARD SEWER SERVICE CONNECTION


NEW CONSTRUCTION ONLY

S6-00

- NOTE:
- ALL MATERIAL SHALL BE ASTM D3034 SDR26 W/ GASKETS
  - SERVICE SHALL BE AS SHALLOW AS POSSIBLE AND STILL SERVICE LOT
  - WHERE A SINGLE SERVICE THAT SERVES A SINGLE RESIDENCE TAPS INTO A MANHOLE NEAR THE PROPERTY LINE OF THAT LOT A SEWER STACK SHALL NOT BE REQUIRED.
  - WHERE A CLEANOUT WILL BE IN A TRAFFIC AREA, A CAST IRON TOP HAT WILL BE REQUIRED.
  - A CLEANOUT MUST BE INSTALLED ON EACH SERVICE RE-CONNECTION AT THE ROW LINE.

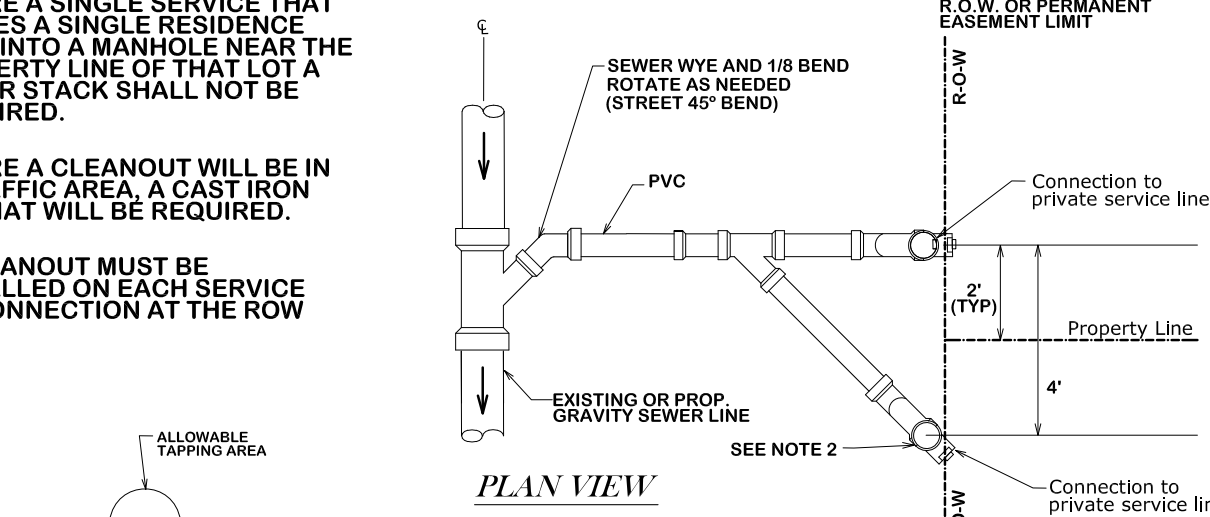

PLAN VIEW

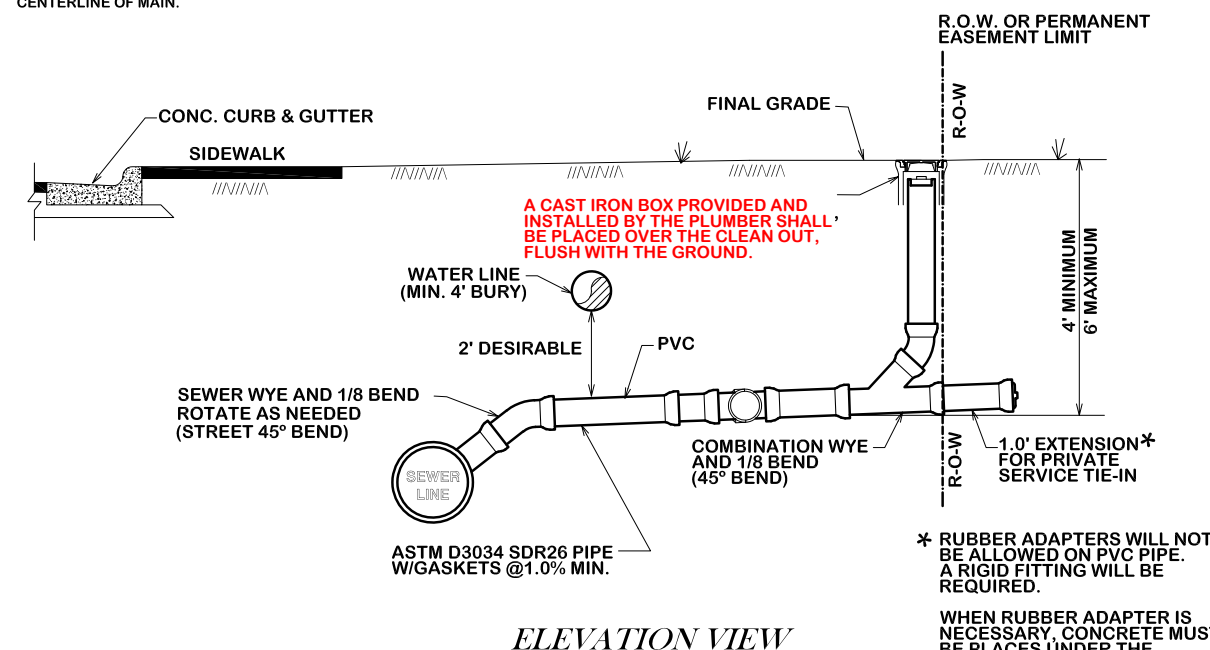


ELEVATION VIEW

STANDARD SEWER SERVICE RE-CONNECTION

PLUMBER CONNECTION OR CIP RECONSTRUCTION

S6-01

- NOTE:
- ALL MATERIAL SHALL BE ASTM D3034 SDR26 W/ GASKETS
  - ALL SERVICE CONNECTIONS & EXTENSIONS ARE TO BE INSTALLED WITH THE MAIN LINE CONSTRUCTION.
  - A CLEAN OUT IS REQUIRED AND WILL BE INSTALLED BY THE CONTRACTOR AT THE ROW FOR EACH LONG AND SHORT SIDE SERVICE CLEANOUT SHALL INCLUDE A BRASS PLUG.
  - CLEANOUTS SHALL BE EXTENDED 4 FEET ABOVE NATURAL GROUND. CLEANOUT CAP FITTING SHALL BE PLACED ON TOP.
  - NEW CONSTRUCTION (TEMPORARY) USE GLUE CAP IN PLACE OF FEMALE ADAPTER AND BRASS PLUG.

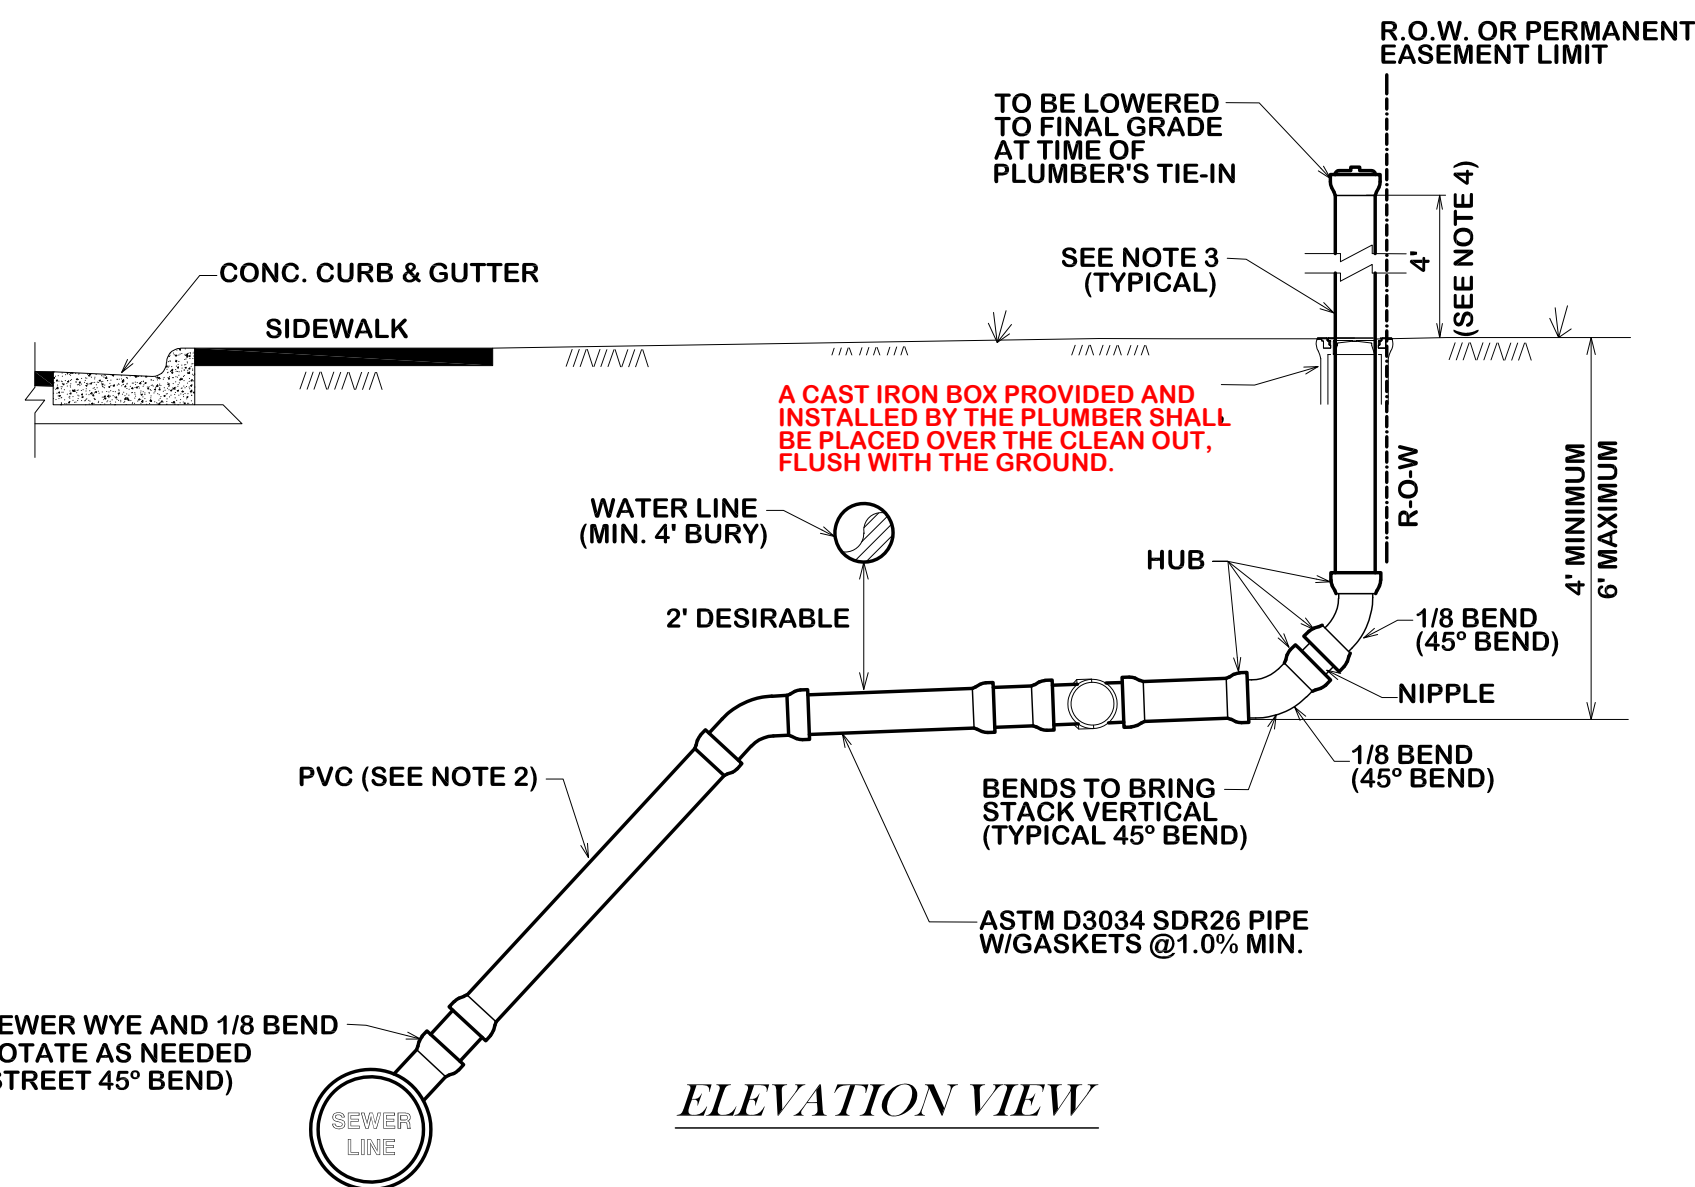

SEWER DEEP SERVICE CONNECTION


NEW CONSTRUCTION ONLY

S8-00

REVISIONS:

S5-00 & S6-01 revised 10/26/2012.

BRYAN - COLLEGE STATION  
STANDARD SEWER DETAILS












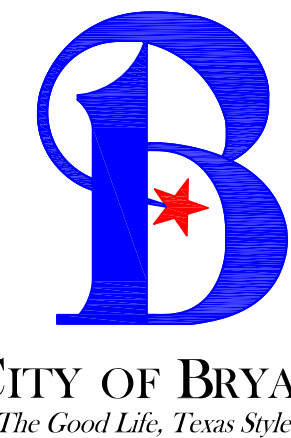


DRAWN BY: K.L.  
DATE: APR 2024  
SCALE: N T S  
APPROVED: W. P. K.

S2

SHEET 2 OF 2



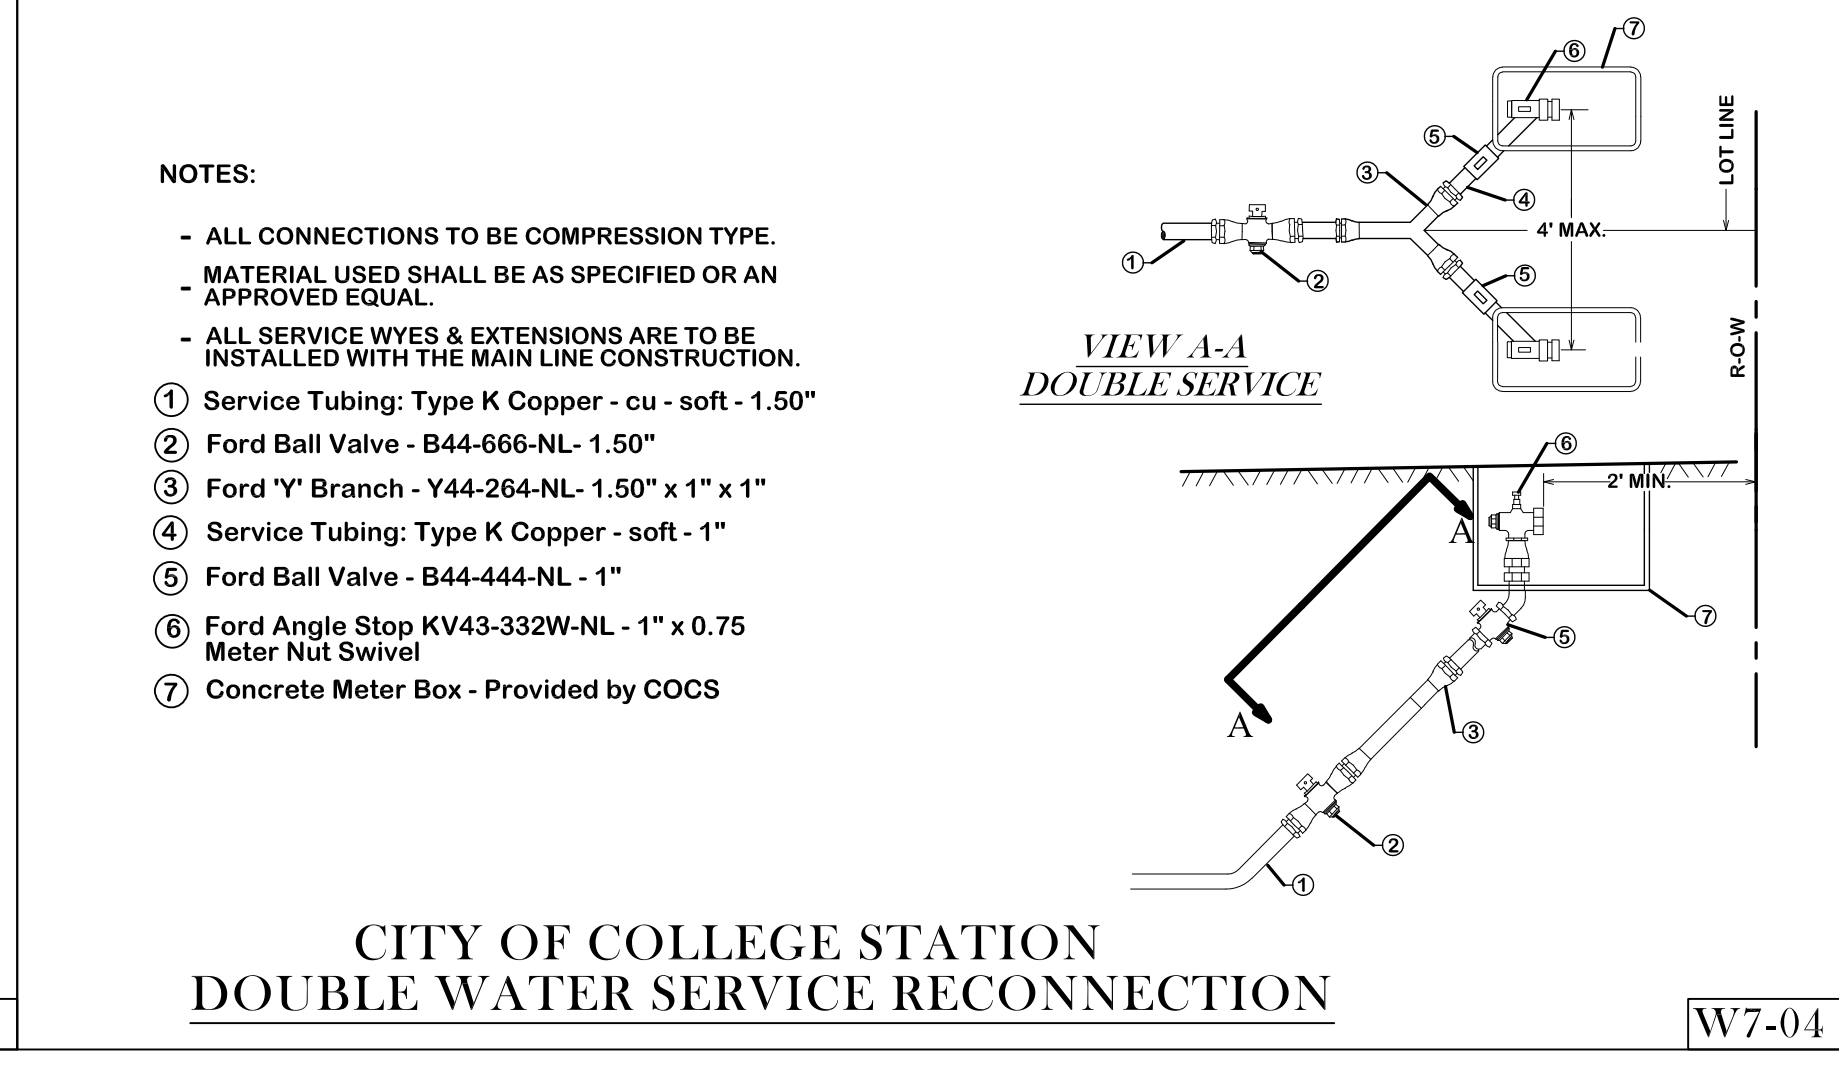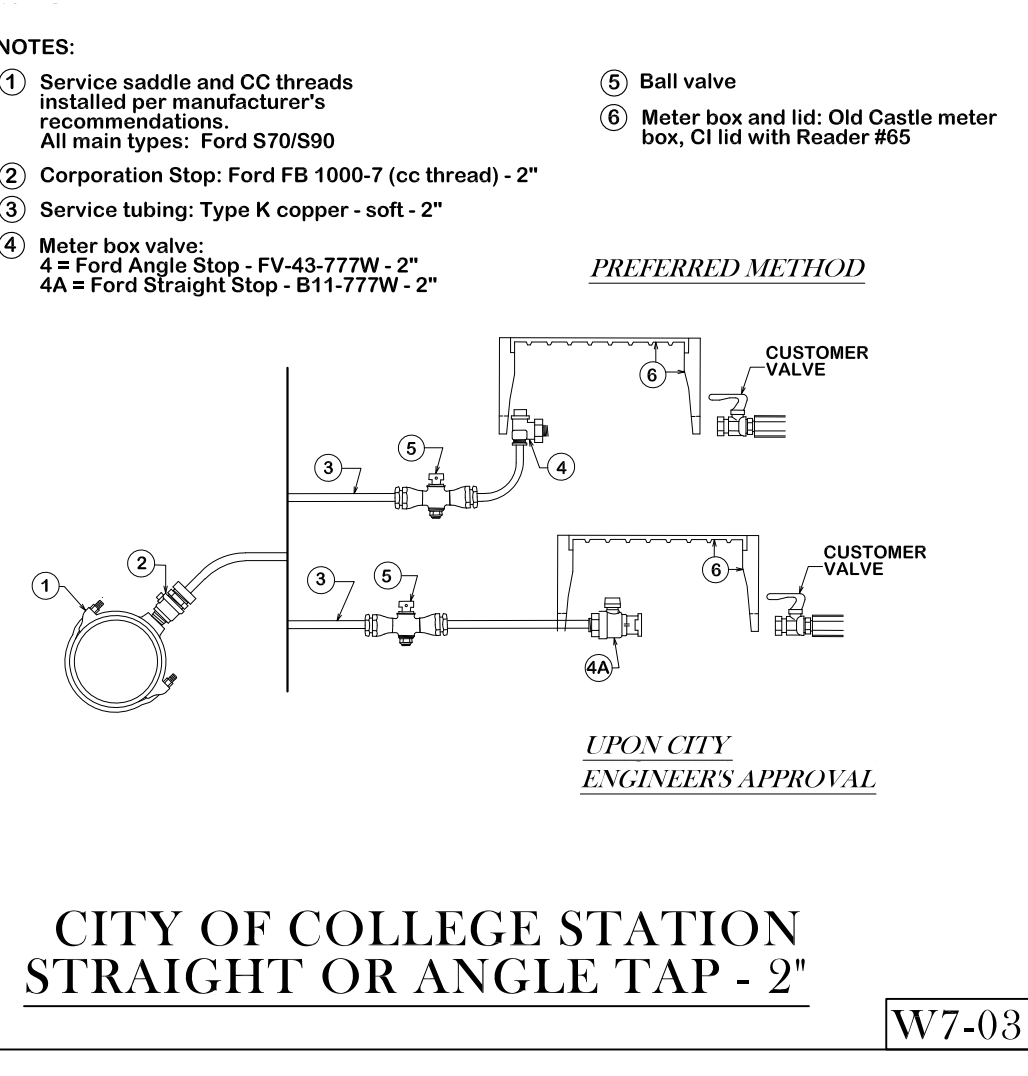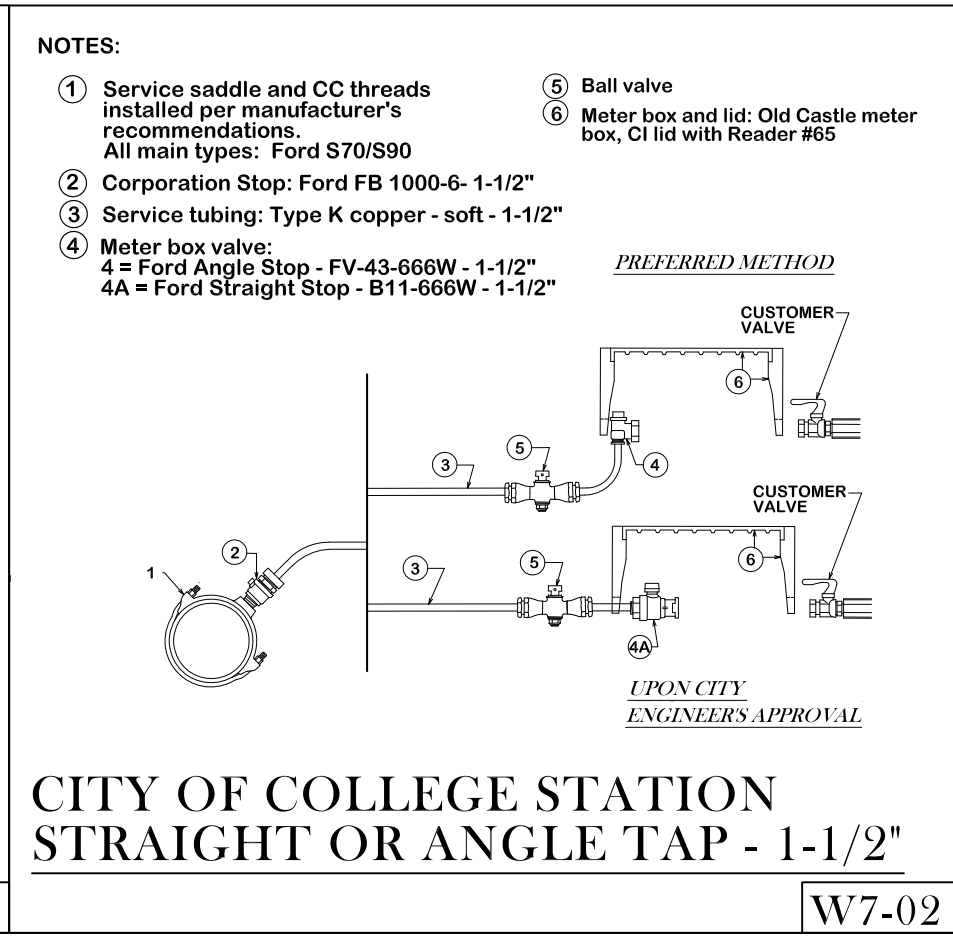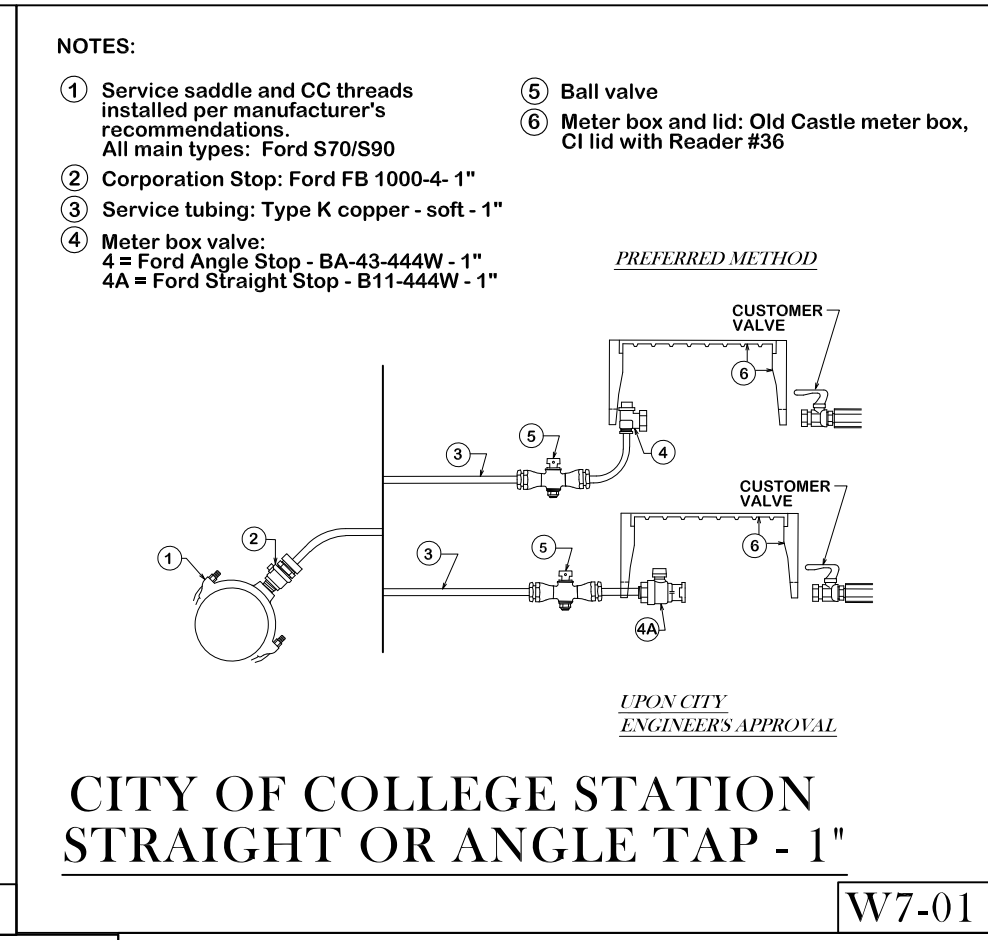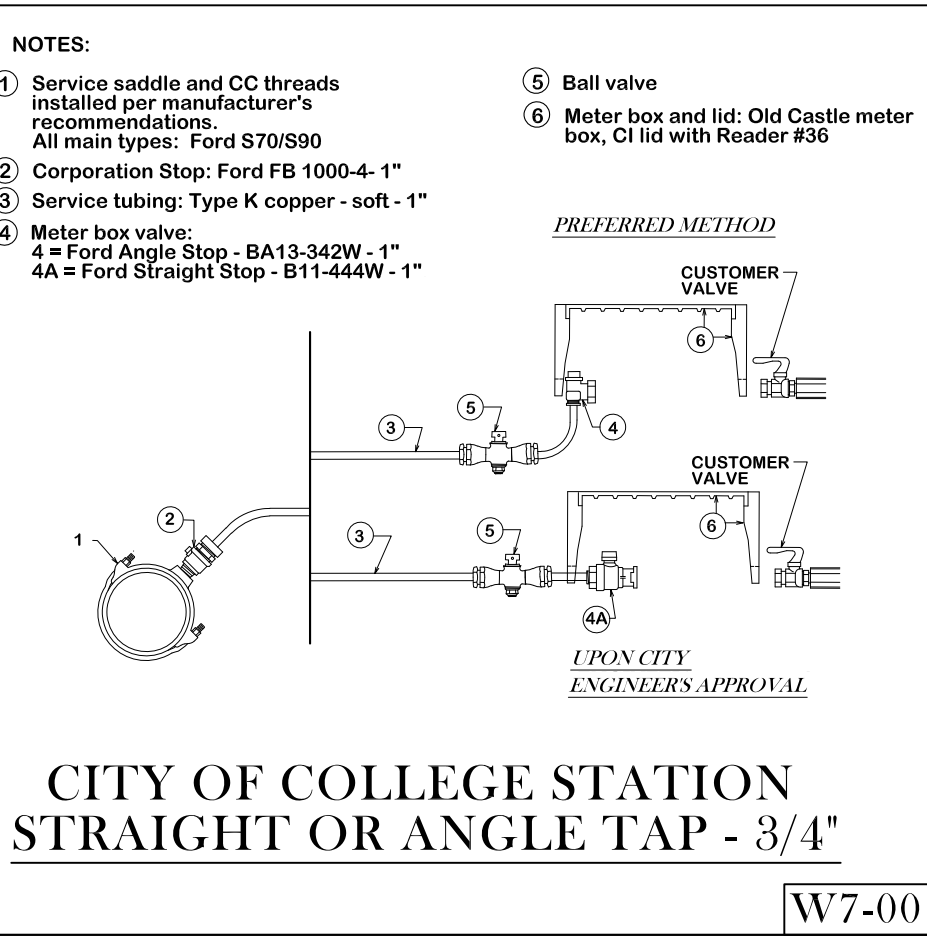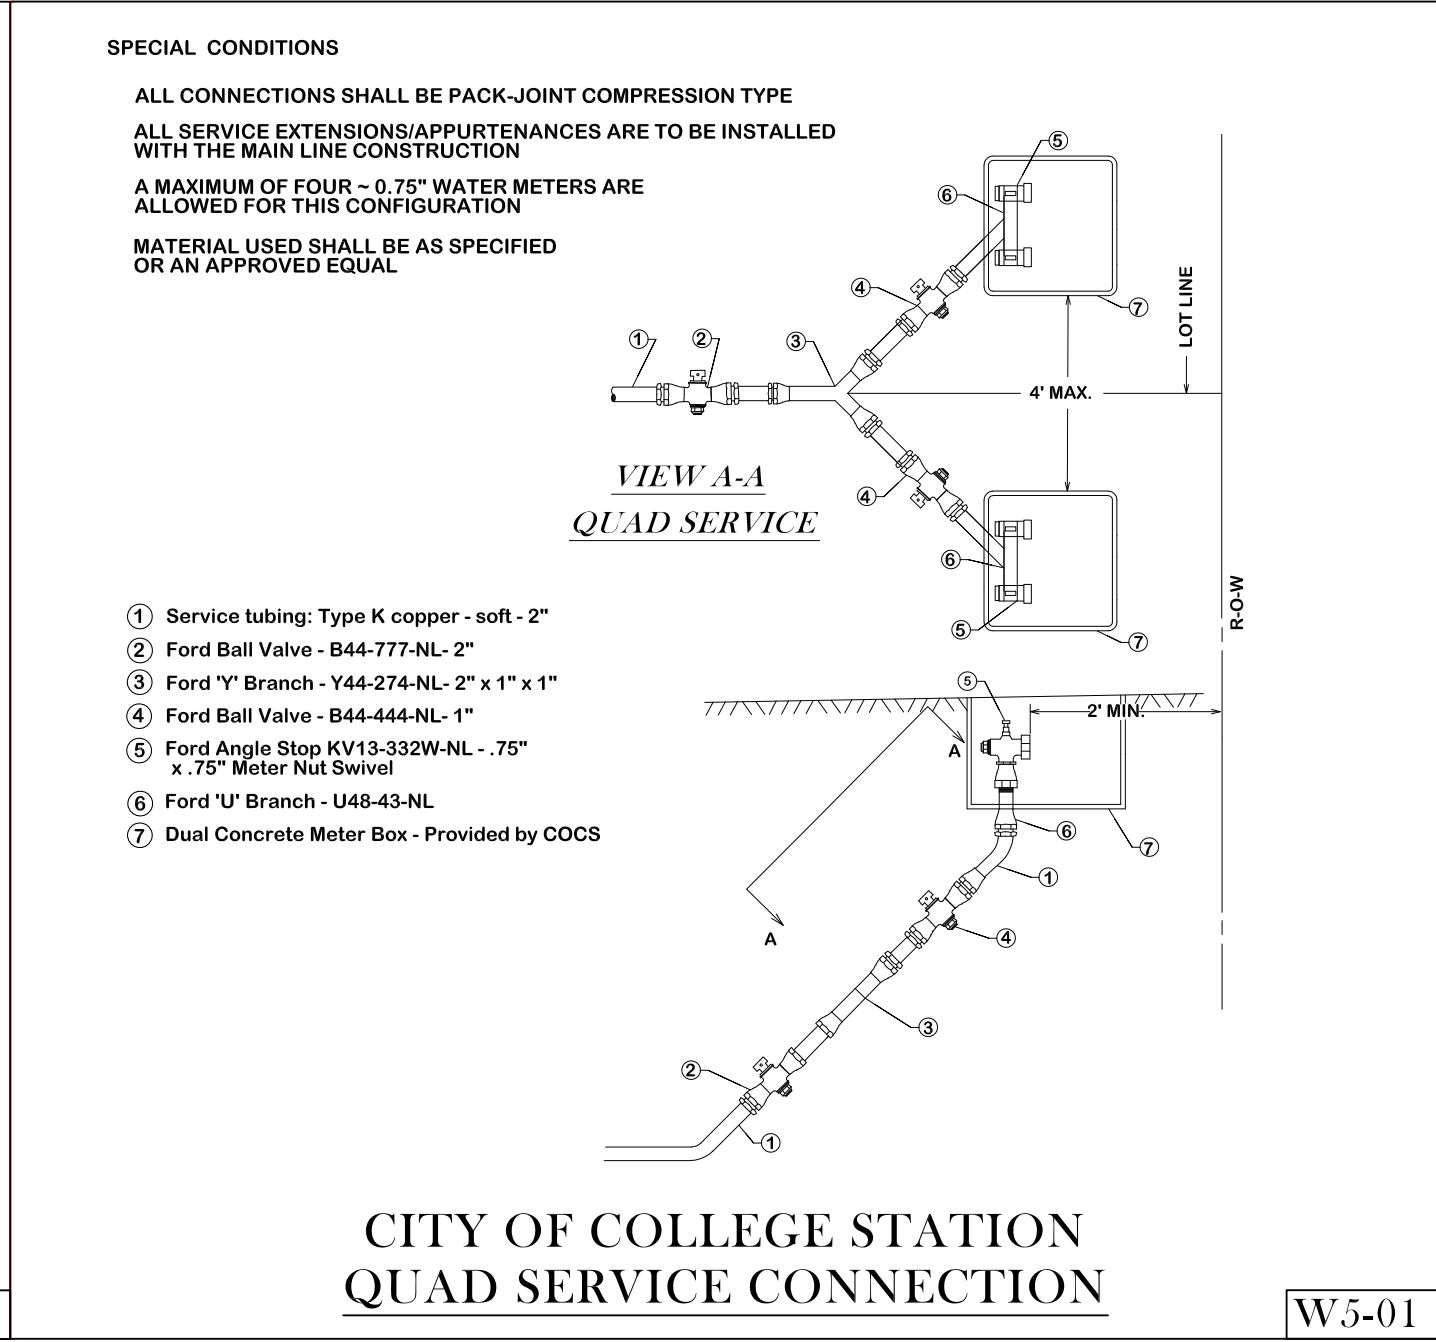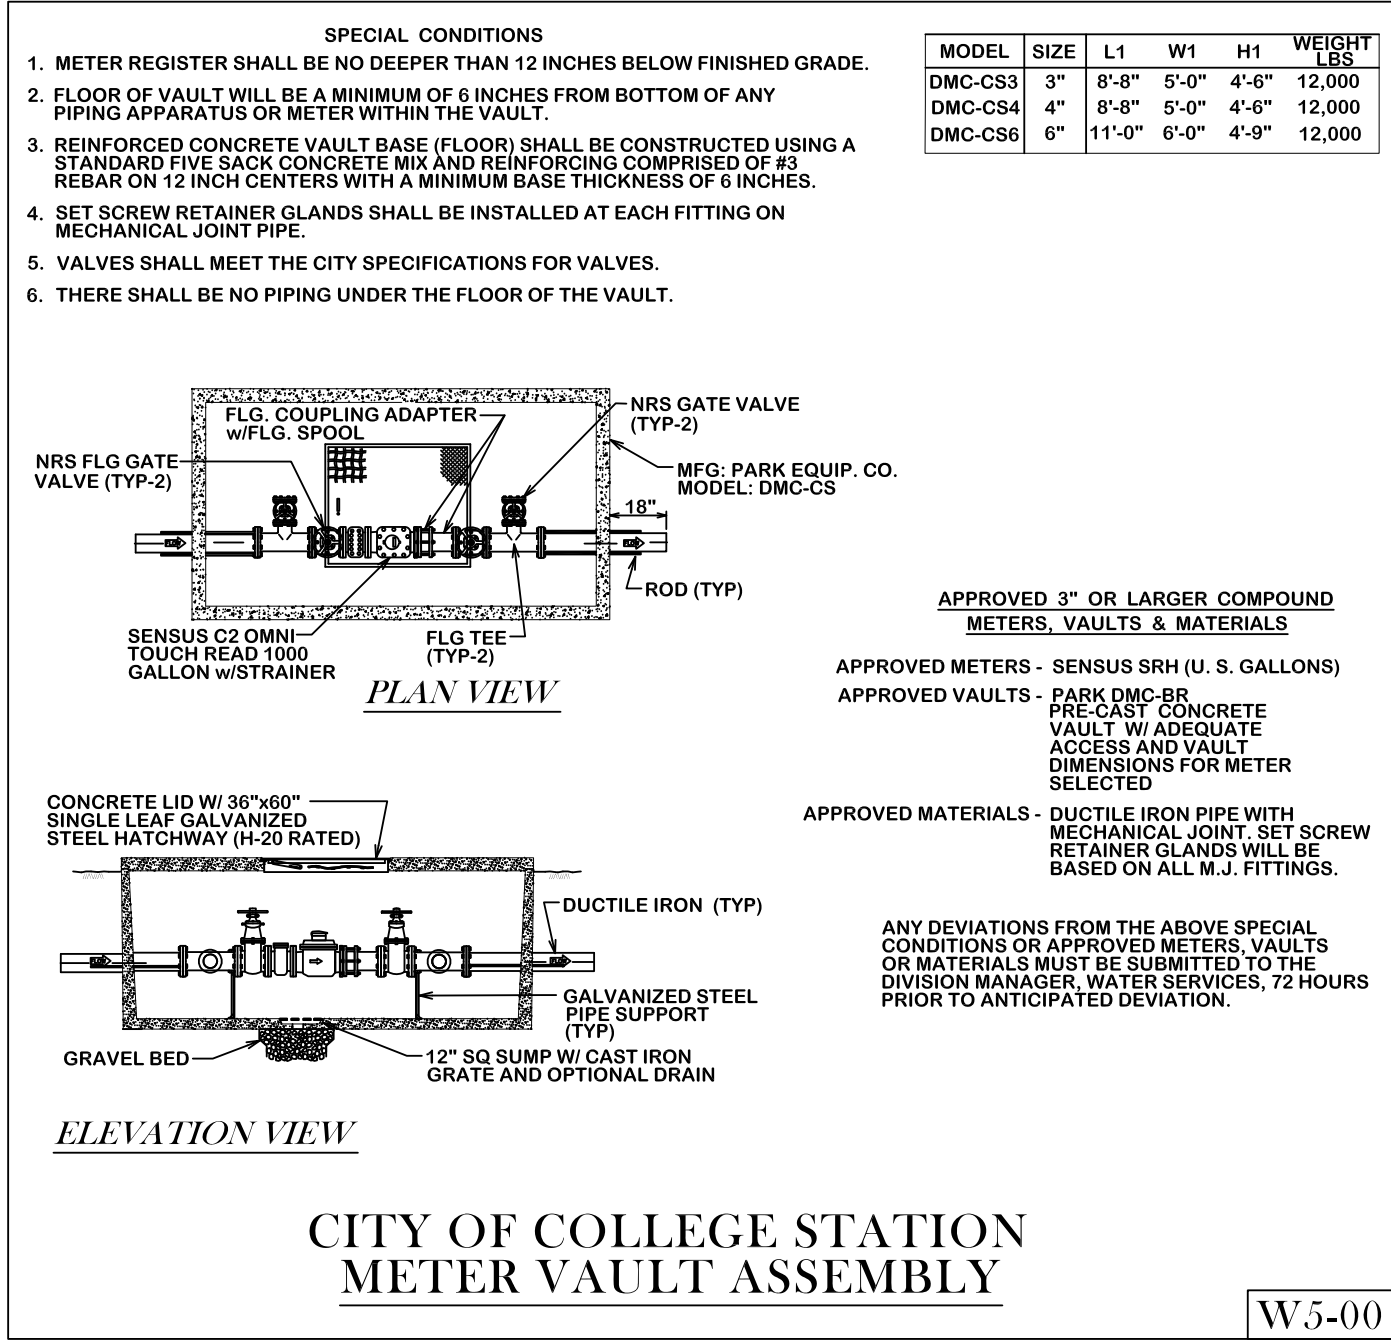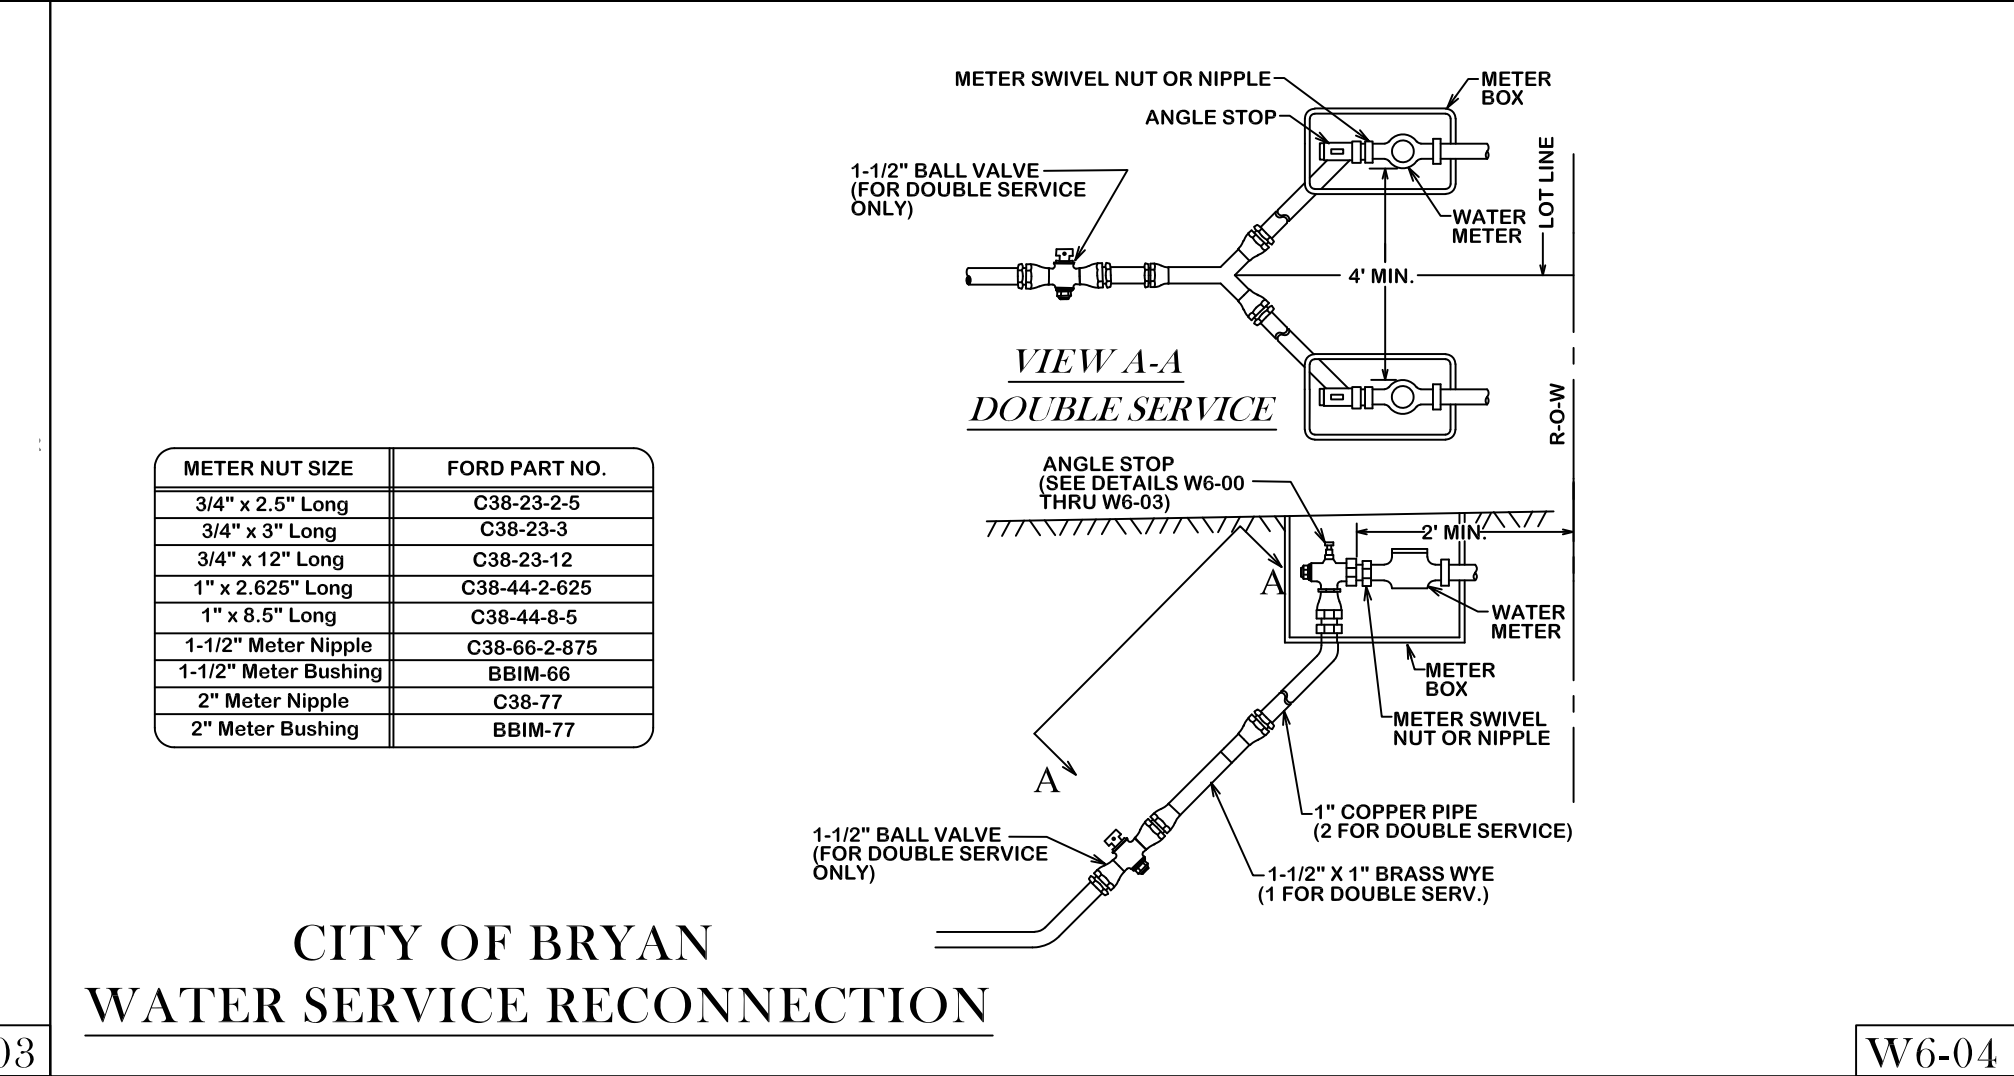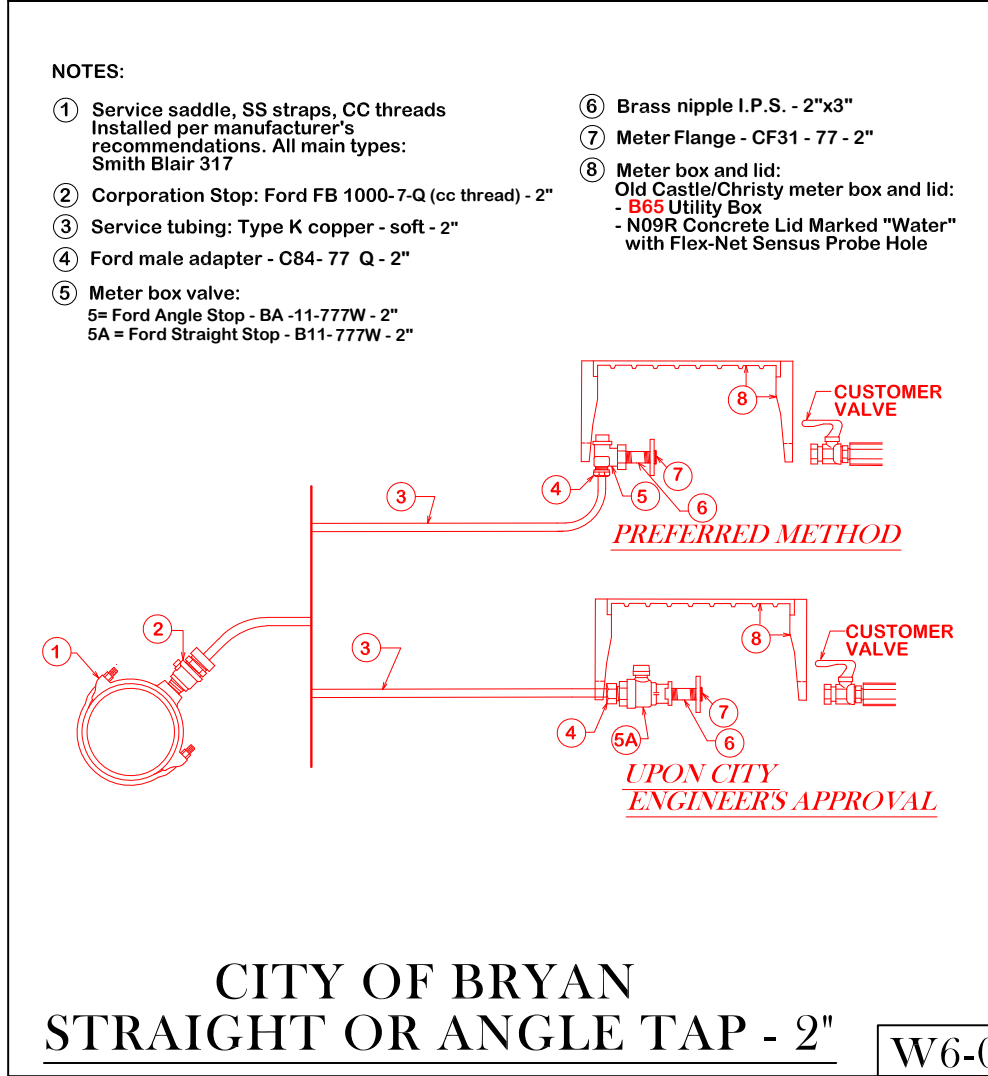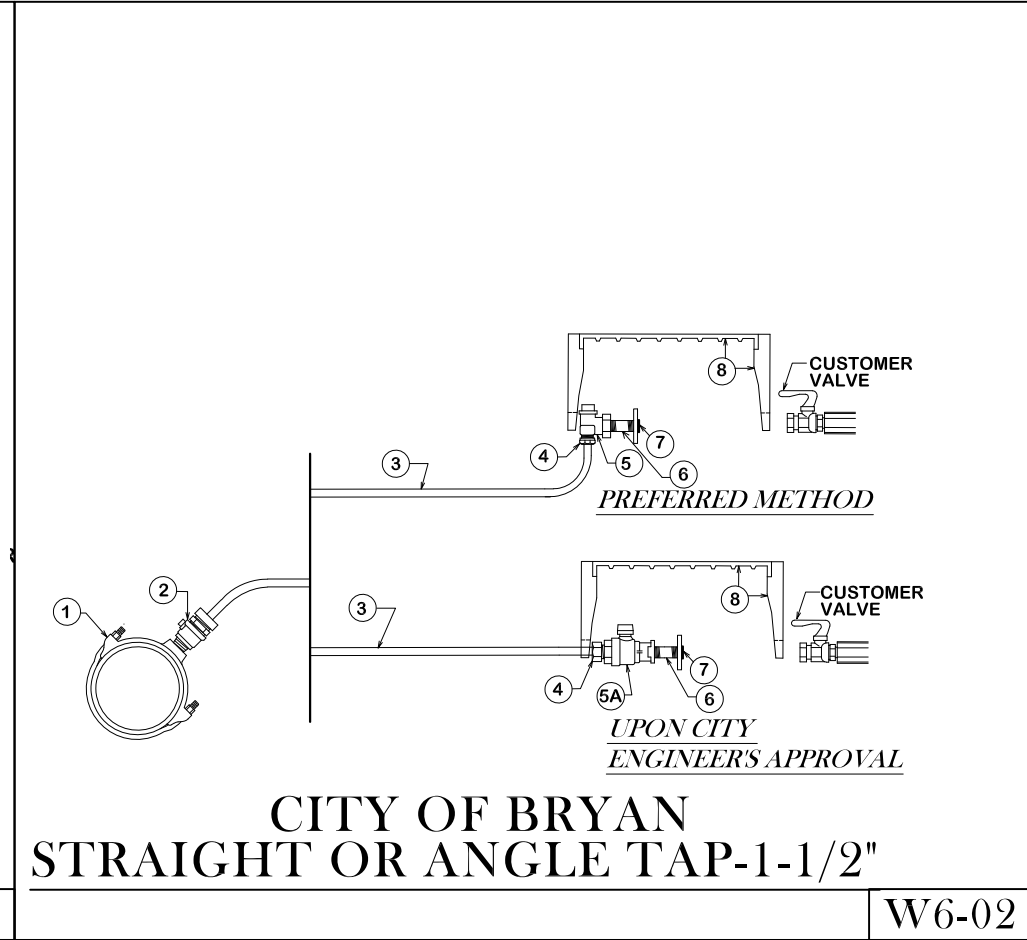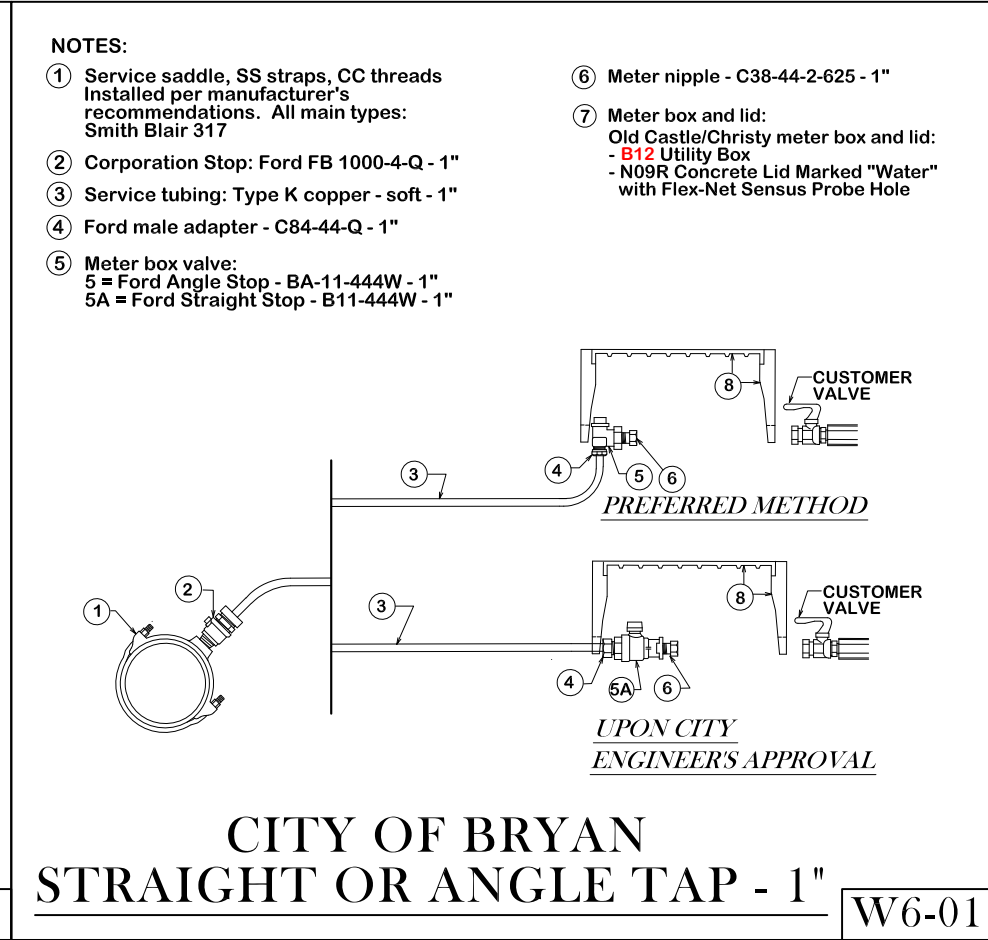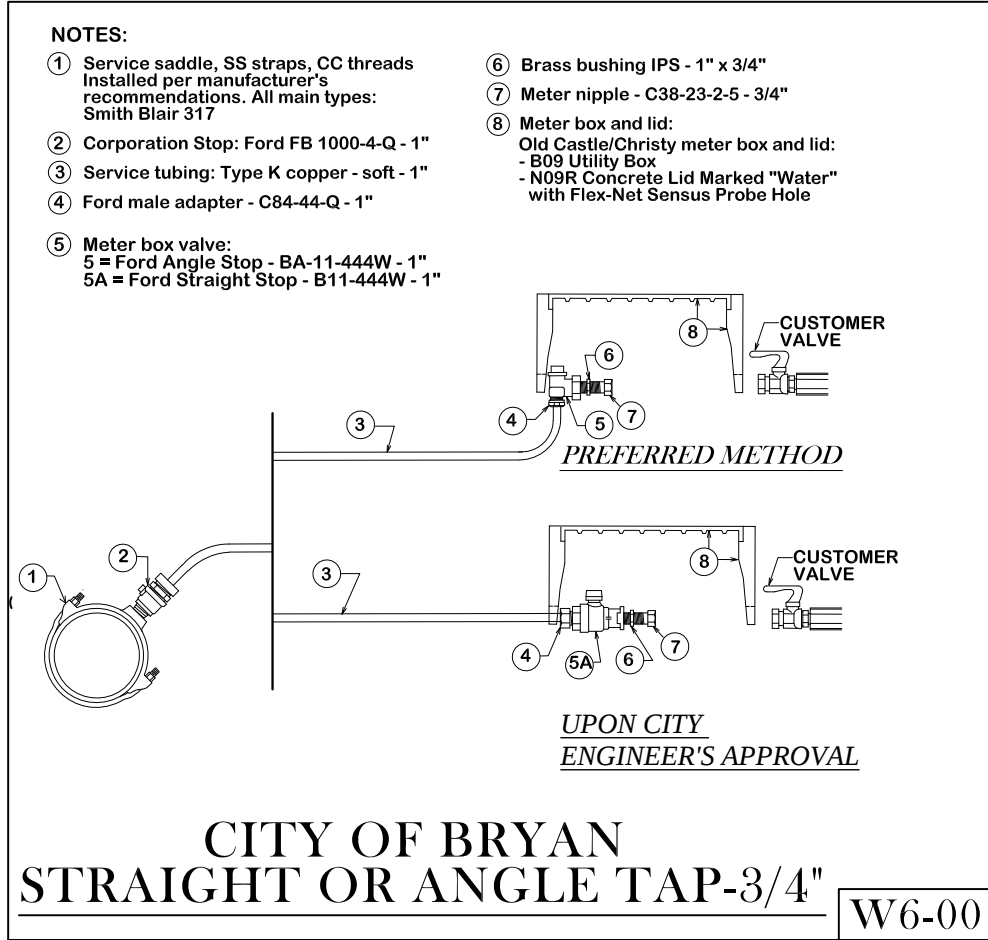

BRYAN - COLLEGE STATION  
STANDARD WATER DETAILS



DRAWN BY:  
DATE:  
SCALE:  
APPROVED:

W2

REVISIONS:  
7/1/2016 - Details W6-00 thru W6-04  
Accepted for use by COB

