


MODEL	SIZE	BY-PASS	L1	W1	H1	WEIGHT LBS
DMC4	4"	2"	8'-8"	5'-0"	4'-0"	9,000

PLAN VIEW

SENSUS

S/N 68904492

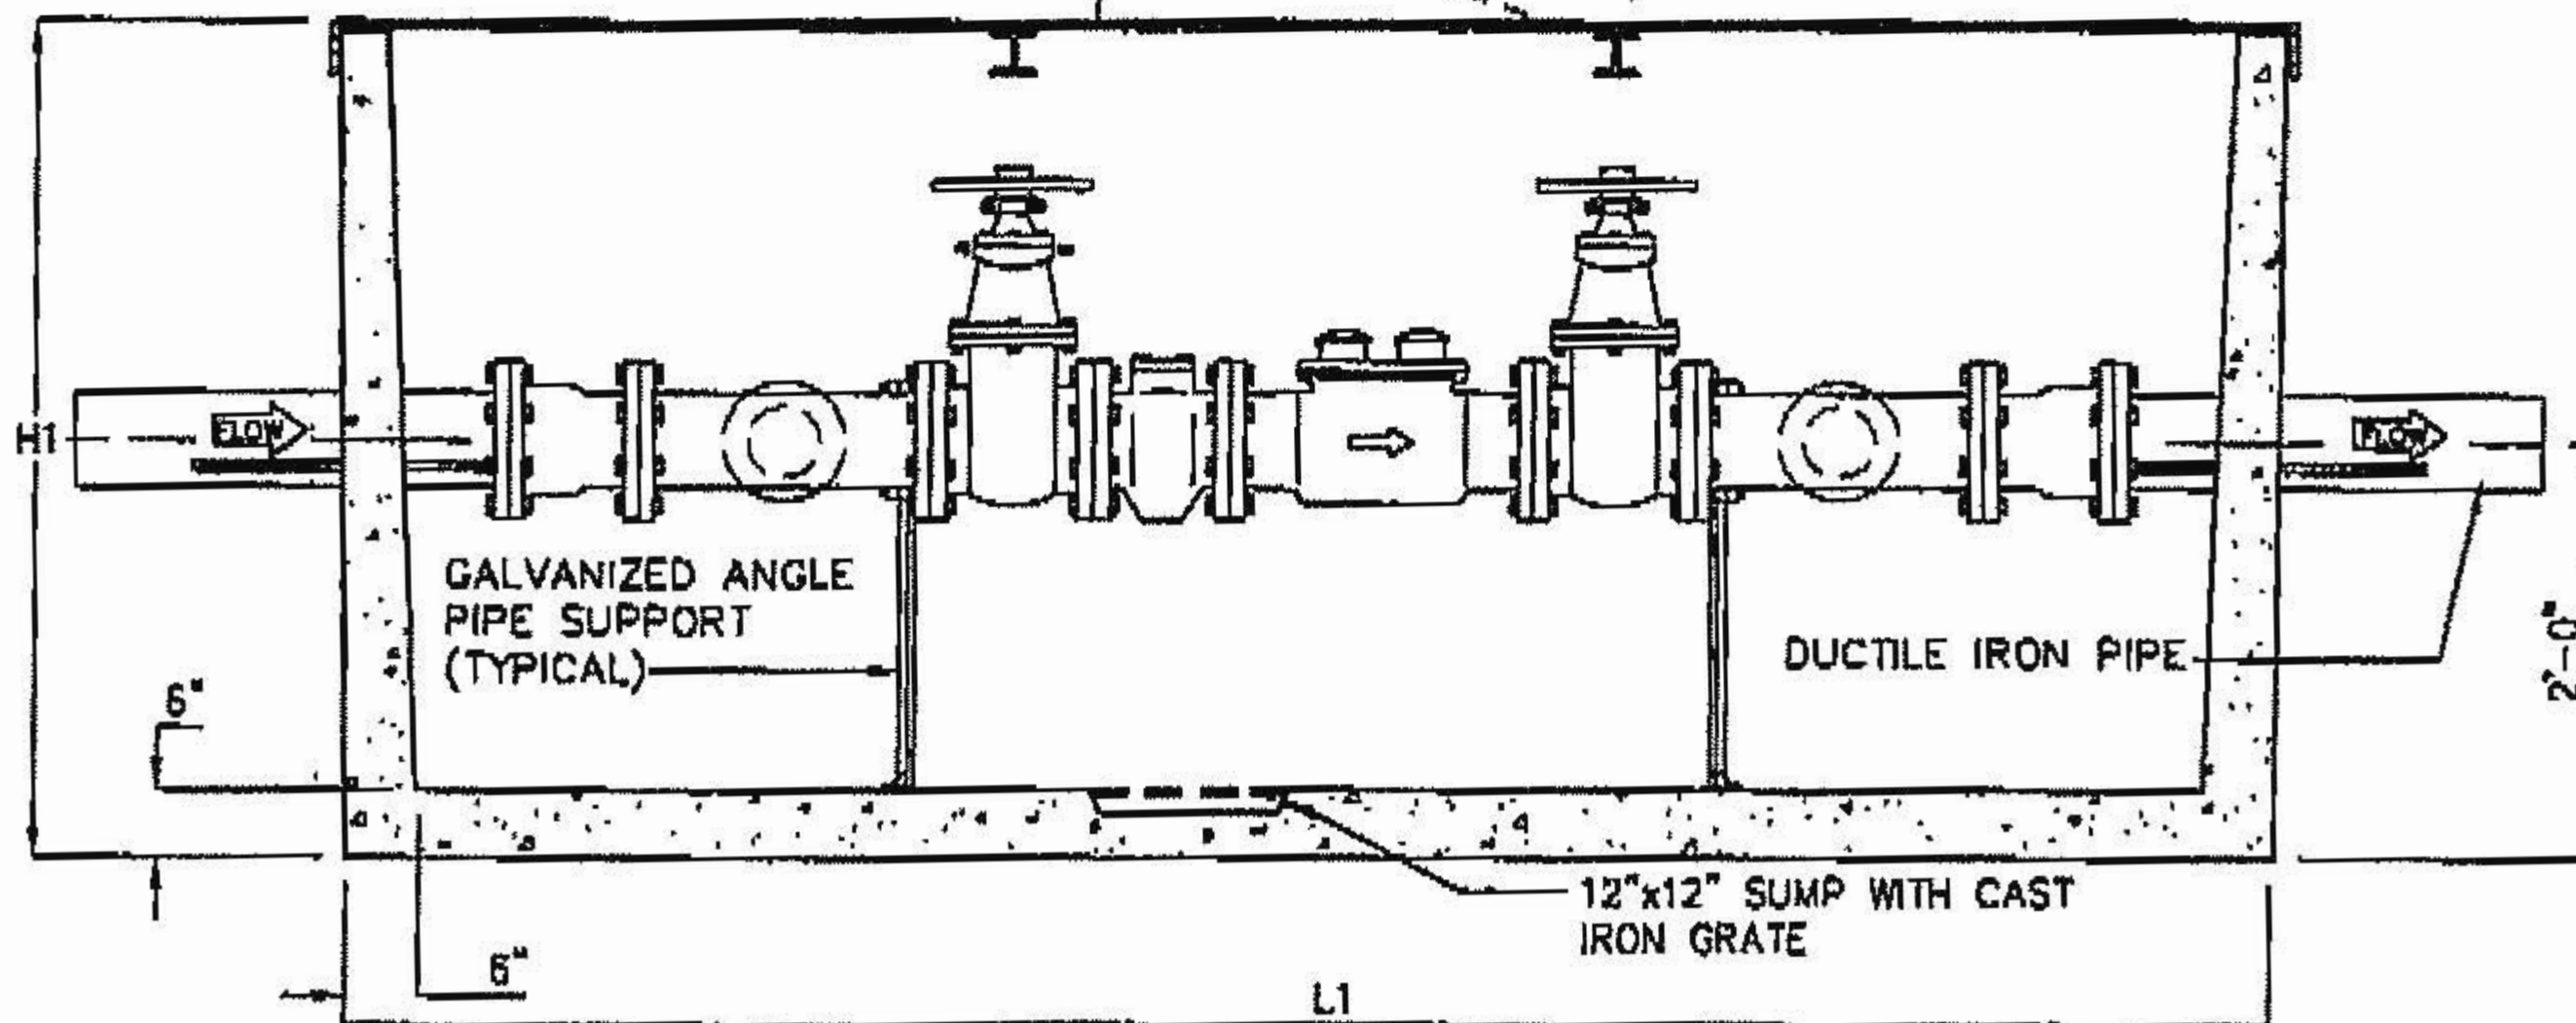

ELEVATION

© Park 2002

Specifications

- CONCRETE :** Class 1 concrete with design strength of 4500 PSI at 28 days. Unit is of monolithic construction at floor and first stage of wall with sectional riser to required depth.
- REINFORCEMENT:** Grade 60 reinforced. Steel rebar conforming to ASTM A615 on required centers or equal.
- STEEL COVER:** 1/4" steel skid-resistant floor plate welded to 3" angle frame with (2) 3x3 angle supports (300 PSF).

Engineering Data

The meter assembly shall be factory assembled in vault & hydrostatically tested prior to delivery. Field excavation & preparation shall be complete prior to delivery. Pipe, valves and fittings of the assembly shall be approved by one or more of the following associations:



PROJECT : BRUSHY WATER SUPPLY

CUSTOMER : CITY OF BRYAN

ORDER : 08-03069



800-256-8041
www.park-usa.com

"Expect the Best"

4" DOMESTIC COMPOUND WATER METER ASSEMBLY

SCALE NONE

DWG. NO.

REV.

DATE 6/31/08

DMC-4

A

DMC4-BR-0803069